

**ERBESSD INSTRUMENTS®**

# Phantom System Setup Guide Version 6



## Table of Contents

About Erbesd Instruments Phantom® .....	1
Phantom Vibration Sensor Specifications.....	1
Gen 3 Expert Triaxial Sensors .....	1
Expert Triaxial Sensors .....	2
Gen 2 Expert Triaxial Sensors .....	3
Phantom Specialty Sensor Specifications.....	4
Temperature Sensors.....	5
Thermographic Camera.....	6
Current Sensor.....	7
Speed Sensor.....	7
General Purpose Sensors.....	8
GP-8.....	8
Phantom Gateway Specifications.....	9
Gateway Version 1.....	9
Gateway 2.0.....	9
USB Gateway 2.0 PC.....	10
System Requirements for DigivibeMX Phantom Software.....	11
Required Software for DigivibeMX .....	11
Other Software.....	11
Phantom System Configuration Options .....	12
Option 1 - Local Database.....	12
Option 2 - EI-Analytic Cloud Database Service.....	13
Option 3 – EI-Analytic Cloud Database via Cellular Network.....	14
Gateway 2.0 Wi-Fi Repeater Networks.....	15
Gateway 2.0 Wired Repeater Networks .....	16
Sensor to Gateway Communications .....	16
Phantom Long Range Mode.....	17
Installing A New Phantom System .....	18
Installation Flowchart.....	19
Step 1 -Familiarization and Preparation.....	20
Every Phantom is Unique .....	20
Fast and Easy Installation .....	21
Easy Battery Replacement.....	21

Create a Database.....	22
Locating Gateways.....	22
Antennae Positioning .....	22
Step 2- Software Installation .....	23
DigivibeMX Phantom Software Installation.....	23
EI-Monitor Software Installation.....	24
Required Permissions in a Secure Network .....	24
Step 3 – Setup EI-Analytic Account.....	25
Step 4 – Assemble Gateways and Power Up.....	25
Step 5 – Setup Network Configuration .....	26
Option 1 – Ethernet Connection .....	26
Option 2 – Wi-Fi Connection .....	29
Custom Network Routes.....	33
Proxy Server Support.....	33
Repeater Network Setup.....	33
Phantom Long Range Option .....	35
Enabling Phantom Sensor Encryption .....	36
Step 6 -Creating a Local Database.....	39
Option 1: Create Single-User SQLCe Database on a Local PC .....	39
Option 2 – Multi-User SQL Database on a Network Server.....	42
Configure EI-Monitor software .....	43
Step 7 –Configure the Data Destination .....	44
Option 1 - Configure the Gateway for a Local DB .....	44
Option 2 - Send Data to EI-Analytic .....	46
Remotely Accessing a Gateway .....	47
Step 8 – Create Machine Database .....	47
Machine Manager.....	48
Creating a new Machine .....	49
Configuring Points on a Machine.....	50
Setting Axis Alarms .....	51
Adding Bearings.....	55
Adding a Gear Box.....	56
Adding a Coupling.....	57
Step 9 - Create Phantom Database.....	58
Phantom Management.....	58
Adding V10/V11 Vibration Sensors .....	61
Step 10 - Pair Sensors to Gateways and Configure Settings .....	65

Live State Screen Search and Sort.....	72
Global Collection Settings.....	74
Step 11 – Check Sensor Status and Test.....	76
Option 1 – DigivibeMX Phantom Status.....	76
Option 2 – EI-Analytic Devices.....	78
Option 3 – Wiser Vibe.....	79
Testing Sensors.....	79
USB Gateway Setup.....	85
Updating Firmware.....	87
Adding Phantom Specialty Sensors.....	88
Adding an EPH-C31 Phantom Current sensor.....	88
Adding an EPH-T20 or T25 Phantom Temperature Sensor.....	90
Adding an EPH-S40 Phantom Speed Sensor.....	93
Adding an EPH-T70 Phantom Thermographic Camera.....	96
Viewing Thermal Camera Images in DigivibeMX.....	98
Viewing Thermal Camera Images in EI-Analytic.....	100
Adding General Purpose Phantom Sensors.....	102
Adding an EPH-G60 2VPP Phantom sensor.....	102
Adding an EPH-G61 (4-20 mA) Phantom sensor.....	106
Adding an EPH-G62 Dry Contact Phantom sensor.....	110
Adding an EPH-G63 0-10 volt Phantom Sensor.....	111
Adding a GP-8.....	115
Other Phantom Tools.....	118
Replace Phantom.....	118
Pre-Add Phantom.....	119
Interval Inactivity Configuration.....	119
Battery Calculator.....	121
Storage Calculator.....	122
Phantom Triggering.....	123
Internal Triggering.....	123
Managing the Sensor Update Interval.....	125
External Triggering.....	127
RPM Trigger.....	128
Speed Sensor Link.....	130
Current Trigger.....	131
Dry Contact Trigger.....	133
4-20 mA GPIO Trigger.....	135

0-10Volt GPIO Trigger.....	136
Gateway Offline Storage.....	137
Security.....	138
Gateway Resets.....	139
Phantom Sync Feature.....	140
Manually Activated Sync Recording.....	141
Automatically Triggered Sync Recording.....	144
System Tools.....	146
Modbus.....	148
MQTT.....	149
OPC UA.....	153
Phantom Gateway Gen2 Management API.....	155
Web Socket interface.....	156
MQTT Interface.....	157
The State Object.....	157
Commands to the Gateway.....	165
EI-Analytic Notifications Manager.....	171
EI-Analytic Diagnose Manager.....	175
Accessing the Feature.....	176
Diagnose Tools.....	177
Using Diagnose Builder.....	178
Delete Faults.....	180
WiSERVIBE Mobile App.....	181
On Demand Recordings from Phantoms.....	181
Scan for Phantoms.....	182
Collecting Data.....	184
Uploading files to the Cloud.....	185
Sharing Files.....	187
Deleting Files.....	188
Open File for Analysis.....	189
Contacting Erbesd Instruments Technical Support.....	190

## About Erbesd Instruments Phantom®

Phantoms are a versatile line of machine health monitoring products. There are **Phantom sensors** for monitoring vibration, speed, temperature or current. There are also Phantom sensors capable of wirelessly transmitting data from 2vPP sensors, 4-20mA process sensors and 0-10V process sensors. Phantoms transmit their data via secure, encrypted Bluetooth Low Energy (BLE) 5.0 transmission to Wi-Fi or Ethernet-networked **Phantom Gateways**. The Gateway then delivers the sensor data to the Phantom system database, which can reside on Erbesd’s El-Analytic cloud-hosted database service, a third-party cloud database, or locally on a network server or PC.

Erbesd Instruments systems and data are protected by a comprehensive Information Security program. For details please visit the Erbesd website at: <https://www.erbesd-instruments.com/data-security-and-it-security-statement/>

## Phantom Vibration Sensor Specifications

### Gen 3 Expert Triaxial Sensors

Released in January 2023, the third generation of Expert vibration sensors feature an IP69 product rating, and easy-to-replace CR2477 batteries. Two models are available, the **EPH-V10E** is a *High Sensitivity* sensor with a frequency range from 0.5 Hz to 4kHz; the **EPH-V11E** is a *High Range* sensor with a frequency range of 10 Hz to 10K Hz.

Sensor Type	Triaxial MEMS Accelerometer
Dynamic Range(V10E)	2/4/8g Selectable
Dynamic Range(V11E)	8/16/32/64g Selectable
Sensor Accuracy	± 3dB
Freq Range (V10E)	0.5Hz–4kHz (x,y), 1.8kHz (z)
Noise Floor (V10E)	130µg/√Hz
Freq Range (V11E)	10Hz–10kHz (x,y), 5.1kHz (z)
Noise Floor (V11E)	630µg/√Hz
Sample Rate	25600 samples per second*
Internal Temperature Accuracy	±5°C
Operating Temperature Range	-30 to 80°C (-22 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	47 x 33mm (1.85 x 1.3in)
Weight	185grams (6.5oz)
Battery Type	3V Lithium CR2477
Battery Life	65,000 Recordings**
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	200m, Line of sight***
Product Rating	IP69
IEC EX Class Certifications	Ex ic IIC T5 Gc, Ex ic IIIC T85°C Dc



\* The sampling rate is selectable – see table in the next section.

\*\* Battery life is directly affected by temperature, frequency of alarms, and other factors independent of user settings.

\*\*\* Ideal environment, with no competing signals or obstructions, using Long Range scanning mode. Regular mode range is 100 meters.

## Expert Triaxial Sensors

Sold until January 2023, the first generation of Expert triaxial vibration sensors included the **EPH-V10 High Sensitivity**, and the **EPH-V11 High Range**. A battery retrofit kit is available for existing V10/V11 sensors to allow use of CR2477 batteries.

Sensor Type	Triaxial MEMS Accelerometer
Dynamic Range(V10)	2/4/8g Selectable
Dynamic Range(V11)	8/16/32g Selectable
Sensor Accuracy	± 3dB
Freq Range (V10)	0.5Hz-4kHz (x,y), 2.5kHz (z)
Noise Floor (V10)	120µg/√Hz (x,y), 200µg/√Hz (z)
Freq Range (V11)	10Hz-10kHz (x,y), 5.1kHz (z)
Noise Floor (V11)	630µg/√Hz (x,y), 900µg/√Hz (z)
Sample Rate	25600 samples per second
Internal Temperature Accuracy	±5°C
Operating Temperature Range	-30 to 80°C (-22 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	48 x 34mm (1.85 x 1.3in)
Weight	177grams (3.5oz)
Battery Type	3.6V Lithium TL-5935
Battery Life	Up to 100,000 Recordings
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	200m, Line of sight (long range mode)
Product Ratings	IP67 / MIL-STD-810G



## Gen 2 Expert Triaxial Sensors

The second generation of Expert sensors, the **EPH-V17 High Sensitivity** and **EPH-V18 High Range**, are smaller in size with the same MEMS accelerometer as the first generation. These sensors were discontinued in January 2023.

Sensor Type	Triaxial MEMS Accelerometer
Dynamic Range(V17)	2/4/8g Selectable
Dynamic Range(V18)	8/16/32g Selectable
Sensor Accuracy	± 3dB
Freq Range (V17)	0.5Hz-4kHz (x,y), 2.5kHz (z)
Noise Floor (V17)	120µg/√Hz (x,y), 200µg/√Hz (z)
Freq Range (V18)	10Hz-10kHz (x,y), 5.1kHz (z)
Noise Floor (V18)	630µg/√Hz (x,y), 900µg/√Hz (z)
Sample Rate	25600 samples per second
Internal Temperature Accuracy	±5°C
Operating Temperature Range	-30 to 80°C (-22 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	35 x 24mm (1.4 x 0.9in)
Weight	78grams (3.5oz)
Battery Type	3V Lithium CR2032
Battery Life	12,000 Recordings
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	200m, Line of sight(long range mode)
Product Ratings	IP67 / MIL-STD-810G



### V10, V17, V10E and V15 High Sensitivity sensors

Recording time (s) 3 axes	0.64	1.28	2.56	5.12	10.24	20.48	40.96	81.92
Recording time (s) 1 axes	2.56	5.12	10.24	20.48	40.96	81.92	163.84	327.68
Sample rate (Hz)	25,600	12,800	6400	3200	1600	800	400	200
Max frequency (Hz) [x,y]	4000	4000	2500	1250	625	312.5	156.25	78.125
Max frequency (Hz) [z]	1800	1800	1800	1250	625	312.5	156.25	78.125
Lines of Resolution	Triaxial-12,800 Single Axis-25,600							
Spectral noise (@10 Hz)	130 µg/√Hz							


### V11, V18, V11E and V16 High Range sensors

Recording time (s) 3 axes	0.64	1.28	2.56	5.12	10.24	20.48	40.96	81.92
Recording time (s) 1 axes	2.56	5.12	10.24	20.48	40.96	81.92	163.84	327.68
Sample rate (Hz)	25,600	12,800	6400	3200	1600	800	400	200
Max frequency (Hz) [x,y]	10,000	5000	2500	1250	625	312.5	156.25	78.125
Max frequency (Hz) [z]	5100	5000	2500	1250	625	312.5	156.25	78.125
Lines of Resolution	Triaxial-12,800 Single Axis-25,600							
Spectral noise (@10 Hz)	630 µg/√Hz							

## Phantom Specialty Sensor Specifications

All Phantom Specialty sensors have the same form factor (size and weight). All can be either battery powered (they come equipped with 2-AA Lithium batteries) or can be hard-wired to a power source locally (5 to 24 VDC @1 A). Six M4 x 12 Hex-head machine screws secure the back plate to the body of the sensor. These screws should be tightened in a radial pattern to a torque value of 2 NM (17.7 in-lb). It is recommended to use either a top drive digital torque screwdriver or a manual torque screwdriver. Using a traditional torque wrench could induce unnecessary side load.

The sensors have cable glands for each channel to route and secure wiring.

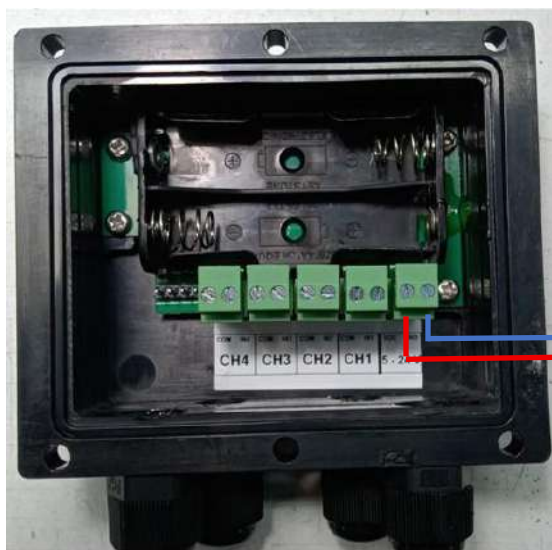

**Optional External  
Power supply connection  
5 - 24VDC/1A**

Use the supplied Pitch connector plugs to terminate wiring, then plug into the socket.



The Plug portion of these connectors can be found here: <https://www.mouser.mx/ProductDetail/649-220008-D021B01LF>

## Temperature Sensors

Erbessd offers two types of Phantom temperature sensor, the EPH-T20 is a non-contact spot infrared radiometer, and the EPH-T25 which supports K type thermocouples and has 3 channels. Thermocouple cables are sold separately in lengths up to 5 meters.

Sensor type	EPH-T20 spot radiometer
Temperature Range - Object	-70 to 380°C (-94 to 716°F)
Temperature Range - Base	-30 to 80°C (-22 to 176°F)
Temperature Range - Ambient	-30 to 125°C (-22 to 257°F)
Sensor Accuracy	±5°C
Resolution	0.25°C (0.45°F)
Effective Range	1 to 10 cm
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	125mm x 100mm x 37mm
Weight	500 grams
Battery Type	2 x AA Lithium
Battery Life	3-5 years
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	100 meters line of sight
Product Ratings	IP67 / MIL-STD-810G



Sensor type	EPH-T25 K type Thermocouple
Temperature Range - Object	-100 to 1250°C (-212 to 2282°F)
Temperature Range - Base	-40 to 80°C (-40 to 176°F)
Temperature Range - Ambient	-40 to 80°C (-40 to 176°F)
Channels	3
Sensor Accuracy	±5°C
Resolution	0.25°C (0.45°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	125mm x 100mm x 37mm
Weight	500 grams
Battery Type	2 x AA Lithium
Battery Life	12,000 measurements
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	100 meters line of sight
Product Ratings	IP67 / MIL-STD-810G



## Thermographic Camera

The Erbesd EPH-T70 Phantom thermographic camera has a 32 by 24 pixel infrared sensor array with a 110 degree high by 75 degree wide field of view. It is intended for use with objects/targets at a distance of 1 meter (approx 39 in.) or less.

Sensor type	EPH-T70 Thermographic IR Camera
Temperature Range - Object	-40 to 300°C (-40 to 572°F)
Temperature Range - Base	-40 to 75°C (-40 to 176°F)
Field Of View (FOV)	110° high by 75° wide
Frames to capture	1 to 16
Capture Rate	0.25 to 4 fps
Sensor Accuracy	±1°C
Max distance to object	1 meter
Size	125mm x 100mm x 37mm
Weight	500 grams
Battery Type	2 x AA Lithium
Battery Life	1-2 years
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	100 meters line of sight
Product Ratings	IP5X



The area monitored by the EPH-T70, based on the Field Of View (FOV) is shown in the table below:

FOV 110 x 75 degrees

distance (cm)	Imaged area	
	Height	Width
5	14.28	7.67
10	28.56	15.35
15	42.84	23.02
20	57.13	30.69
25	71.41	38.37
30	85.69	46.04
40	114.25	61.39
50	142.81	76.73
60	171.38	92.08
70	199.94	107.43
80	228.50	122.77
90	257.07	138.12
100	285.63	153.47

## Current Sensor

The Erbesd EPH-C31 current sensor supports 4 channels up to 500 Amperes. Four types of current clamp are available -50A, 100A, 250A and 500A. (sold in sets of 3)

Sensor Type	EPH-C31 Current
Current Clamps	50A/100A/250A/500A
Frequency	50-400Hz
Sensor Accuracy	50A±0.5%/100A±1.5%/250A & 500A±1%
Channels	4
Operating Temperature Range	-40 to 80°C (-40 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	125mm x 100mm x 37mm
Weight	500 grams
Battery Type	2 x AA Lithium
Battery Life	12,000 measurements
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	100 meters line of sight
Product Ratings	IP67 / MIL-STD-810G



CT Clamps

## Speed Sensor

The EPH-S40 speed sensor uses a Hall effect sensor/magnet(included with sensor).

Sensor Type	EPH-S40 Tachometer
Switching Speed	600k RPM
RPM Range	0-200,000 RPM
Sensor Gap	5mm to 15mm (0.2 in to 0.6 in)
Receiver	Hall Effect Omni-polar
Magnet type	Neodymium
Operating Temperature Range	-40 to 80°C (-40 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	125mm x 100mm x 37mm
Weight	500 grams
Battery Type	2 x AA Lithium
Battery Life	12,000 measurements
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	100 meters line of sight
Product Ratings	IP67 / MIL-STD-810G



Hall effect sensor & magnet

## General Purpose Sensors

Erbessd offers four general-purpose sensors.

Sensor Type	Interface	Channels
EPH-G60	2 V peak-to-peak sensors	2
EPH-G61	4-20 mA sensors	4
EPH-G62	Dry Contact	4
EPH-G63	0-10 Volts sensors	4



EPH-G60



EPH-G61



EPH-G62



EPH-G63

All four general purpose sensors share the following specifications:

Operating Temperature Range	-40 to 80°C (-40 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	125mm x 100mm x 37mm
Weight	500 grams
Battery Type	2 x AA Lithium
Battery Life	12,000 measurements
Transmission Type	Encrypted 2.4 GHz BLE 5.0
Range to Gateway	100 meters line of sight
Product Ratings	IP67 / MIL-STD-810G

## GP-8

The GP8 is a universal wireless adapter to interface with standard ICP accelerometers

Sensor Type	Universal Accelerometer Wireless Adapter
Power Supply	5VDC / 1A
Input Connector	BNC female
Channels	8 Channels
Sampling Rate	31,250 Hz
Internal Temperature Accuracy	± 5 °C (± 41 °F)
Operating Temperatures	-40 to 75°C (-40 to 167 °F)
Size	102mm x 83mm x 51mm (4x3.3x2 in.)
Weight	350 grams (12.5 oz)
Transmission Type	2.4 GHz BLE 5.0
Distance Range	100 meters line of sight
IP Rating	IP65



## Phantom Gateway Specifications

### Gateway Version 1

Gateway version 1 was end-of-sale in January 2023, replaced by Gateway 2.0.

The specifications include:

Product Code	<b>EPH-GW</b>
Receiver Type	Encrypted 2.4 GHz BLE 5.0
BLE Reception/WiFi Transmission Range	100 meters line of sight
Operating Temperature Range	-40 to 80°C (-40 to 176°F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	88 x 69 x 30mm (3.4 x 2.5 x 1.2 in.)
Weight	165 grams (5.9 oz)
Antenna Connector	Two RP-SMA male
Input Power	5 VDC - 2 Amps
Wi-Fi Protocol	802.11 B and G
IEEE Standard Compliance	IEEE 802.3
Mounting	Dinrail
Sensor Capacity	100
Comm Protocols Supported	Modbus TCP/IP, UDP/HTTPS/DHCP
Wired Network Interface	RJ-45 Ethernet 10/100



Gateway V1

### Gateway 2.0

Gateway 2.0 was released in January 2023 and is the only version currently for sale.

The specifications for Gateway 2.0 are:

Product Code	<b>EPH-GW2</b>
Receiver Type	Encrypted 2.4 GHz BLE 5.0
BLE Reception/WiFi Transmission Range	200m, Line of sight (long range mode)
Operating Temperature Range	-7 to 60 °C (20 to 140 °F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	88 x 69 x 30mm (3.4 x 2.5 x 1.2 in.)
Weight	170 grams (6.1 oz)
Antenna Connector	Two RP-SMA male
Input Power	Dual power - 5 VDC (4-pin connector) or 9-24 VDC (pitch connector)
Input Current Required	2 Amps
Wi-Fi Protocol	802.11 B, G, N - 2.4 and 5 Ghz
Wi-Fi Security	WEP, WPA-2 Personal, WPA-2 Enterprise
IEEE Standard Compliance	IEEE 802.3
Mounting	Dinrail
Sensor Capacity	250 suggested max
Comm Protocols Supported	Modbus TCP/IP, UDP/HTTPS/DHCP/MQTT/OPC UA
Wired Network Interface	RJ-45 Ethernet 10/100
Storage Capacity	100,000 recordings on embedded Micro SD Card



Gateway 2.0



## USB Gateway 2.0 PC

The USB Gateway 2.0 PC was released in 2024. This version connects to any Windows® Device via USB and uses the device's network connection to access a database, local or cloud.



Product Code	<b>EPH-USB-GW</b>
Receiver Type	Encrypted 2.4 GHz BLE 5.0
BLE Reception/WiFi Transmission Range	200m, Line of sight (long range mode)
Operating Temperature Range	-7 to 60 °C (20 to 140 °F)
Storage Temperature Range	-60 to 105°C (-76 to 221°F)
Size	69 x 39 x 17mm (2.72 x 1.52 x 0.65 in.)
Weight	50 grams (1.8 oz)
Antenna Connector	RP-SMA male
Input Power	5 VDC via USB
Input Current Required	1 Amp max
Wi-Fi Protocol	802.11 B and G
Mounting	None
Sensor Capacity	250
Comm Protocols Supported	ModbusTCP/IP, UDP/HTTPS/DHCP/MQTT/OPC UA
Protection Grade	IP54
Storage Capacity	Offline files stored on Windows device

## System Requirements for DigivibeMX Phantom Software

Minimum desktop PC, laptop or tablet computer system requirements for *DigivibeMX Phantom* software installation:

- 64-bit (x64) system is required. **32-bit (x86) systems are not compatible with DigivibeMX Phantom**
- Windows 10 or newer OS preferred
- Intel® Celeron® processor (1.60 GHz / 400MHz) or higher
- 4GB RAM minimum (8GB recommended)
- SVGA/HDMI (touch screens are supported)
- Minimum of 500 MB disk space
- Ethernet/WiFi connection (for communication with EI-Gateway)

## Required Software for DigivibeMX

- **MySQL Connector Net 6.5.4** (Included with system purchase)
- **SSCERuntime\_x64** (For SQLCe, included with system purchase)
- **MicrosoftEdgeWebview2 Plugin** (Included with system purchase)
- **Acrobat Reader 7.0** or higher (for opening user manual and reports)

## Other Software

- **EI-Monitor:** (also called EI-Monitoring) Phantom system monitoring software - used for local network databases only (Included with system purchase). This software relays data from gateways to a local SQL database.
- **WiSERVIBE** – free mobile app used as an option to collect on-demand recordings from Phantoms.
- **Phantom Manager mobile app** (for iOS and Android) – only required for EPH-T70 Thermographic Camera Live View feature. (no cost to download from Google Play Store or the Apple App Store).
- **USB Gateway Utility** – Installs the Windows© Service to operate the USB Gateway.


## Phantom System Configuration Options

Phantom is a versatile system, compatible with a wide range of off-the-shelf hardware. It is impossible to predict all of the unique hardware and software configurations a user might implement, in order to adapt a Phantom system for their specific needs. There are 3 primary configuration models for receiving data from a Phantom system, described as follows:

### Option 1 - Local Database

The Phantom system supports SQL CE databases, typically used on a PC. Phantom also supports SQL and MySQL databases, usually resident on a server.

- DigivibeMX Phantom software is required to manage the database and analyze sensor data.
- EI-Monitor software, which relays data from the gateways to the local database, also needs to be installed, preferably on the same PC/server as the database.
- The gateways send data to EI-Monitor on Ethernet TCP port 11050.
- The EI Monitor software relays data to the local database on TCP port 1433 for SQL servers, or TCP Port 3306 for MySQL servers.
- Static or Dynamic (DHCP) IP addressing is supported. When Static addressing is selected, the DNS server can also be configured.
- If the EI-Monitor and the Phantom gateways are configured in separate VLANs or subnets, routing between them must be established.
- The Web Portal (app.eianalytics.com) and the WiSERVIBE app for IOS/Android are not supported with local databases.
- Notifications via email/WiSERVIBE app are not supported with local databases.

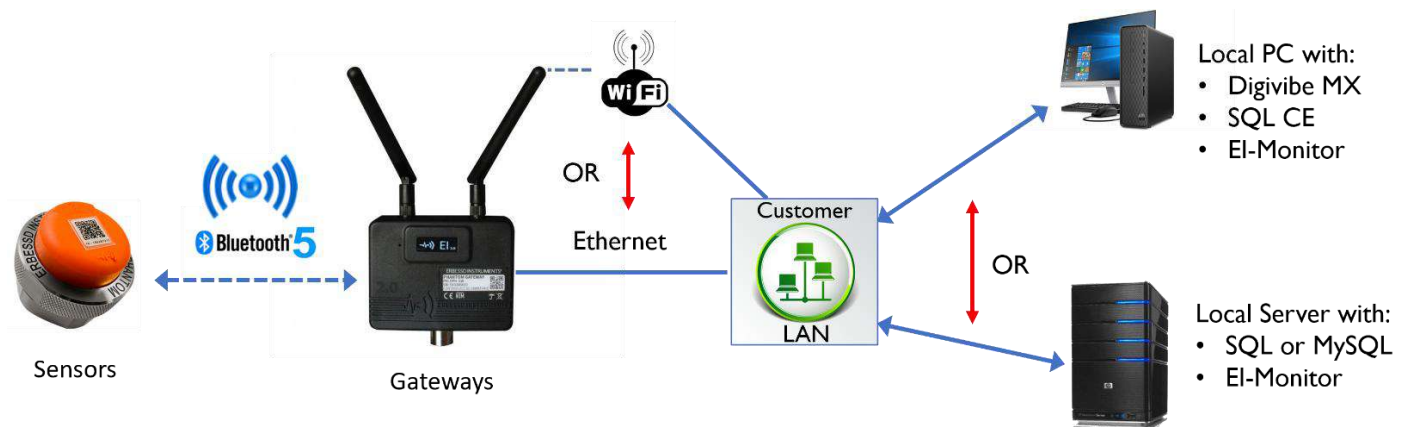


## Option 2 - EI-Analytic Cloud Database Service

Erbessd Instruments EI-Analytic is a cloud-based monitoring and data integration service. A free account can be created with a size limit of 1 GB. Paid subscriptions start at 10 GB in size and can expand to multiple TB.

Advantages of using the EI-Analytic cloud service to store Phantom data include:

- No need to backup data. (Data can be copied from the cloud to a local filesystem on demand)
- EI-Analytic provides a Web Portal (app.eianalytic.com) and supports the WiSER VIBE mobile app for IOS/Android, both of which can be used to manage a Phantom database as an alternative to DigivibeMX.
- A flexible Task Manager feature to configure email and push notifications for alarms.
- EI-Monitor software is NOT required, the Gateways relay data directly to the EI-Analytic cloud database.
- Secure communications between Gateways and EI-Analytic use HTTPS over **TCP port 443**.
- Gateways attempt to connect with <https://eiaws.eianalytic.com/PhantomService.svc/> upon bootup to start a secure session with EI-Analytic using TLS 1.3.
- URL's used are eiaws.eianalytic.com and rt.app.eianalytic.com

**Note-** DigivibeMX v11 is also configured to use **TCP port 443** for communication with an EI-Analytic database.

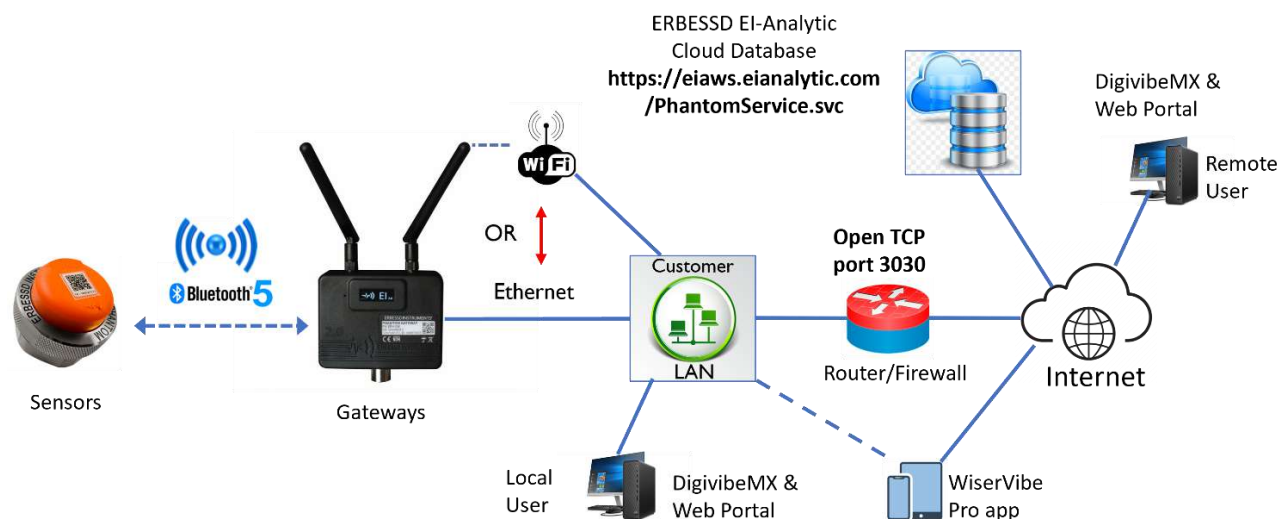


### Option 3 – EI-Analytic Cloud Database via Cellular Network

This option is very popular in scenarios where using a customer network is not possible. A cellular data network (LTE or 5G) subscription is required to create an *overlay* network that has NO connection to a customer network.

This option offers:

- All the benefits of the Erbesd EI-Analytic database service.
- No IT involvement necessary (assuming local user can access Internet/HTTPS).
- All communications to EI-Analytic cloud are secured end-to-end using HTTPS on **TCP port 443**.
- Gateways attempt to connect with <https://eiaws.eianalytic.com/PhantomService.svc/> upon bootup.
- URL's used are [eiaws.eianalytic.com](https://eiaws.eianalytic.com) and [rt.app.eianalytic.com](https://rt.app.eianalytic.com)

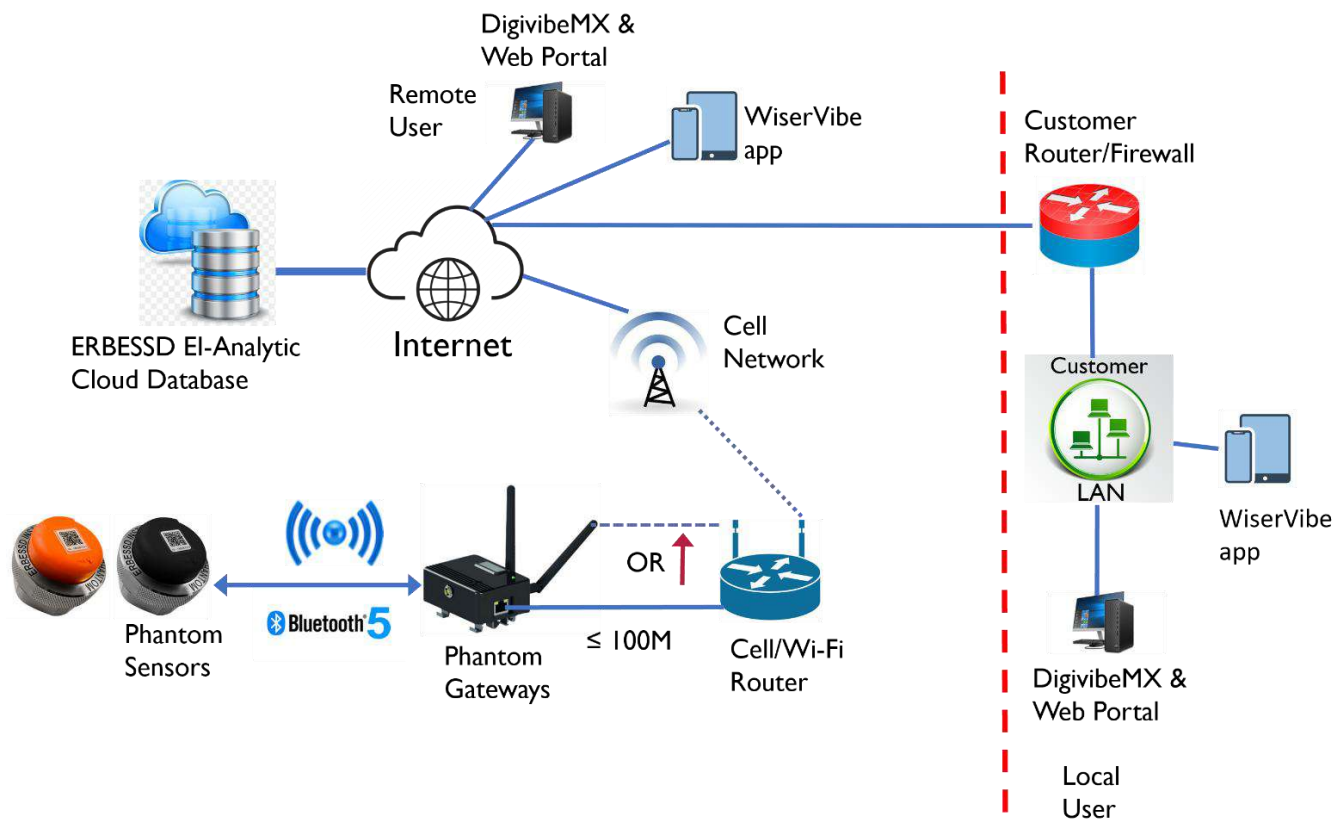


## Gateway 2.0 Wi-Fi Repeater Networks

Phantom Gateway 2.0 with [Firmware Version 49](#) or higher can be configured as a standalone Wi-Fi network to extend range or share a network connection. The **Repeater Network** parameter allows each gateway to be configured as a **Main** or a **Subordinate**.


- All gateways must be version 2.0 and have **the same firmware version**. ( gateway v1 uses a different networking method for Repeater mode).
- The Main gateway creates a NON-PUBLIC Wi-Fi network for communication with Subordinate(Sub) gateways within range. The name of the Wi-Fi network created is **not discoverable** by any device.
- The Main GW can support up to 250 Phantom sensors. The number of Subs used does not affect this limit. All sensors *pair* with the Main GW.
- Only the Main GW is assigned an IP address from the network(DHCP or static).
- Sub gateways are assigned non-routable link-local IP addresses by the Main gateway.
- Individual Gateway Admin Consoles are accessed through the Main gateway Admin console (**Repeater** tab on the main menu). **Note** -Subs do not need to be registered in EI-Analytic.
- Global Collection Settings are configured only in the Main GW.
- Subordinates can connect directly or indirectly to the Main GW.
- All Modbus, MQTT and OPC UA data from Subs is stored in the Main GW.

**Note**- in this configuration, it is highly recommended to use Ethernet as the connection method to the Network instead of Wi-Fi. The combination of Network and Repeater Wi-Fi networks can cause traffic congestion at the Gateway.

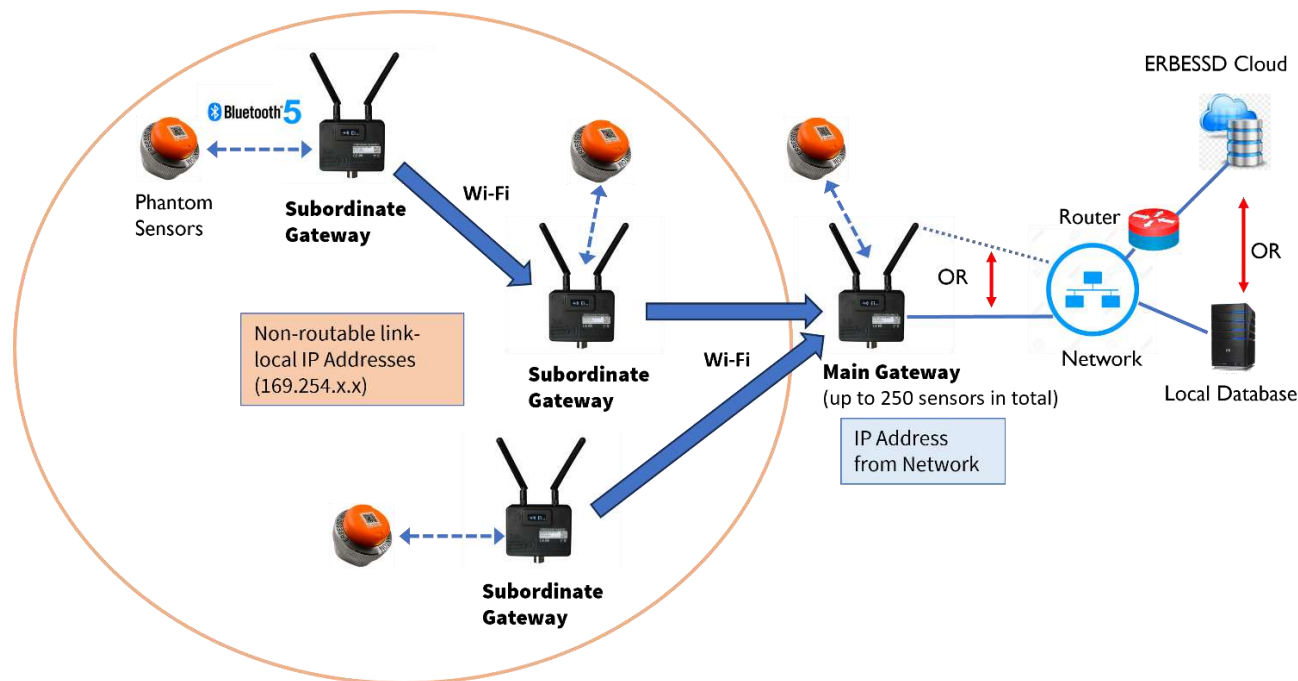

## Gateway 2.0 Wired Repeater Networks

The RJ-45 Ethernet port on the Main Gateway may be used to connect to a Repeater network. In this option, the Wi-Fi option must be used to connect the Main Gateway to the network with Internet access.

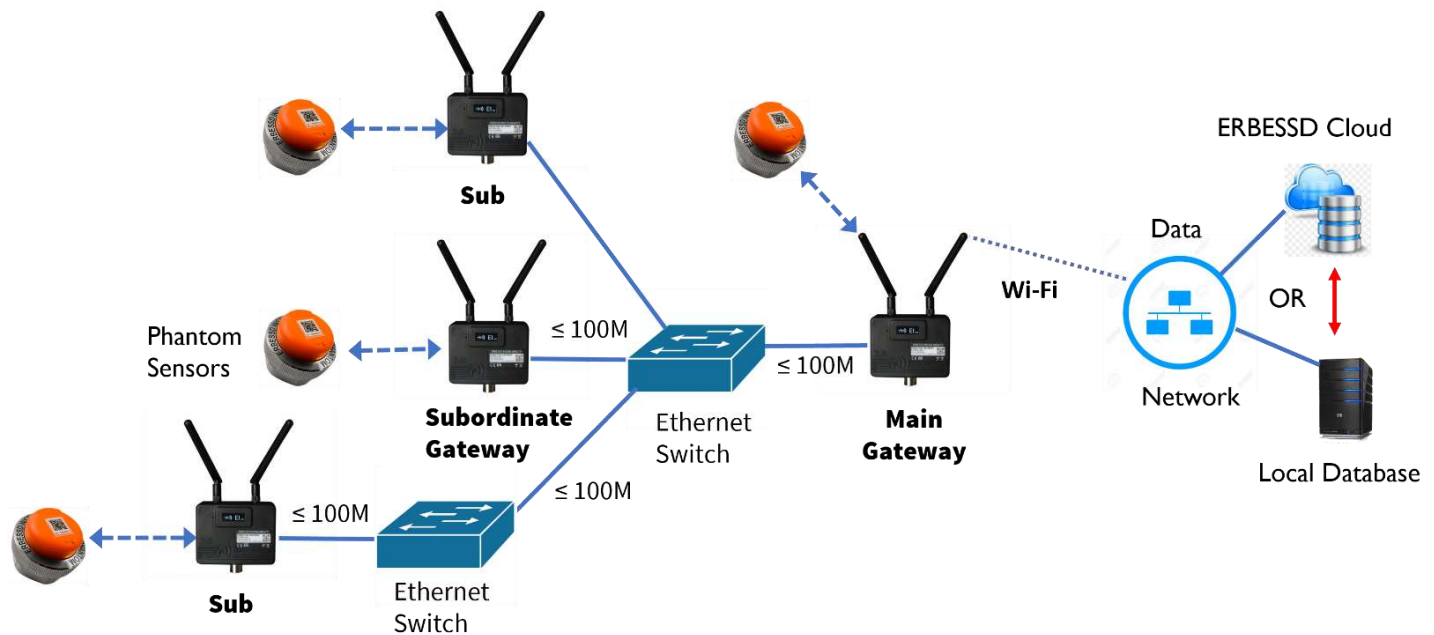

## Sensor to Gateway Communications

- Phantoms employ Bluetooth Low Energy (BLE) 5.0, which uses the 2.4GHz frequency spectrum. This is the same frequency band as Wi-Fi, found in commercial and residential settings. As with Wi-Fi, signal interference is caused by physical obstructions such as cement/cinder block walls and metallic objects. A wireless survey of the areas where Phantom sensors and gateways are to be deployed should be undertaken to determine the number and placement of gateways required for adequate coverage.
- Phantom sensor to gateway communication can be 128-bit AES encrypted. Every Phantom sensor is equipped with a Cryptocell 310 Cryptographic processor. See Gateway configuration section.
- Phantoms send a beacon every 2 seconds by default to the gateway via BLE Advertising. This timing may be configured to a lower value in the sensor settings.
- Phantom sensors are automatically detected by their advertising beacon, when in range and not in *Sleep* mode, by one or more Phantom gateways. The gateway Admin Console web interface is used to “pair” sensors to gateways and manage all their settings.
- Phantom Expert vibration sensors collect and send two types of data:
  - RMS data** (aka small data - about 8 bytes) includes an RMS velocity value for each axis, bluetooth signal strength, temperature and battery voltage.
  - Full data collection** (aka big data - approx 150 Kb signal file). Includes a Time Waveform in addition to temperature and battery voltage.
  - Vibration sensors store both small and big data in internal memory until it can be transmitted to a gateway. Only one data collection of each type is stored internally due to memory size constraints. Once sent, the data is in a secure proprietary data file format.
- To improve battery life and minimize induced noise on a recorded signal, Phantom vibration sensors disconnect Bluetooth to the Gateway while a vibration signal is being recorded.

## Phantom Long Range Mode

The Phantom Long Range option can be used to increase the distance between a Phantom Expert triaxial vibration sensor and a Phantom Gateway 2.0 to up to 200 meters line-of-sight. The Gateway Bluetooth scanning mode can be set to Regular, Long Range only, or both Long Range and Regular.

Some important notes:


- Phantom Gateway firmware version 54 or higher is a pre-requisite for this feature.
- Phantom Expert Triaxial Vibration Sensor firmware version 186 or newer is required on EPH-V11, V11E, and EPH-V10, V10E models.
- When set to Long Range mode, Phantom sensor battery life is affected. An estimated 15-20% life cycle reduction should be expected.
- The available bandwidth between sensor and gateway in Regular mode is 1 Mbps, in Long Range mode it is reduced to 500 kbps.
- Phantom Gateways cannot scan in Regular mode and Long Range mode simultaneously. The Gateway alternates between Regular and Long Range mode for brief periods of time. In Regular mode, a Phantom vibration sensor will attempt to communicate with a Gateway every 2 seconds. The actual amount of time varies by Gateway CPU load. However if the Gateway is operating in dual mode, that interval will increase to 10 seconds or more, again depending on Gateway load. This could impact any Phantoms that are powered locally and are set to provide data updates to the Gateway at frequent intervals, such as an RPM Phantom set to continuous mode. Any Phantom with an update interval under 10 seconds will be affected by enabling Long Range mode; these include the EPH-C31 Current Phantom and EPH-G62 Dry Contact.

## Installing A New Phantom System

The installation of a new Phantom system can be achieved by performing the following steps :

- Step 1.** Inventory Phantom sensors and create a spreadsheet database.
- Step 2.** Install required Software (DigivibeMX and optionally EI-Monitor).
- Step 3.** Set up EI-Analytic Account.
- Step 4.** Assemble gateways and power up.
- Step 5.** Set up Network configuration (Ethernet or Wi-Fi).
- Step 6.** Create a local database (SQLCe, SQL,MySQL)and configure EI-Monitor (optional)
- Step 7.** Configure Data destination(local or cloud) in gateways.
- Step 8.** Create the Machine database using Machine Manager.
- Step 9.** Create and assign Phantom sensors to Machines.
- Step10.** Pair sensors to gateways and configure settings.
- Step 11.** Check sensor status and test data collection.

## Installation Flowchart

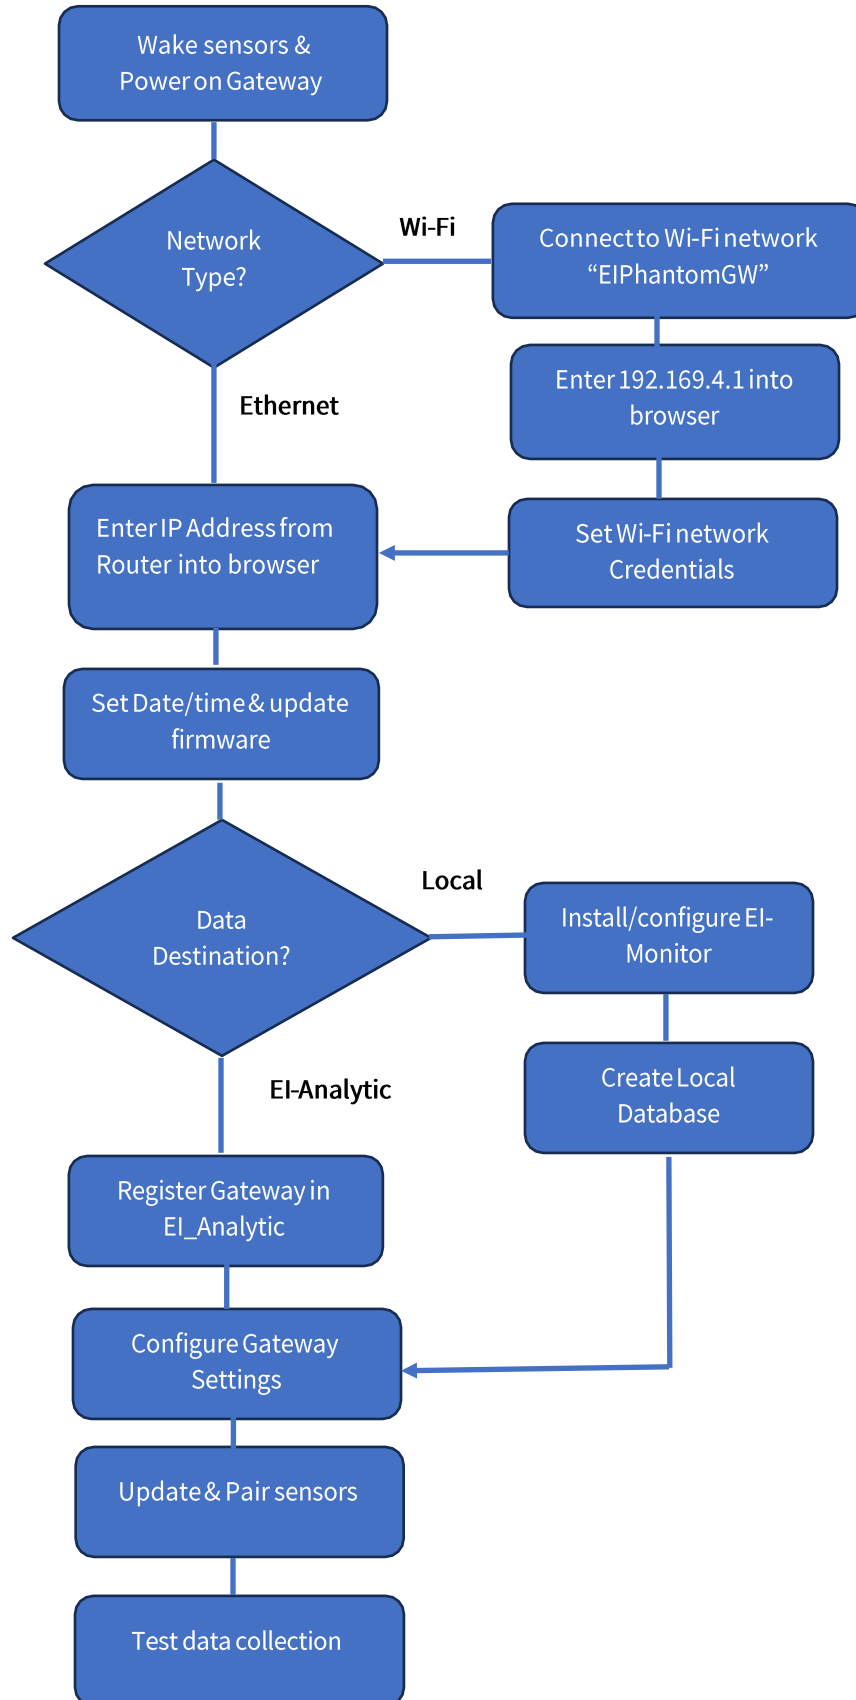

## Step 1 -Familiarization and Preparation

Phantom system components and software are designed to install easily and integrate seamlessly. However, a little bit of preparation and product familiarization can save time and prevent frustration during the installation and setup process.

### Every Phantom is Unique

To precisely identify individual sensors and monitored data collection locations, every Phantom sensor is encoded with a unique serial number – which is translated to a QR Code for quick scanning purposes.

The model of this sensor is: EPH-V11E (accelerometer high-sensitivity)

The 2-digit product code for all EPH-V11E sensors is: **11**

The unique 9-digit serial number for the sensor pictured is: **189295990**.



## Fast and Easy Installation

Phantom Gen 3 vibration sensors are designed with an integral adhesive mounting surface and common 1/4"-28 thread receptacle. The large knurled ring compresses an o-ring between the top of the sensor and the base. When loosened, the orientation of the sensor may be rotated as needed. The knurled ring is locked in place by a set screw. Tighten the knurled ring hand-tight or to approx. 25 in/lbs of torque to compress the o-ring for a proper seal. Phantoms are shipped with a stud installed, so they can also be permanently installed via drill/tap or affixed to a shielded magnetic base for portability.



All Expert Phantoms have the axis orientation marked on top to align the sensor when installing on the machine point.

The Gen 3 Phantom Expert sensors consist of four parts, the base, sensor body, battery and knurled ring with set-screw.



## Easy Battery Replacement

The Expert Phantoms are shipped with a Panasonic CR2477 battery. The battery slides out of the holder easily for replacement.

**Note** – Not all CR2477 batteries have the same specifications. For example, the maximum operating temperature may vary between manufacturers. Panasonic batteries are recommended.



## Create a Database

Before beginning the hardware and software configuration process, Erbesd Instruments recommends documenting the unique ID number of each Phantom (auto-detected or manually-entered) and its machine health monitoring location. This will prevent a great deal of running back and forth to identify sensor IDs and their locations later, especially when it is time to build the machine database and assign sensors. A simple spreadsheet can be created that may look something like this:


Sensor ID	Location
11-189286917	PressurePump001 – Motor Non Drive End
11-189286918	PressurePump001 – Motor Driven End
11-189286919	PressurePump001 – Pump Driven End
11-189286920	PressurePump001 – Pump Non Driven End

## Locating Gateways


Gateways require AC power and must be located accordingly. They should be mounted as centrally as possible among the sensors they serve. The Gateway Admin Console Live State shows the signal strength of each sensor in bar-graph format. The signal strength for Phantoms is rated as either Good(-50 to -75dBm), OK(-76 to -90dBm), or Poor (less than -90dBm). In addition, the Phantom Manager App for iOS or Android devices has a signal strength tool, used to help determine if the Bluetooth signal between sensor and gateway is strong enough for proper operation. See the *Phantom Manager Mobile App* section of this guide for details.

## Antennae Positioning

The Bluetooth chip antenna in a Phantom sensor has a rating of **0.34dBi**, meaning its signal dispersion pattern relatively spherical as shown. The higher the dBi rating, the more directional the pattern becomes. A high dBi antenna's signal can go farther, but is more focused. Under 2 dBi is considered spherical.

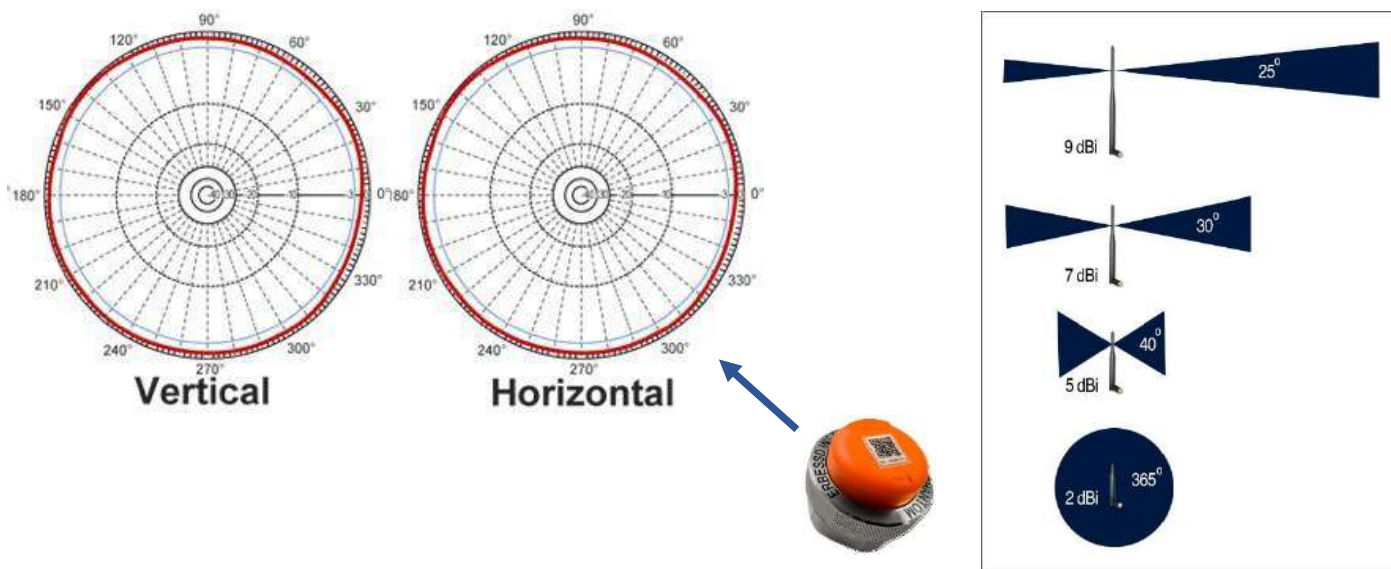

The Phantom Gateway antennae are both 3dBi rated, so the dispersion pattern is a bit more flattened and directional:

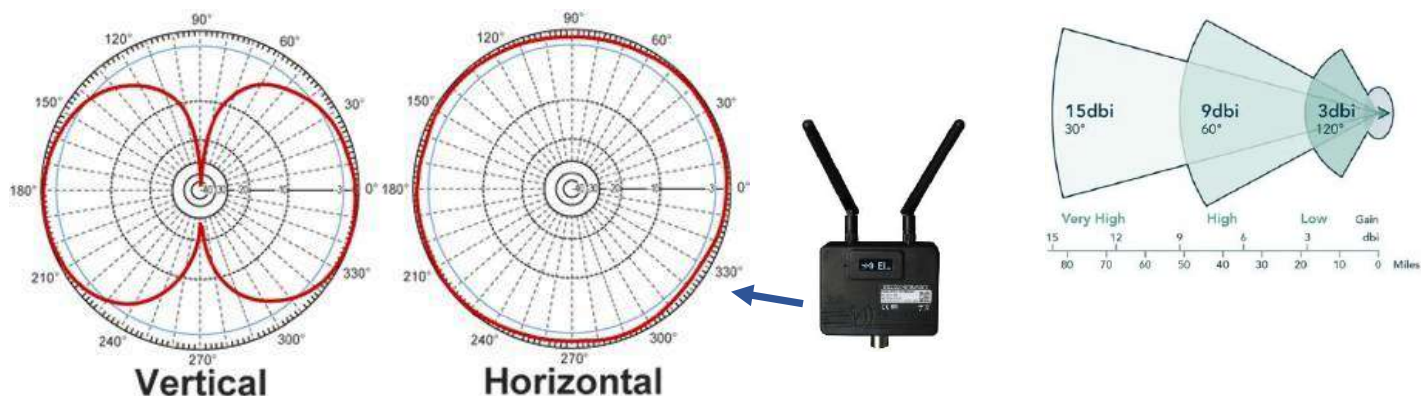

Adjusting the Gateway antennae is often necessary to improve the signal for sensors placed directly above or below a Gateway.

## Step 2- Software Installation

### DigivibeMX Phantom Software Installation

From USB or Download: Open the *DigivibeMX\_P\_DV11P.11xx* folder location in Windows Explorer.


Open the IMPORTANT INSTALLATION INFORMATION text file and follow the instructions provided. Currently this includes:

1. Install the MySQL connector by double-clicking on mysql-connector-net-6.5.4.
2. Install SSCE Runtime by double-clicking on SSCERuntime\_x64-ENU.
3. Install the WebView2plugin by double-clicking on MicrosoftEdgeWebview2Setup.exe.
4. Install *DigivibeMX* by double-clicking on the setup.exe file.

IMPORTANT INSTALLATION INFORM...	Text Document	1 KB	No	1 KB	38%	1/27/2022 10:44 AM
MicrosoftEdgeWebview2Setup	Application	1,643 KB	No	1,740 KB	6%	12/8/2021 4:31 PM
mysql-connector-net-6.5.4	Windows Installer Package	12,212 KB	No	13,112 KB	7%	8/19/2015 10:04 AM
setup	Application	239 KB	No	519 KB	55%	5/25/2023 2:02 PM
SSCERuntime_x64-ENU	Application	2,468 KB	No	2,560 KB	4%	2/17/2019 10:01 PM


## EI-Monitor Software Installation

A local database requires EI-Monitor software to be installed, preferably on the same PC or server where the database resides. EI-Monitor is included at no cost, along with DigivibeMX Phantom and the SQL connectors. Open the EI-Monitoring\_11 file folder and double-click the SSCERuntime\_x64-ENU if you did not do so during the DigivibeMX software install and are using SQL CE. Then double-click on Setup to install EI-Monitor.

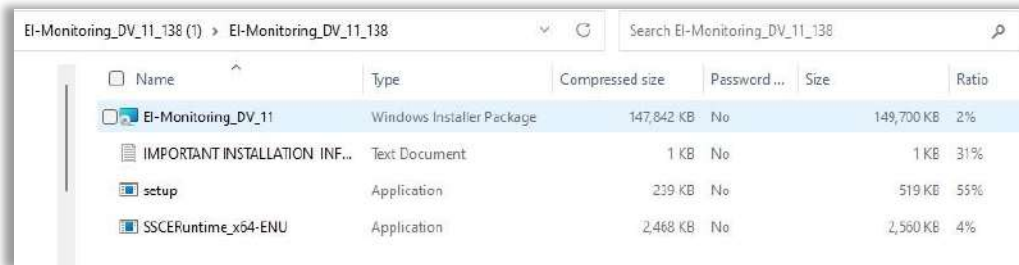

## Required Permissions in a Secure Network

Both DigivibeMX and EI-Monitoring require Read/Write permissions to C:\Program Files and C:\ProgramData (hidden folder). Antivirus and Firewall programs on a user's computer may interfere with these permissions and with Phantom system communications. Users in a secure / Network IT environment may require administrator assistance to enable these required permissions.

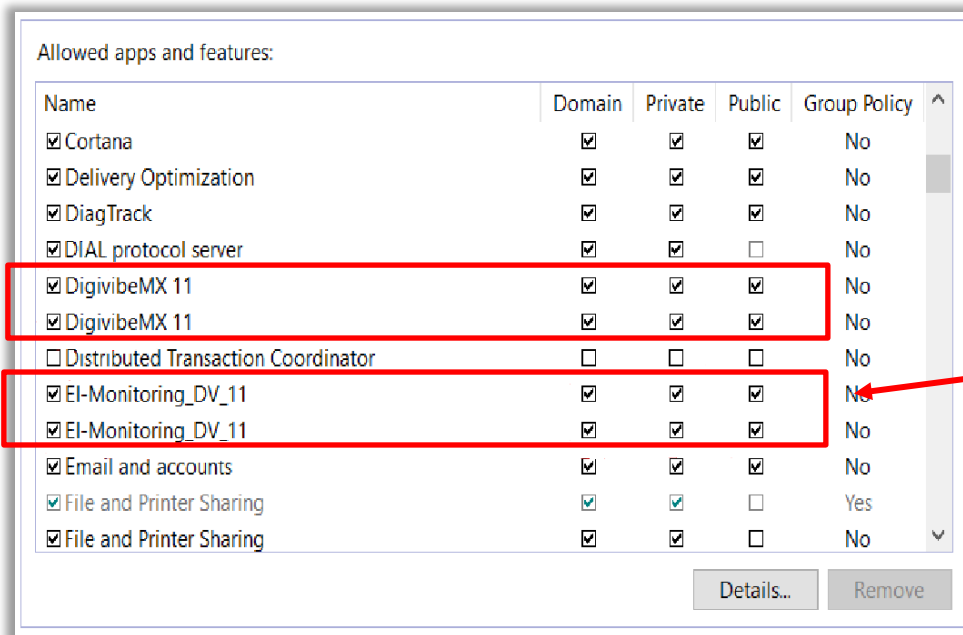



For Local databases only

## Step 3 – Setup EI-Analytic Account

This is required to set up your cloud database. However, even if you plan on using a local database, you can create and use a free EI-Analytic account to register and manage your gateways and sensors remotely via the secure HTTPS web interface. Otherwise, managing your Phantom system must be done from the same network as the gateway(s) to make communication possible.

1. Go to [app.eianalytic.com](http://app.eianalytic.com) and click on New Account.
2. Enter a Name for the account.
3. Add the Email and password info, the address does not need to be valid, in fact if multiple users will access the account, it would be preferable to create a generic Username in email address format (Ex: user@companyname.com). However, if email notifications are desired when a sensor in the database enters an alarm condition, an actual email address should be used. To have a paid subscription service activated, please provide Erbesd Instruments Technical Support your EI-Analytic account Username at [info@erbesd-instruments.com](mailto:info@erbesd-instruments.com).
4. Enter a Company name – this must be all lowercase letters and/or digits 0-9 . The only special character allowed is an underscore.
5. The Database Name must be all lowercase letters and/or digits 0-9 . The only special character allowed is an underscore.

## Step 4 – Assemble Gateways and Power Up

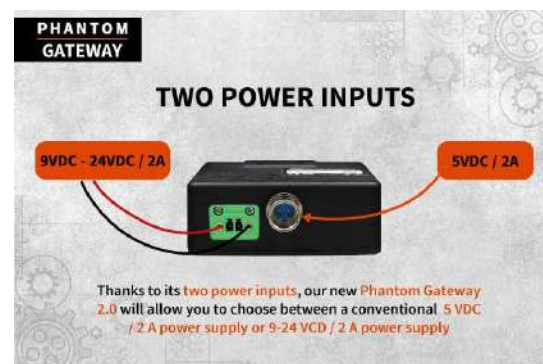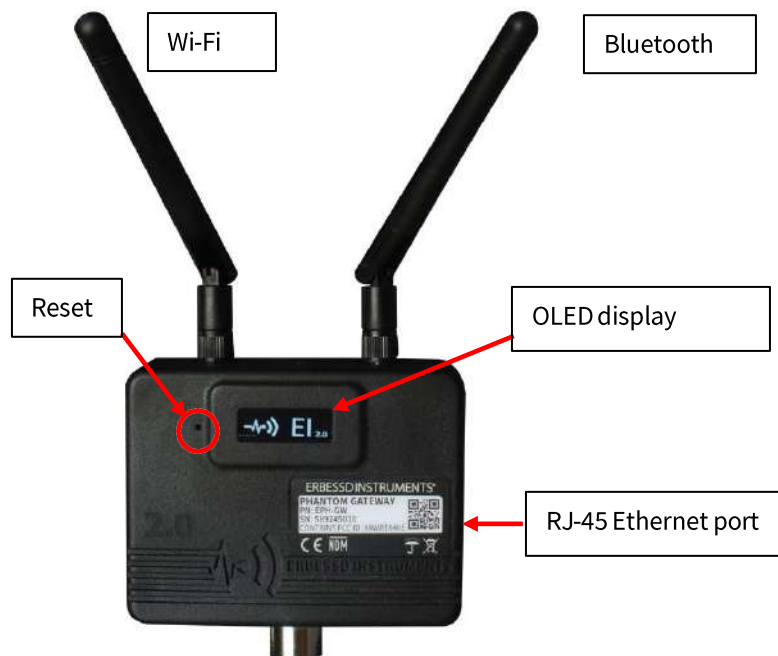

The following Phantom Gateway information does NOT apply to gateway version 1. For installation of a gateway V1, please reference the Phantom Setup Guide V3 document.

1. Attach the two identical antennae provided (both Wi-Fi and Bluetooth use the 2.4 GHz frequency band).
2. Choose a Network connection type – wired **Ethernet** or **Wi-Fi**.
3. Connect power via one of two connectors on the bottom. The 4-pin aircraft-style power connector takes 5VDC @ 2 amps (10 watts) A 4-pin female to USB-A male cable is included. The terminal block supports 9-24VDC (with sufficient current to provide 10 watts of power to the gateway). **Note** – The **reset** button is located just left of the OLED display. See the *Gateway Resets* section of this guide for details.

The 9-24VDC power connector is a 2-pin 3.81mm PCB connector. If required, a matching screw-in plug can be sourced from online electronics retailers such as Ali Express or DigiKey.

<https://www.digikey.com.mx/en/products/detail/phoenix-contact/1827703/349143>.



## Step 5 – Setup Network Configuration

### Option 1 – Ethernet Connection

Plug an RJ-45 network patch cable into the Ethernet port and power on the Gateway.

The Gateway will boot and proceed through the startup sequence. The network Router will assign an IP address to the Gateway, which will be shown on the OLED screen.



If the Gateway does NOT obtain an IP address, it will default to Access Point mode, as shown below.




Factory Reset the Gateway by inserting a paperclip into the reset hole, left of the OLED screen, and hold for 10 seconds until the screen shows it has reset:



Cycle the power to reboot the gateway. If an IP address is still not assigned, you may need to troubleshoot the Ethernet connection, or administer a *static* IP address (see below), depending on your network. (private vs corporate). If you are in a corporate network environment, contact your local IT group for support.


In the above example, the Gateway was assigned address 192.168.0.3.

To access the Gateway Admin Console, enter the assigned IP address in the address bar of any web browser (Chrome, Safari, Edge, etc).

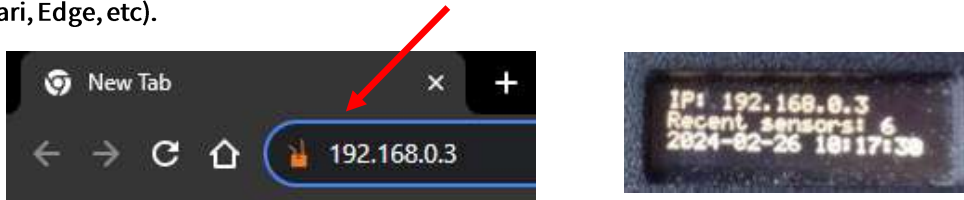

YOU MUST BE CONNECTED TO THE SAME NETWORK as the Gateway for this to function.

The Gateway Admin Console will open.

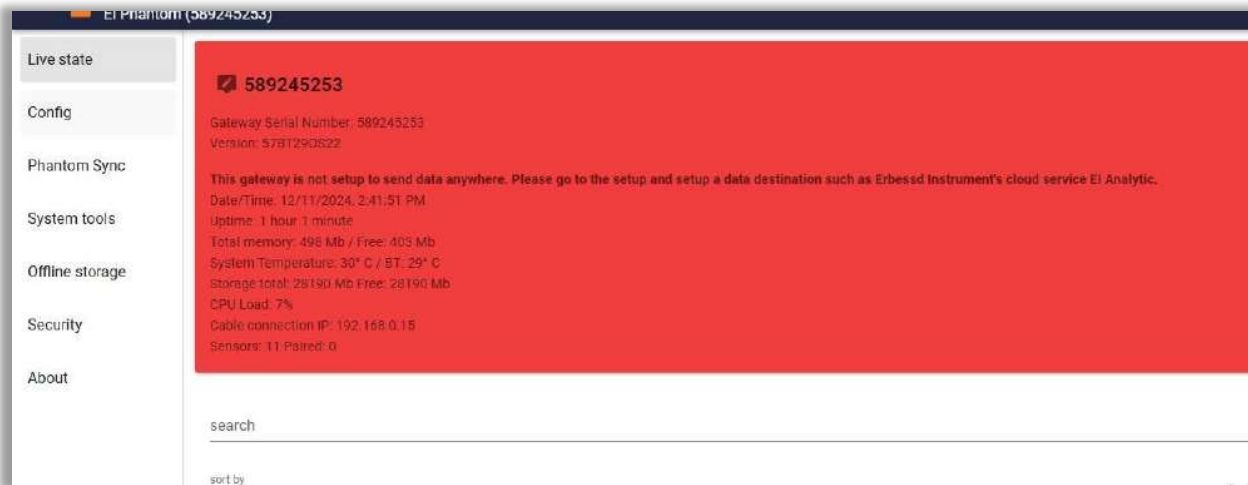


To set **static** addressing, open the **Config** menu and click **Static IP Configuration** in the **General** tab. Enter the IP address, subnet mask, default gateway and optionally the DNS address. Consult with your local IT administrator to obtain this info, if possible. Otherwise, enter:


- An unused IP address on the network
- 255.255.255.0 for the subnet mask
- Your router's address (always the .1 address in the network, e.g. 192.168.0.1) in the default gateway field.
- DNS - set to the same address as the default gateway, or 8.8.8.8.

Click **Save**; the gateway will restart and any changes will be applied.


Note - you can access the Admin Console remotely (once registered) from the EI-Analytic web interface, see details in Step 7 - *Remotely Accessing a Gateway* below.

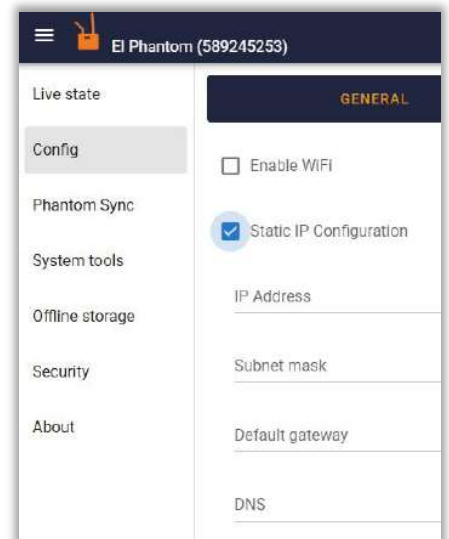

Check the Firmware version to ensure the gateway has the latest version. Click the **System Tools** tab on the main menu and select the **System Firmware update** button. Press the **Check Online Update** button to view the current and available versions. If they differ, the **Update** button will be available. (Internet access is required).

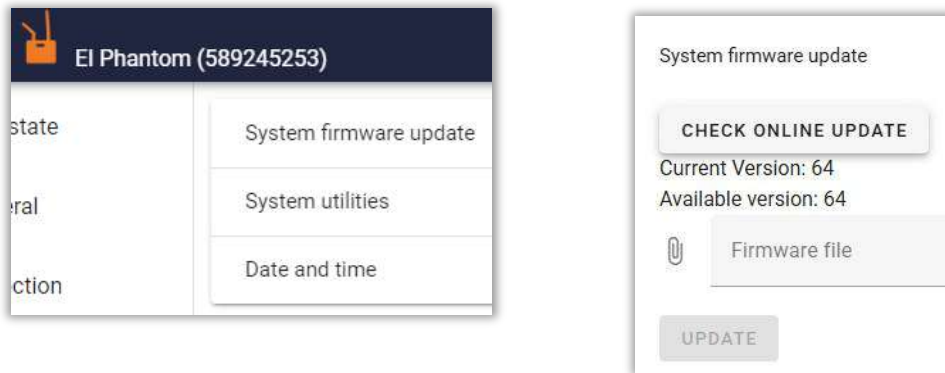


Set the Gateway Time Zone from the System Tools tab on the Main menu. Select the location from the drop down box.

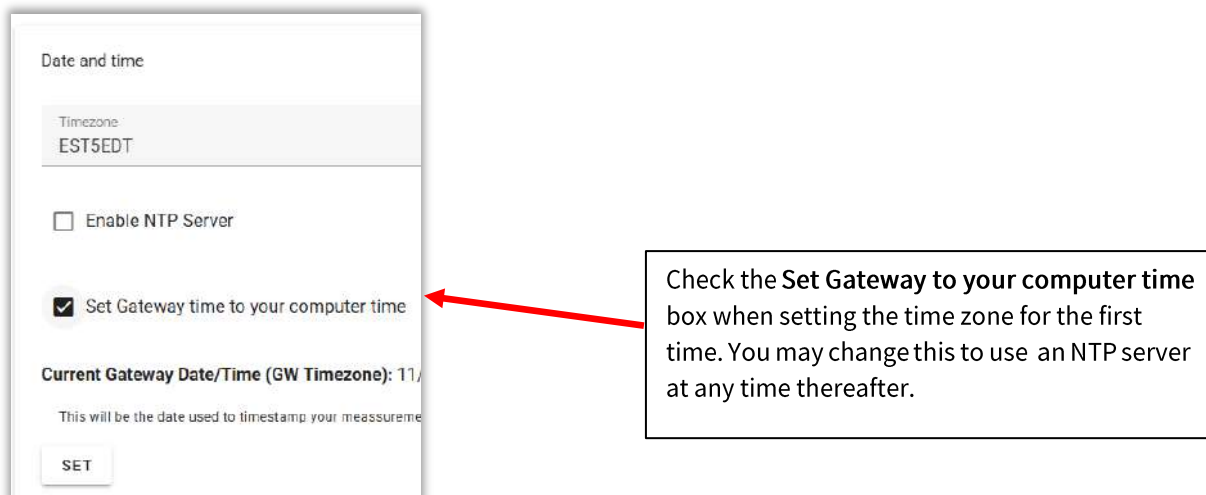

A specific Network Time Protocol Server may be specified or the default **pool.ntp.org** can be used. If the gateway loses connection to a network clock source, its internal Real-Time clock will free-run. The NTP service usually updates the time every 1000 seconds.

Press **SET** and the Gateway will restart to save the changes.

Next, enable the Bluetooth Amplifier on the Config>General screen.

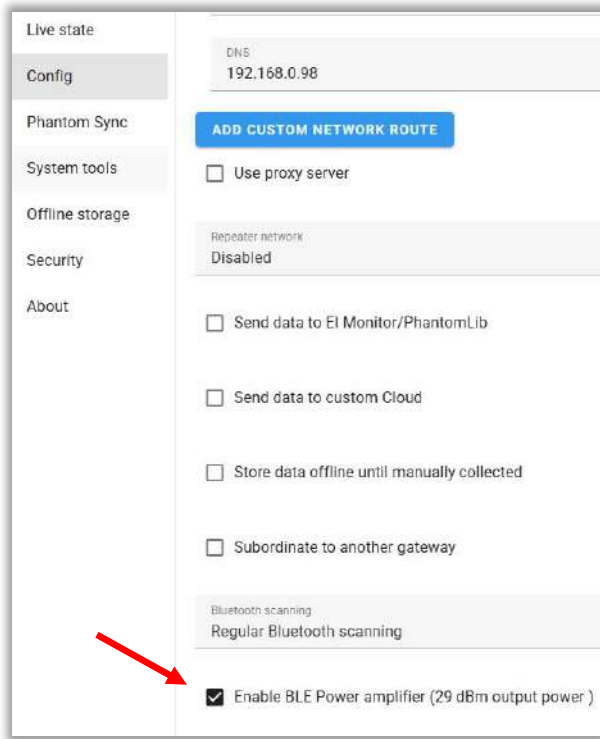

## Option 2 – Wi-Fi Connection

To connect a Gateway to a Wi-Fi network, power it on with no ethernet cable connected and allow it to boot into Access Point mode.




The Gateway will broadcast a Wi-Fi network SSID with the name “EIPHANTOMGW”. and assign itself an IP address of **192.168.4.1** (AP).


Look for the EIPHANTOMGW name in the **available Wi-Fi networks** of any PC, tablet or phone.



Connect to this network using password **88888888** (eight 8 times).


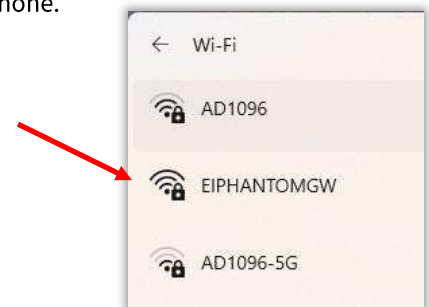
Open any browser and enter **192.168.4.1** in the address bar.

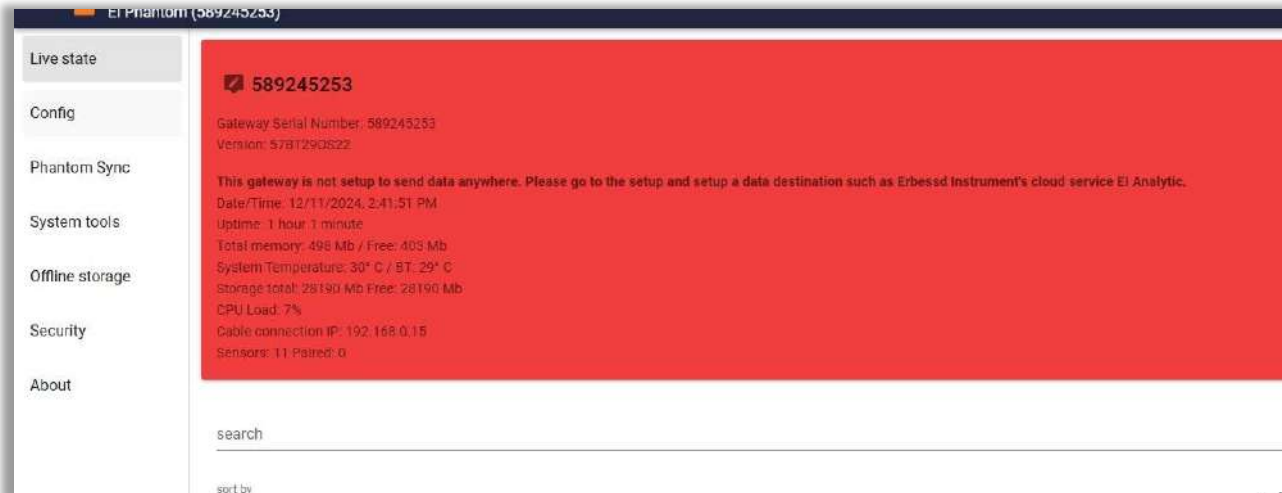

The GatewayAdmin Console will open.



1. Click on the **Config** menu and **Enable Wi-Fi** in the General Tab.
2. You can scan available Wi-Fi networks or enter the **WiFi network name** directly. There is also a selector for **Auth Type**: WEP, WPA (Personal or Enterprise), or Open Network.
3. In the **Wi-Fi Password** section, enter the password of the selected network. You can view the password or hide it with the   buttons.
4. Press **Save**, the gateway will restart.
5. Check the OLED display as the gateway reboots, you should see the newly assigned IP address.

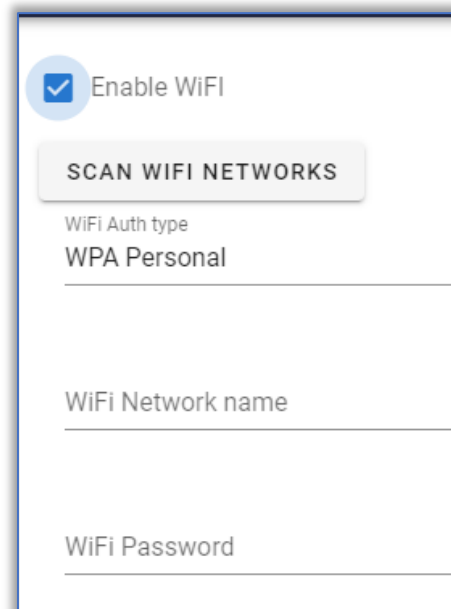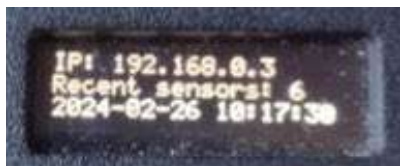

To access the Gateway Admin Console enter the assigned IP address in the address bar of any web browser (Chrome, Safari, Edge, etc).




Note - This only works if your PC/tablet/phone is on the same network as the gateway.

To set static addressing, open the **Config** menu and click **Static IP Configuration** in the **General** tab. Enter the IP address, subnet mask, default gateway and optionally the DNS address. Consult with your local IT administrator to obtain this info, if possible. Otherwise, enter:



- An unused IP address on the network
- 255.255.255.0 for the subnet mask
- Your router's address (always the .1 address in the network, e.g. 192.168.0.1) in the default gateway field.
- DNS - set to the same address as the default gateway, or 8.8.8.8.

Click **Save**; the gateway will restart and any changes will be applied.


Note - you can access the Admin Console remotely (once registered) from the EI-Analytic web interface, see details in *Step 7 - Remotely Accessing a Gateway* below.

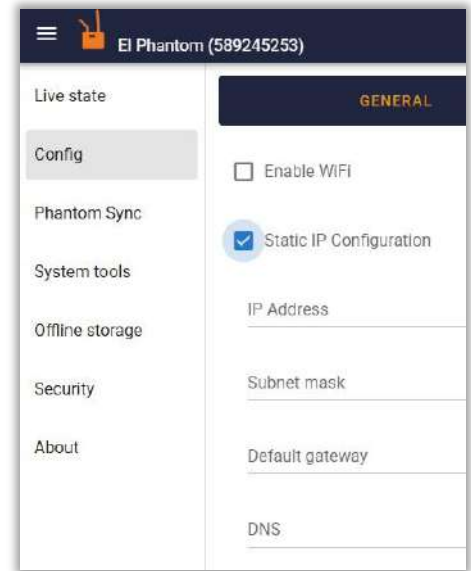

Check the Firmware version to ensure the gateway has the latest version. Click the **System Tools** tab on the main menu and select the **System Firmware update** button. Press the **Check Online Update** button to view the current and available versions. If they differ, the **Update** button will be available. (Internet access is required)

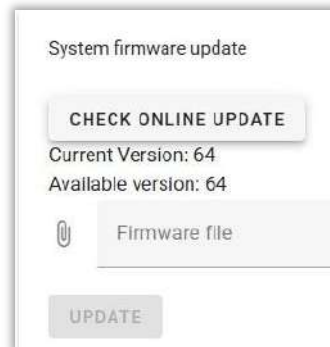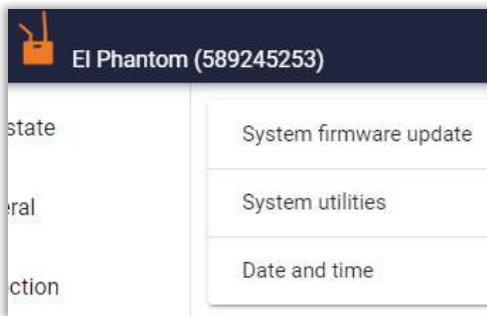

Set the Gateway Time Zone by selecting the location from the drop down box.

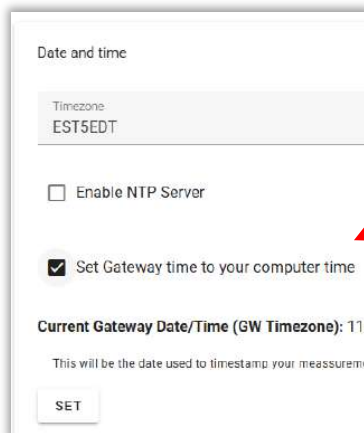


Check the **Set Gateway to your computer time** box when setting the time zone for the first time. You may change this to use an NTP server at any time thereafter.

A specific Network Time Protocol Server may be specified or the default **pool.ntp.org** can be used. If the gateway loses connection to a network clock source, its internal Real-Time clock will free-run. The NTP service usually updates the time every 1000 seconds.


Press **SET** and the Gateway will restart to save the changes.

Next, enable the Bluetooth Amplifier on the Config>General screen.

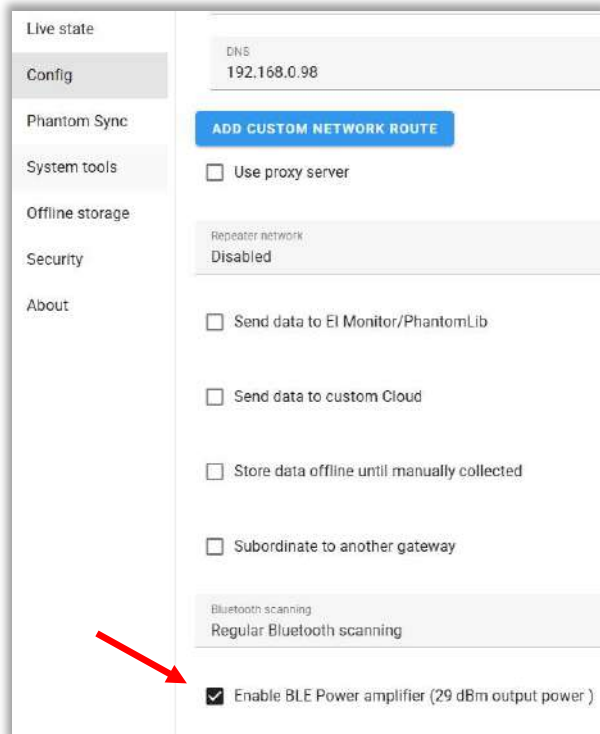

## Custom Network Routes

Click the Add Custom Network Route button in the Config>General Tab:

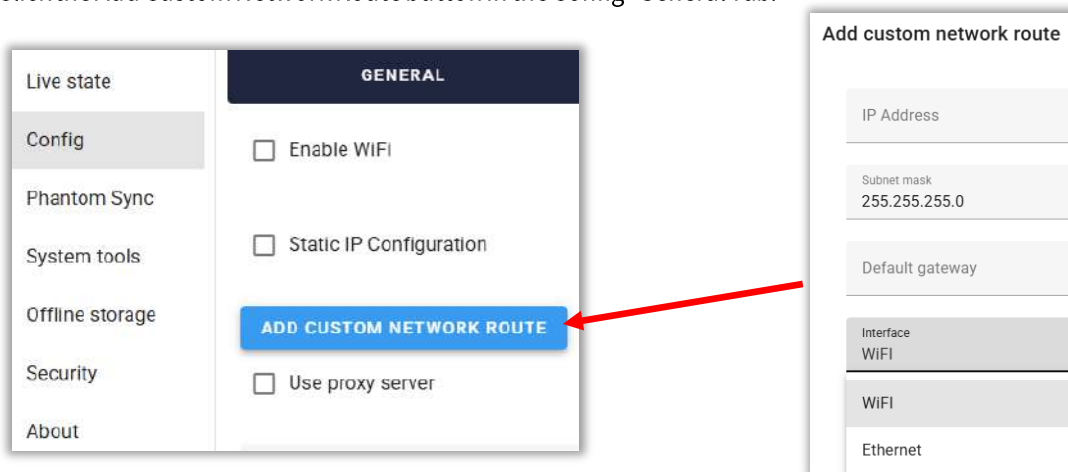

Both Network Interfaces, Ethernet and Wi-Fi can be configured with a Custom Route.

## Proxy Server Support


A proxy server may now be administered in the **General** Tab of the Gateway Admin Console. A Proxy server can provide a single point of contact for all Internet-bound Phantom Gateway traffic. Proxy servers provide improved security by managing all web traffic (filters, Firewalls), relaying bidirectional data between source and destination.

All Phantom Gateway data forwarded to EI Analytic will be sent to the Proxy, which relays it to the EI-Analytic website. The Proxy will also support connections to the remote access server (used for logging into a gateway from EI -Analytic).

Enter the Proxy server URL, the TCP port used, and optionally a Proxy User name and password.

Gateways use the CONNECT method for establishing communication with a Proxy. This method requests that a Proxy establish a HTTP tunnel to a destination server, and if successful, forward data in both directions until the tunnel is closed. For details see: <https://developer.mozilla.org/en-US/docs/Web/HTTP/Methods/CONNECT>

Testing was conducted using SQUID (a web caching proxy) see <https://www.squid-cache.org/>


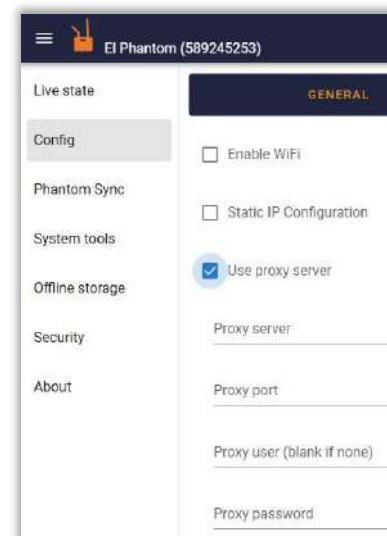


## Repeater Network Setup

If a Repeater Network is to be installed, click on the **Config** tab and set the **Repeater Network** as required, **Main** or **Subordinate**. Only one Main Gateway may be configured in a unique network of Gateways. Up to 7 discrete Main/Sub network groups ( A through G) may be administered.

- Subordinate Gateways DO NOT need to be registered in EI-Analytic.
- Main gateways should be installed first, followed by Subordinates.

To install a Subordinate Gateway, power it up using Ethernet or Wi-fi, then set the Repeater Network to Subordinate in the **Config** tab. Press Save, and it will restart and attempt to locate the Main Gateway for its Group ID (A-G) and establish a Wi-Fi connection. The OLED display of the Subordinate Gateway should now show “**Connected to Mesh**”.

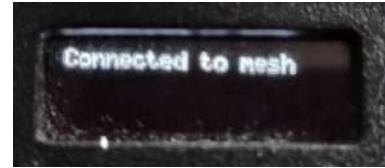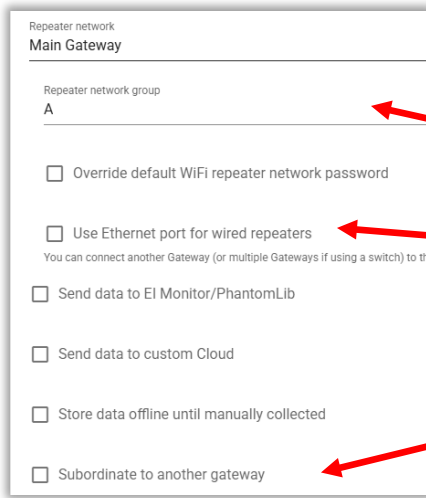

Network Group A - G

Use ethernet port for Repeater network



DO NOT check this parameter!

The **Repeater** tab will appear on the Main menu only when a Subordinate Gateway is connected to the Main Gateway.


**Note** - When all subs are out of range or offline, the Repeater tab will disappear from the Main menu.

Click on the **Repeater** tab to see the status of all gateways in the Network. The [Admin Interface](#) link provides access to the Admin Console of each Sub gateway. Note that most menu tabs are greyed-out for a Sub gateway. All collection and sensor settings are configured in the Main gateway only.

Subordinate Gateways should be configured with the SAME Firmware version as the Main gateway for the Group.

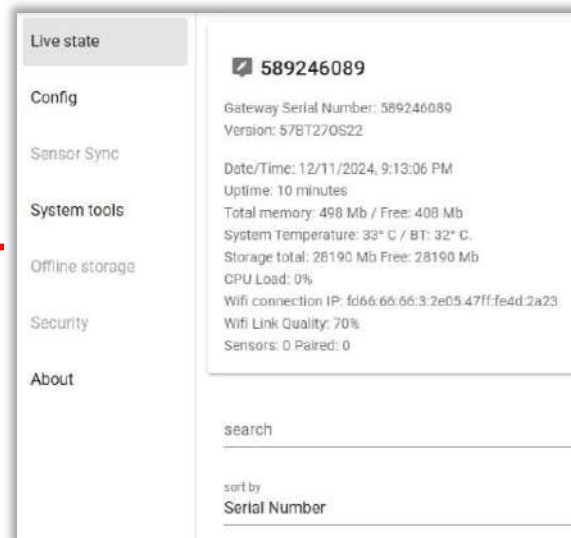
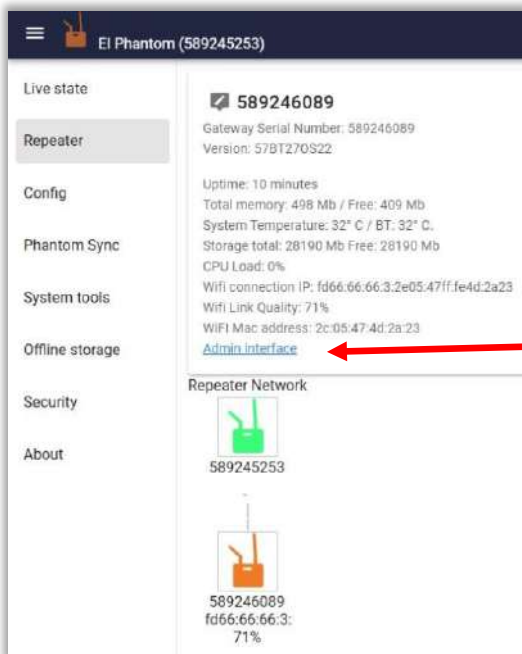


The RJ-45 Ethernet port on the Main Gateway may be used to connect to a Repeater network. In this option, the Wi-Fi option must be used to connect the Main Gateway to the network with Internet access. If the Main Gateway can only use Wi-Fi to connect to a network it is highly recommended to use the Ethernet connection option if a Subordinate Gateway is required. This reduces the Wi-Fi traffic on the Gateway to only that of the Subs.

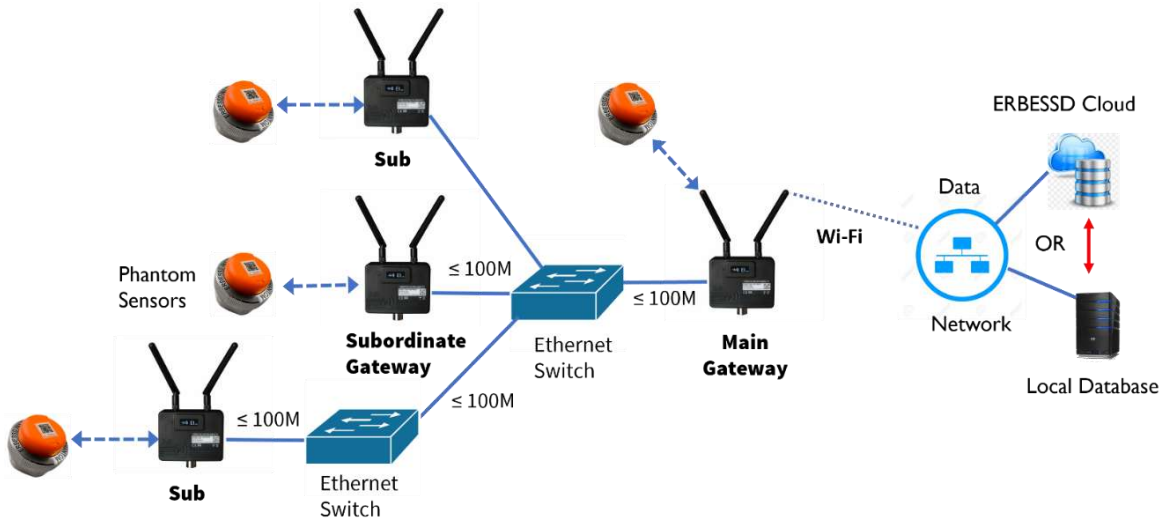

## Phantom Long Range Option

If Phantom Long Range is required, enable it on the Config>General Tab. Otherwise, proceed to Step 6:

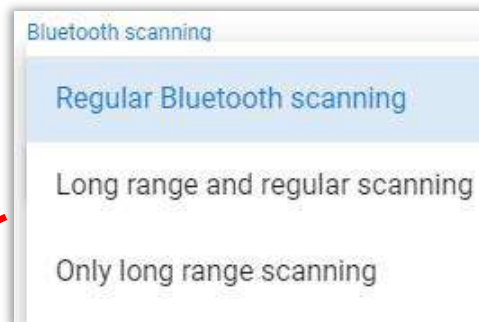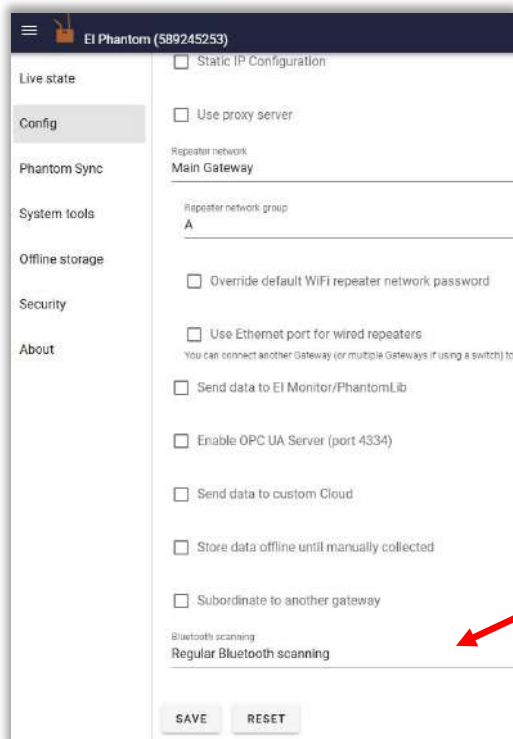


Press **SAVE** and the Gateway will restart.

## Enabling Phantom Sensor Encryption

The Erbessd Instruments Phantom system uses Bluetooth Low Energy 5.0 for communications between sensors and Gateways or a Defiant. Bluetooth employs multiple encryption keys depending on the version and pairing method used. Erbessd uses two primary keys, the **link key** and the **encryption key**.

To enable the 128-Bit AES encryption of the Bluetooth communications please use the following procedure.

1. Access the Gateway/Defiant through the Admin Console interface and open the Security Tab.
2. Select **Enable Console password**; more options will then appear. (Setting a console password is a prerequisite to enabling sensor encryption)
3. Check **Enable Sensor Encryption**.
4. Press **Save**.

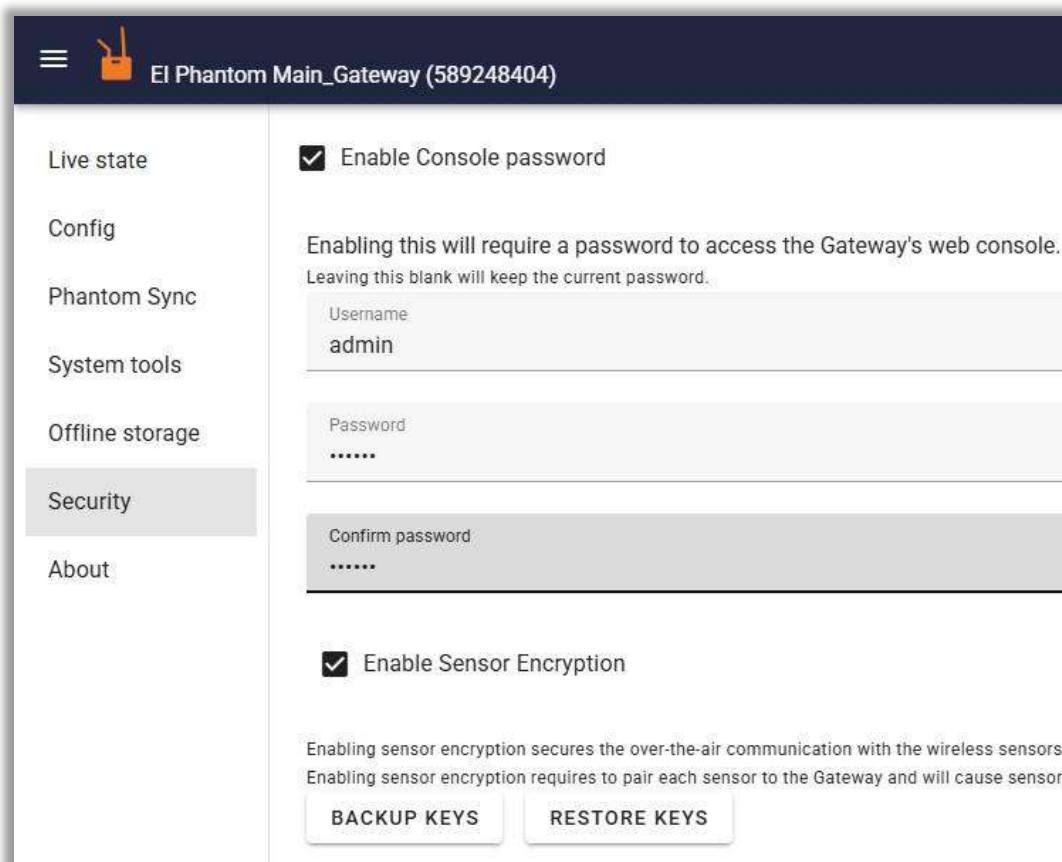


Upon restart the ability to enable encryption for each individual sensor is possible.


5. Go to the Live State screen of the Admin Console and confirm that each sensor badge now contains a Lock icon.




6. Click this icon to enable encryption for the sensor; a popup will occur:

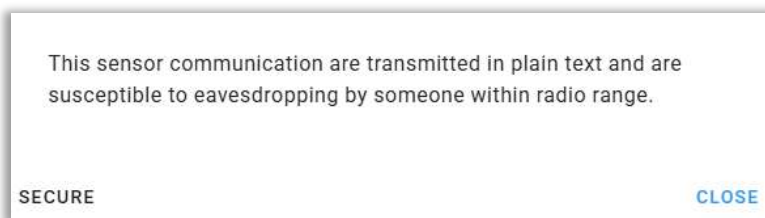


7. Select **Secure**. The sensor badge will show that a security update is pending. **You must restart the sensor with a magnet (the same way a sensor is wakened from Sleep mode) .**

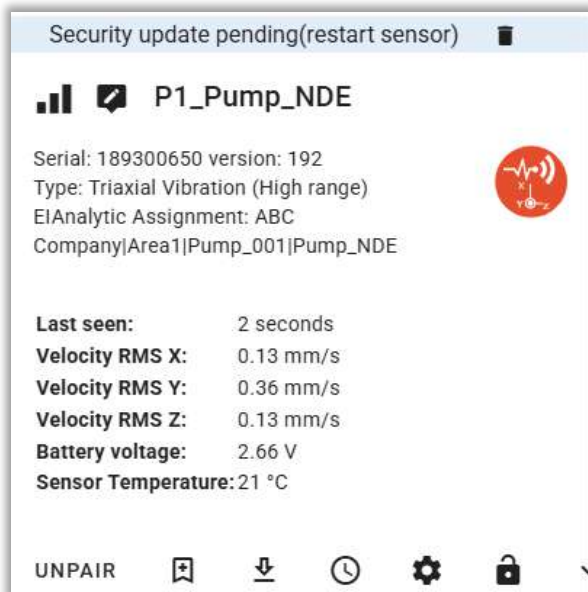


8. The encryption is now applied.

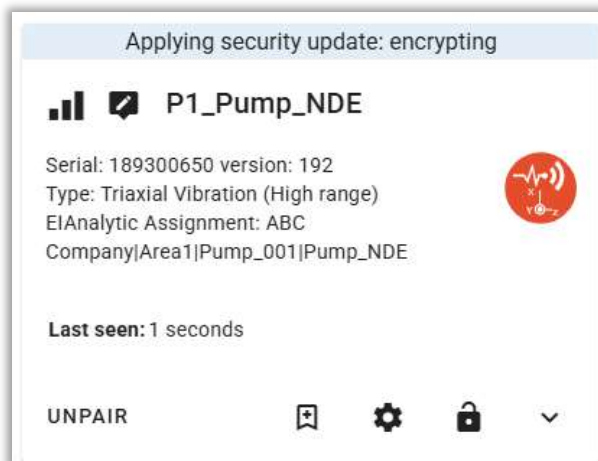

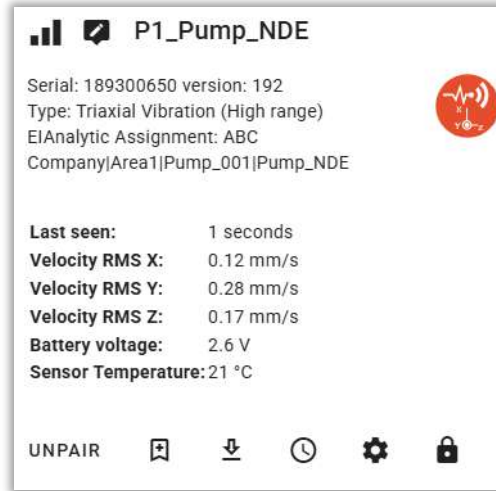

To unencrypt, click the Lock icon and select **Unsecure**.

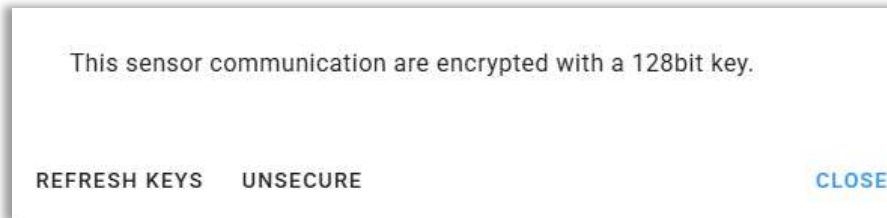


This change can be applied without the need to reset the sensor with a magnet.

Press **Refresh Keys** to change this sensor's encryption key.

## Step 6 -Creating a Local Database


### Option 1: Create Single-User SQLCe Database on a Local PC

A local SQLCe database is created on a PC using DigivibeMX Phantom software. Even if an EI-Analytic database is used for data storage, it is best practice to create a local database. This can be used to backup the EI-Analytic cloud DB, or allow analysis to be done offline.(EI-Analytic databases may be Synchronized or Backed up using tools in Digivibe MX.)

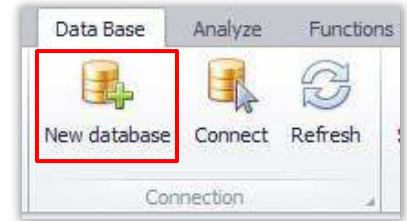

Click on **Database** in the DigivibeMX11 main menu, then select **New database**.

The **Save As** window opens to the default database location (Documents> Erbesd Instruments 11 > Database). Specify an alternate location, if desired. Enter the name of the new database in the **File Name** text field. **Save as type**: SQLCe.

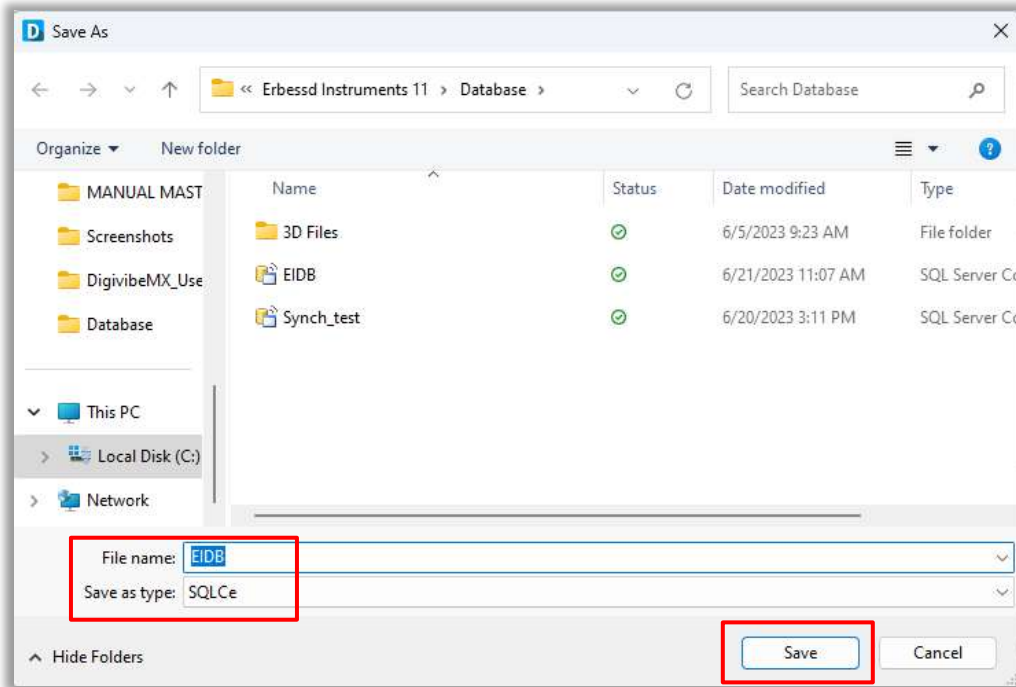


Click the **Save** button to save the new database. Click Yes for any notification boxes that may appear after the database file is created.

**NOTE:** SQLCe databases have a 4GB capacity limit. Because of this, DigivibeMX will store the full signal files **OUTSIDE** the SQLCe database file structure. The signal files represent approximately 85% of the storage space requirements for a database, the rest is configuration info – Machines, Phantoms, Routes, etc. **Note** - SQLCe will only allow file storage on a PC's C: Drive, external drives are not supported.

There is an option to **KEEP** the signal files inside the SQLCe file folder, however it may be necessary to periodically thin the SQLCe database of old data, or synchronize the database structure to a new SQLCe database to avoid having the database refuse new data because it has reached its maximum allowable capacity.


To set the destination folder for local SQLCe database signal files, open DigivibeMX and connect to a local SQLCe database. Open the Configuration>Preferences>DB Settings tab: **Note** – this tab only appears when Digivibe is connected to a local DB.

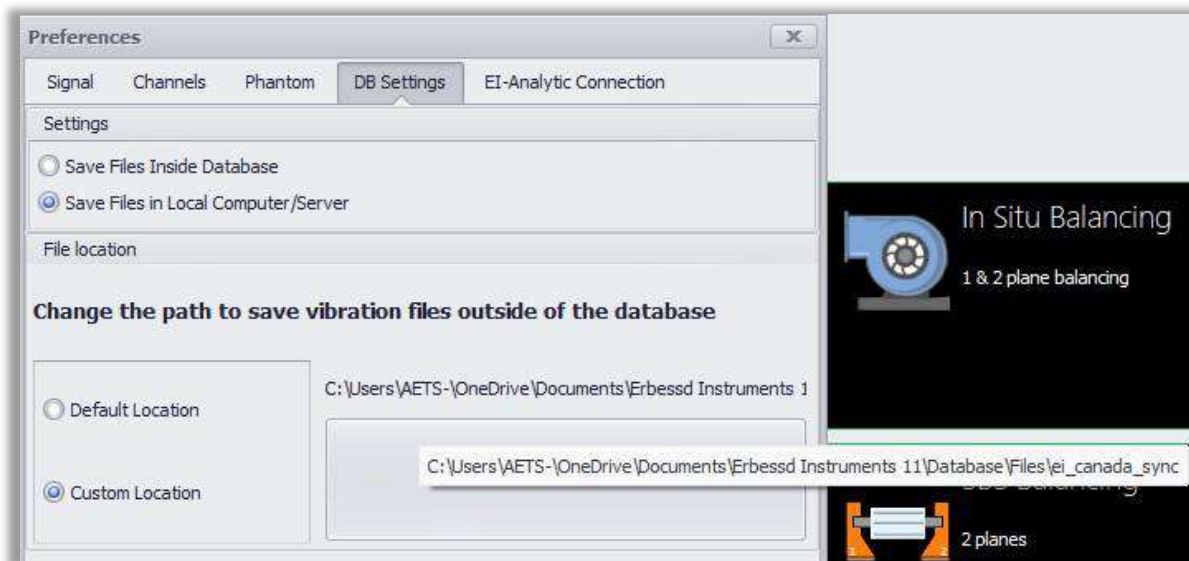

Choose the location for saving signal files:

- **Inside the Database** (counts toward the 4Gb limit), or.
- **In Local computer** – in another folder on the computer, but outside the Database file structure.

By default, all signal files will be saved in a folder called “Files”, which resides in the Erbessd Instruments 11>Database folder:

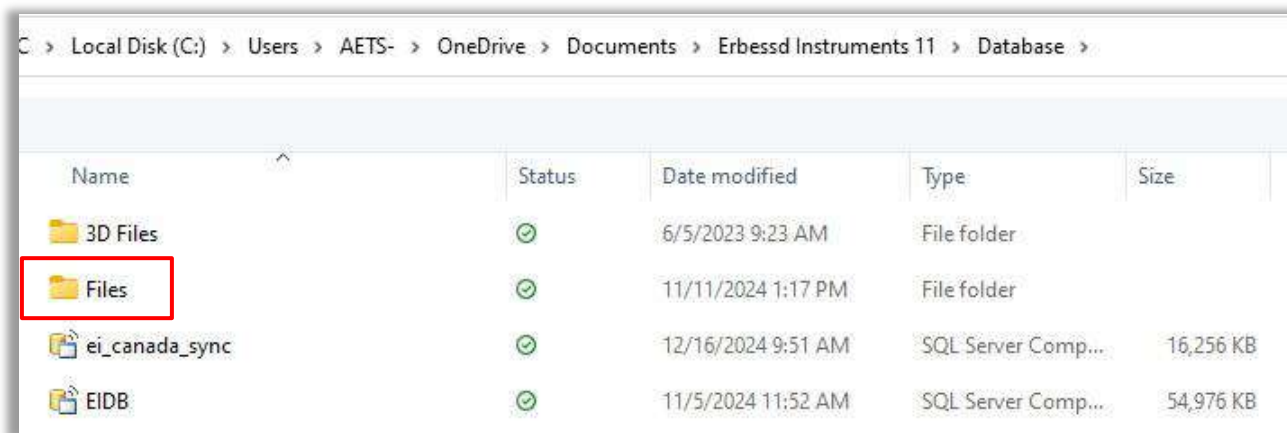

Click the **Custom Location** radio button to choose another location on this computer (must be on the C: drive!)

With this option, a local SQLCe database will contain only RMS and configuration data. (Machine, Phantom, Routes, etc.)

All Signal files, sorted by Machine are stored in the Files Folder in the local Database.

Opening the database in the Files folder reveals the folders for each Machine’s signal files, sorted by Machine ID:

Name	Status	Date modified	Type	Size
M_84727546	OK	11/11/2024 1:15 PM	File folder	
M_270309797	OK	11/11/2024 1:15 PM	File folder	
M_426434301	OK	11/11/2024 1:15 PM	File folder	

When viewed in DigivibeMX, the Historic Measures window shows “File Outside DB” in the View File column.

Collection Reason	Date	View File
Type:Scheduled	2024-12-11 17:16:16	File Outside DB
Type:Requested	2024-12-05 16:00:21	File Outside DB
Type:Requested	2024-12-05 15:47:10	File Outside DB




## Option 2 – Multi-User SQL Database on a Network Server

DigivibeMX software cannot create a new SQL Server, MySQL or SQL Azure network database. The empty database must be created independently, then DigivibeMX is mapped to the database location. Once connected, DigivibeMX will create the required fields and tables. Locating the SQL Server or MySQL database on a shared network server will require entering the destination server’s IP address. Locating an SQL Azure database will require the TCP address. Accessing the database may also require a database administrator Username and Password authentication. Be prepared with this information before proceeding. Consult a local IT administrator or SQL database administrator for assistance.

For MySQL, a step-by-step installation procedure can be found on the Erbesd website at <https://www.erbessd-instruments.com/tutorials/mysql-server-installation/>

Open the Data Base Menu in DigivibeMX. Select **Connect** on the Connection toolbar.

The **DB\_Open\_Network\_DB** window opens. Select SQL, MySQL or SQL Azure database format. Click **Local Host** button to continue. The **Host Select** window opens.

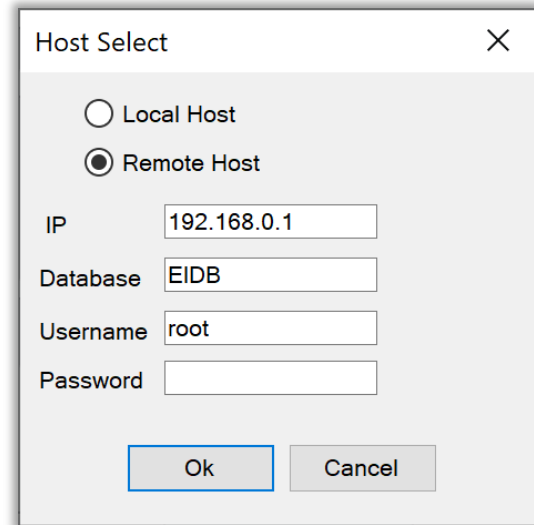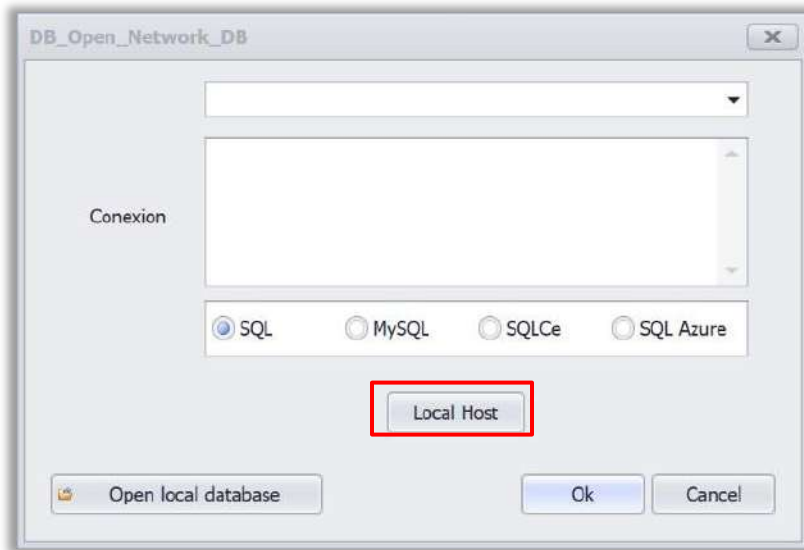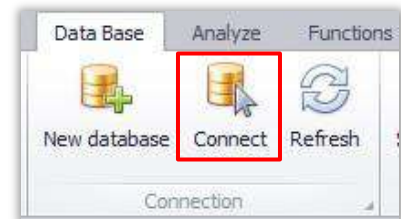


For a SQL Server or MySQL database, enter the server’s IP address. For an SQL Azure database, enter the TCP address. Then enter the Database name. Enter the Username and Password, if required. Click the OK button to continue.

The destination address connection string will appear in the **DB\_Open\_Network\_DB** Connection window. Click the **Ok** button to connect.


## Configure EI-Monitor software

EI-Monitor software is used to relay data from gateways to a common SQL database.

1. Launch EI-Monitor software on the PC/server.
2. When opening the first time, the **Open Network DB** window will automatically launch. For SQLCe, check the radio button and choose a local database by clicking **Open local database**. Navigate to the desired local DB and press **OK**.

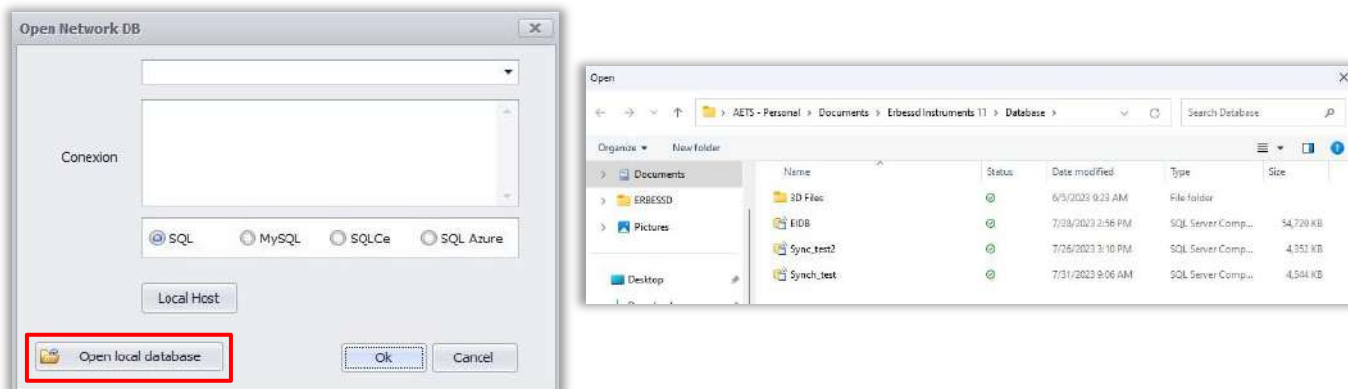

3. For a SQL, MySQL or Azure database, click the appropriate radio button and press the **Local Host** button. Enter the database info and press **OK**.
4. The main menu will then open, and a **Connection DB Successful** message is displayed in the banner.
5. Select the **Settings** menu and click on **Preferences**. Check the box for **Run monitor service at startup**.
6. **Get IP Address**. This is the IP address of the device running EI-Monitor. Make note of this address, you will need to administer it in the Phantom gateway. See details below.

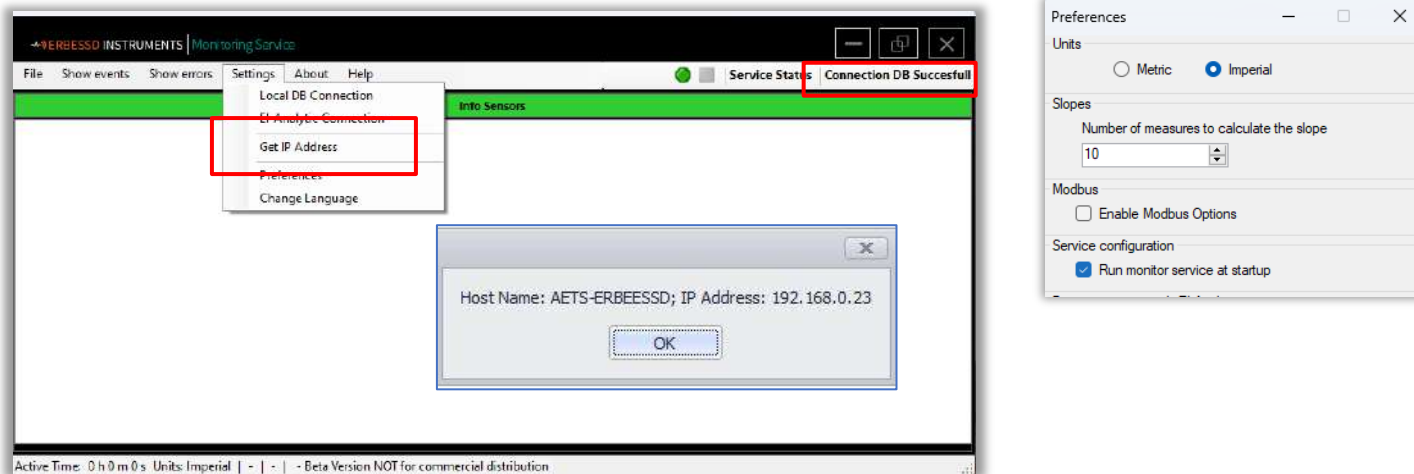

**IMPORTANT: NEVER** close the EI-Monitoring program. This will interrupt communications between the Gateway and database. EI-Monitor must always be operating in the background. If the computer running EI-Monitor is shut down or restarted, the gateways will store data collections in their Offline Storage SD card (up to 100k files) until EI-Monitor restarts.




## Step 7 –Configure the Data Destination

### Option 1 - Configure the Gateway for a Local DB


1. Open the Config menu and select **Send data to EI-Monitor/PhantomLib**.
2. Enter the IP address of the computer/server from step 6 in this field. **Note** - Network routing must be possible between gateways and the EI-Monitor PC/server.
3. Select **Save**. The gateway will then restart.

**Note:** A static IP address is required for the EI-Monitor PC/Server to ensure the address never changes. This will cause the database to go off-line.

4. Return to EI-Monitor software and click the green octagon to start the service. The banner will change to “Service running”. To stop the data collection service, click the red stop button.

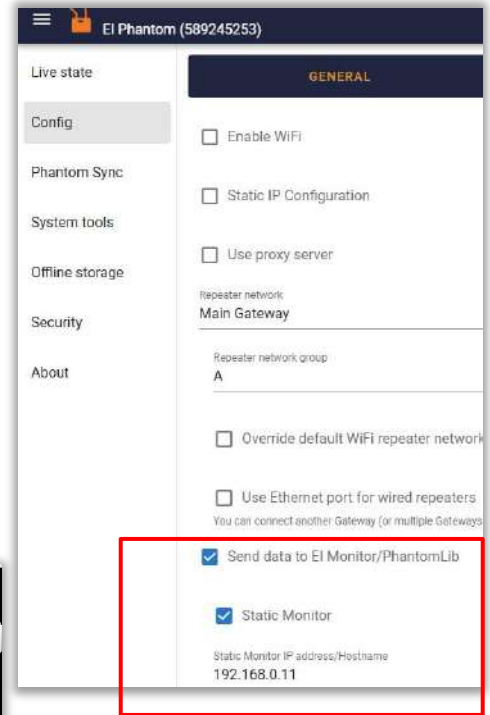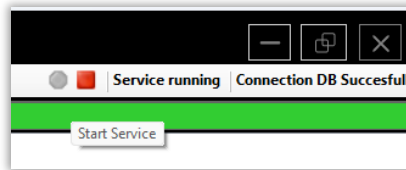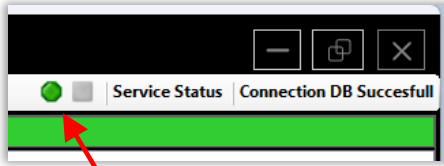


The main screen of EI-Monitor defaults to the **Show Info** mode. Upon startup a message from each gateway is sent with its **serial number**, followed by messages scrolling on the screen every few seconds from each sensor.

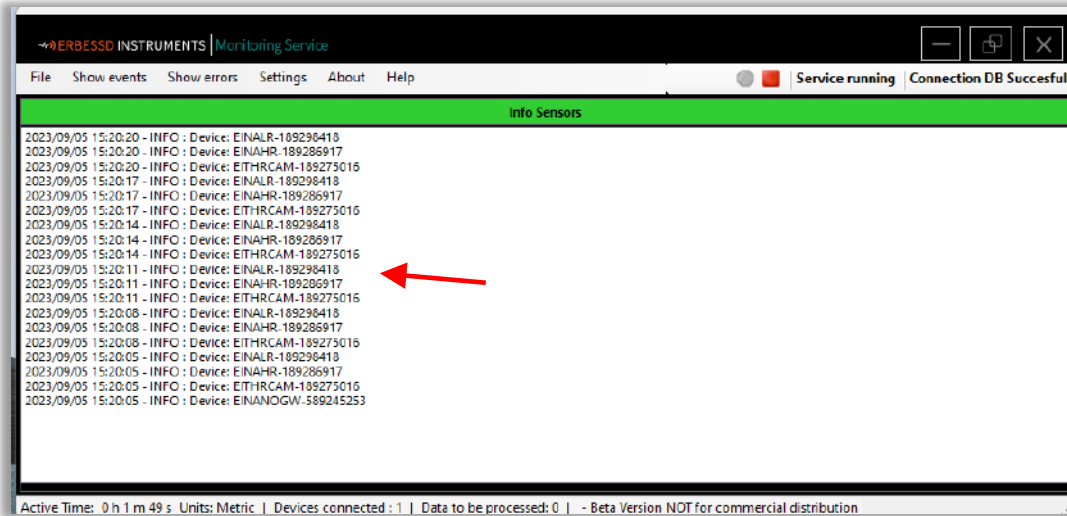

If you do not see any messages, but the Service is running, check the Live State screen for the connection status. It should show the Monitor IP address if successfully connected.



If connected, then check your Windows Defender Firewall settings to ensure the UDP and TCP ports for EI-Monitoring\_DV\_11 are not blocked:


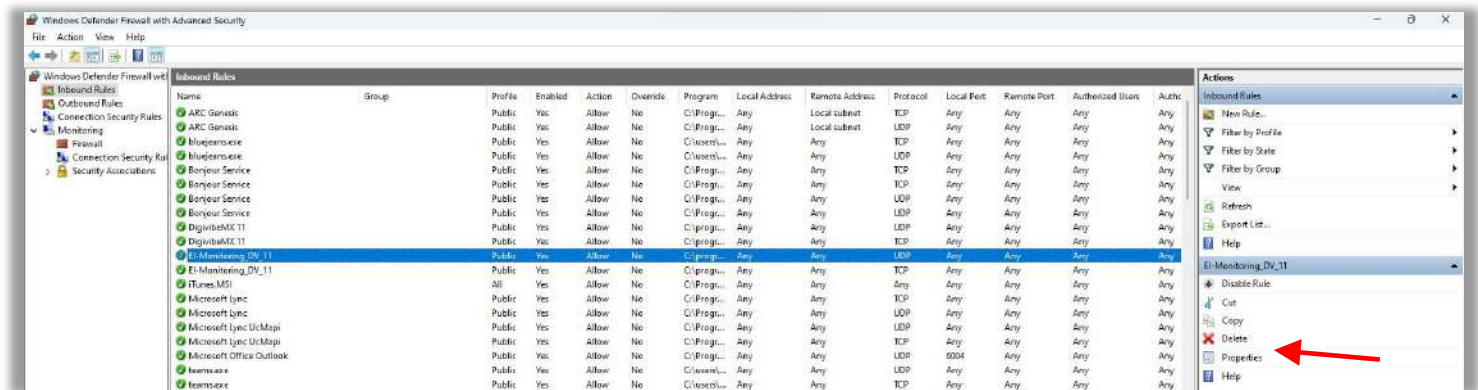


If blocked, click on **Properties**, and change both UDP and TCP to **allowed**.



## Option 2 - Send Data to EI-Analytic

For a gateway to send data to an EI-Analytic cloud database, it must first be registered. To register a gateway:

1. Login to the EI-Analytic account and database that the gateway will be associated with at [www.eianalytic.com](http://www.eianalytic.com).
2. Select **Gateway Manager** from the **Database** menu.
3. Click the **Add Gateway** button.
4. Enter the gateway serial number.
5. Click **Add Gateway**.

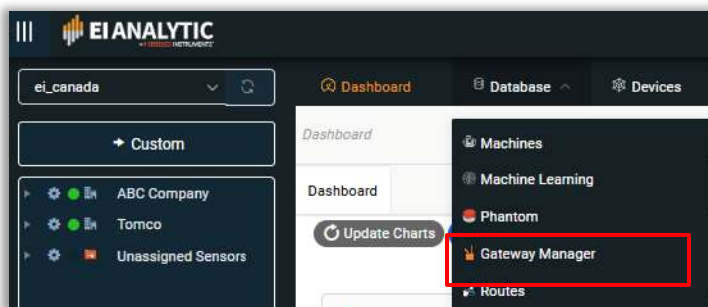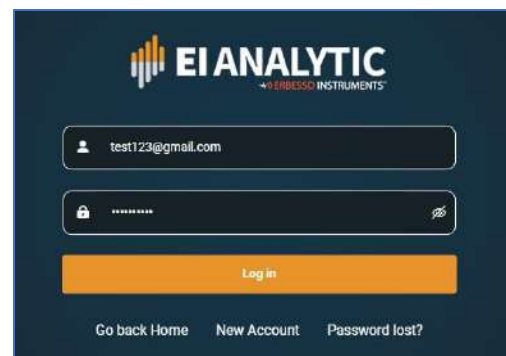

6. Once the gateway is registered, **copy** the **Auth Token** and **paste** it into the EI-Analytic screen on the Gateway Admin Console Config Menu>EI-Analytic tab:

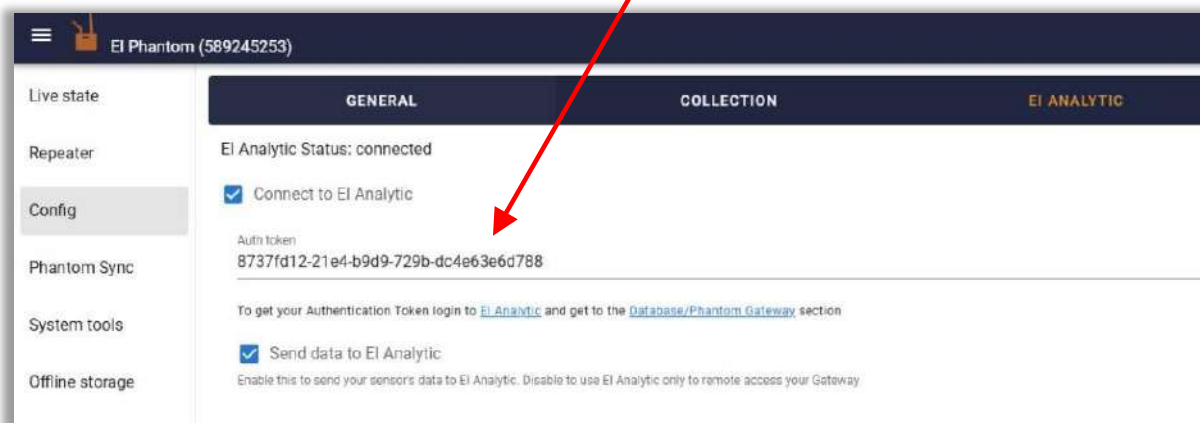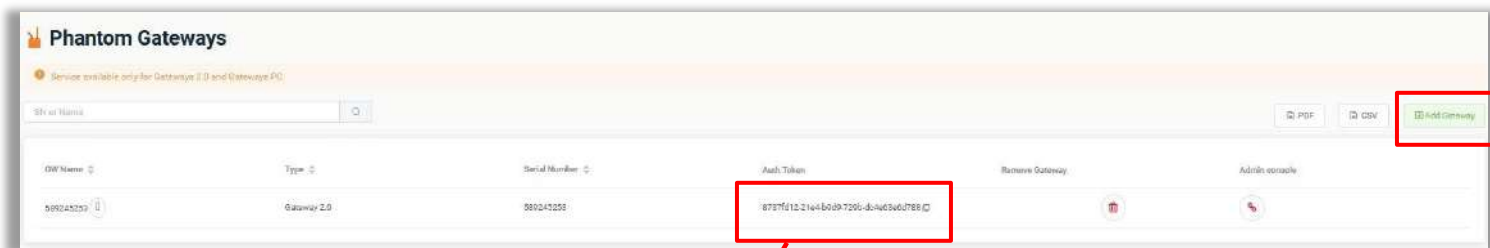

7. Ensure both **Connect to EI-Analytic** and **Send data to EI-Analytic** boxes are checked as shown.
8. Click **Save** and the gateway will restart. Upon reboot it will start sending data to the EI-Analytic database.

### Remotely Accessing a Gateway

Once registered, gateways can be accessed through the EI-Analytic web interface. This requires the following steps:

1. Login to your EI-Analytic account where the gateway is registered.
2. From **Database** drop-down menu choose **Gateway Manager**.
3. Click on the **Admin console** icon for the desired gateway. A new browser tab will open, providing full access to manage the gateway and all connected Phantom sensors. **Note** – you can set a password for access to the Gateway Console. See the *Security* section of this guide for details.




### Step 8 – Create Machine Database

There are two main database components used with the Phantom solution; **Machines** and **Phantoms**.


Both Machines and Phantoms can be administered in three ways:

1. From DigivibeMX software (on a Windows device).
2. The EI-Analytic web portal (requires EI-Analytic cloud database account, supports any web browser).
3. Using the WiSER VIBE mobile app (requires EI-Analytic cloud database account, supported on iOS or Android devices.)

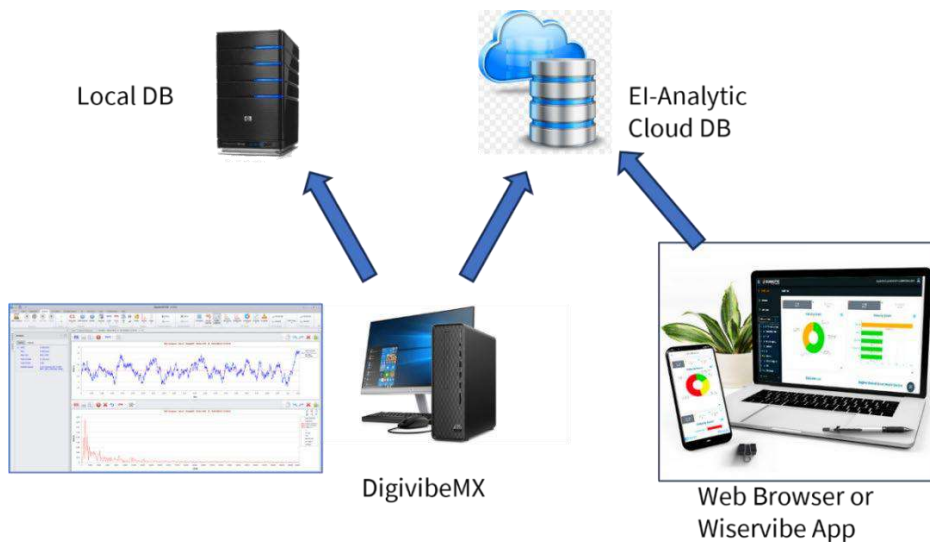

## Machine Manager

This web-based configuration interface is used to manage the **Machine** database.

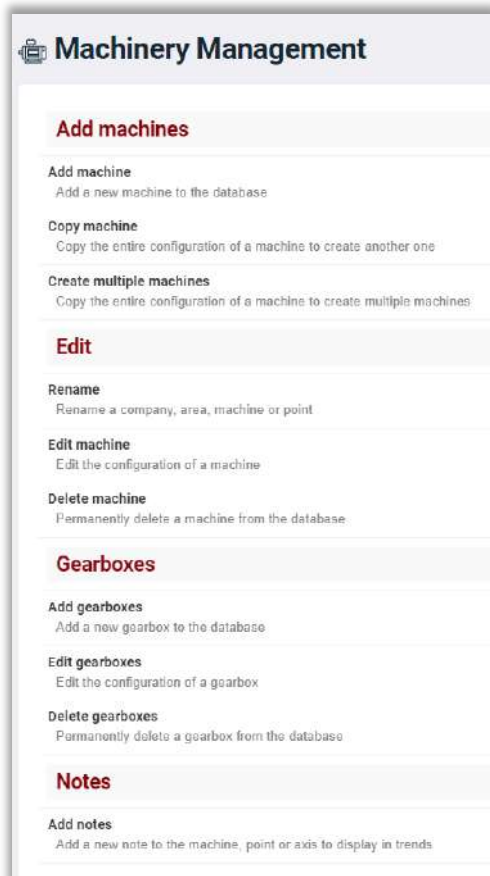

**Add Machine:** Opens the Add Machine window for adding new machines to the database.

**Copy Machine:** Copies an existing machine for quick additions.

**Create multiple machines:** This works well for creating multiple machines with the same parameters, e.g., RPM, bearings, etc.

The **Rename** feature allows renaming a Company, Area, Machine, or Point.

**Edit Machine:** To select a machine for editing, click on the arrow beside the machine name. The Edit function can be used to change a machine's *Company* or *Area* assignment in addition to all other fields in the machine configuration.


**Delete Machine:** Select from the list to delete a machine.

**Gearbox Add/Edit/Delete:** Opens the Gearbox window to allow management of gearboxes in the database.

**Add Notes:** Opens the Notes manager screen to allow adding, editing or viewing notes attached to a machine. Notes are displayed in the Trends graphs.


### Option 1 - DigivibeMX

To open from DigivibeMX, click the **Machine Manager** icon on the Main menu or on the Database menu.

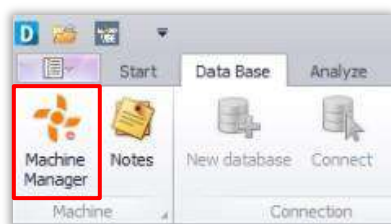



### Option 2 - EI Analytic web portal

To open from EI-Analytic, click **Machines** on the Database menu.

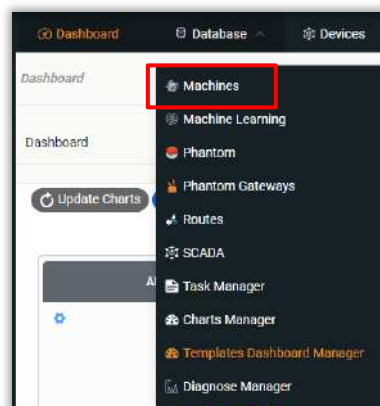

### Option 3 - WiSER VIBE

To open from the WiSERVIBE mobile app, select **Machinery** from the main menu.

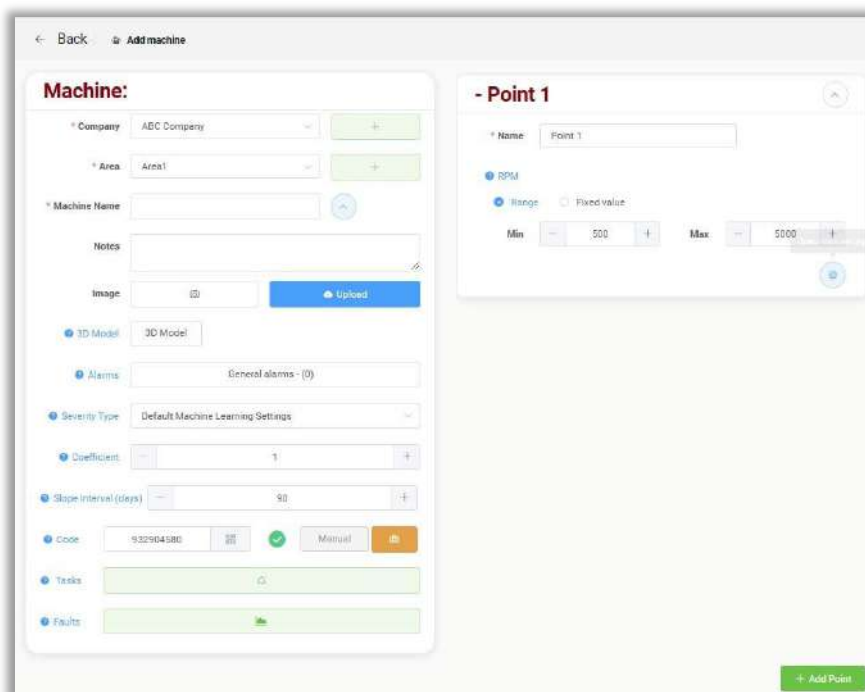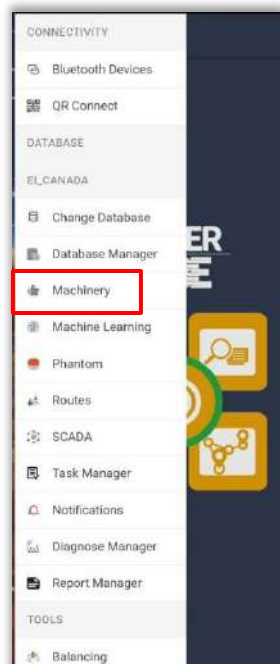

### Creating a new Machine

The **Add Machine** screen has two sections, the **Machine** panel and the **Points** panel. Contextual Help is available for some fields by clicking the blue question marks.


The **Machine** panel contains fields for:

- **Company:** The company who owns the machine.
- **Area:** The production area in which the machine is located.

New Company and Area info can be added by using the add button.



- **Name:** The machine name or ID number. **NOTE:** the only special character permitted in the name field is an underscore.
- **Image:** Optional 2D image of the machine may be uploaded to the database for reports. Also, clicking the photo button will capture an image using the device's camera.
- **3D Model:** 3D ODS models can be selected from the DigivibeMX database. External 3D models in .3ds, .xaml, or .obj formats can also be imported to DigivibeMX.
- **Notes:** Text field for documenting additional machine information.
- **Alarms:** General alarms may be configured here for Specialty Phantom sensors such as Temperature, Speed, Current, etc. These types of sensors may be administered at the Machine level **or** the Point level in the database. If created at the Machine level, the corresponding alarms should be configured here, if created at the Point level, configure alarms in the Points panel **Extras** field as described in the next section.




- **Severity type:** The choice is used to determine the severity color (red, yellow, orange, green) of the icons shown in the Data Tree of DigivibeMX , EI-Analytic and the WiSER VIBE App. The drop-down menu includes:
  - Only User Settings(default) – displays colors based only on User alarm severity settings.
  - Only Machine Learning Settings – displays colors based only on Machine Learning settings.
  - Default Settings - Shows User settings as source for colors, if configured. If not, shows Machine Learning settings.
  - Default Machine settings - Severity colors are shown based on Machine Learning, if configured. If not, colors reflect User settings.
- **Coefficient:** The machine maintenance priority or criticality for severity trending on a 1-10 scale (1 for critical machines, 10 for non-essential machines).
- **Slope Interval:** The time period of data to be considered for machine severity calculations.
- **Code:** DigivibeMX automatically generates a unique code(number) that can be used to identify a machine. Click the View button to see a unique QR code for scanning purposes. A Manual code may also be entered, or an image created via a device’s camera.
- **Task:** Opens the Tasks window. **NOTE-** This feature is only available with an EI-Analytic cloud database subscription; it is not currently supported when using local databases. Tasks provide notifications via email and/or push notifications to the WiSER VIBE App, based on configurable thresholds for velocity, acceleration, etc., for a given machine. Click on the green bar to open the Notification Manager manager window. See *EI-Analytic Task & Notifications Manager* section of this guide for details on setting Tasks.
- **Faults:** The Auto Diagnose feature is applied here. Click to configure and apply auto-diagnosis to this Machine. See the *EI-Analytic User Guide* for more details.

### Configuring Points on a Machine

Point 1 is created by default in a separate panel. Every machine has a minimum of 1 point, although it is not used when non-vibration Phantom sensors are assigned at the machine level. Click on the **up/down arrow** to expand or hide the bottom portion of the Points panel.


- **Name:** Use a naming convention for points that works for you. Names like MOB (motor outboard) or NDE (non-driven end) are commonly used. Only underscores are permitted as a special character in the name field.
- **RPM:** Enter a fixed value or the Min and Max RPM Range values for the machine point. An accurate RPM range is required for Acceleration Envelope calculation and identifying the machine’s running speed.
- **RPM Range Hz:** For high-sensitivity Phantom sensors (V10, V10E) use the default range of frequencies from 10 to 1000 Hz. It is recommended to change this for high-range Phantom triaxial sensors (V11, V11E) to 20 Hz Min and 1000 Hz Max to get higher precision.
- **Axes:** Defaults to triaxial, adjust as necessary.

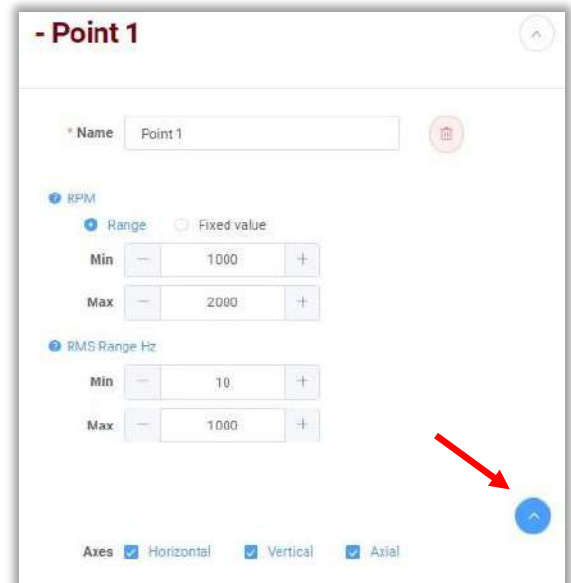

## Setting Axis Alarms

Axis Alarms are used to determine the colors displayed in the Data Tree (DigivibeMX or EI-Analytic).

Horizontal, Vertical and Axial alarms can be set in the **Point** configuration of a Machine:

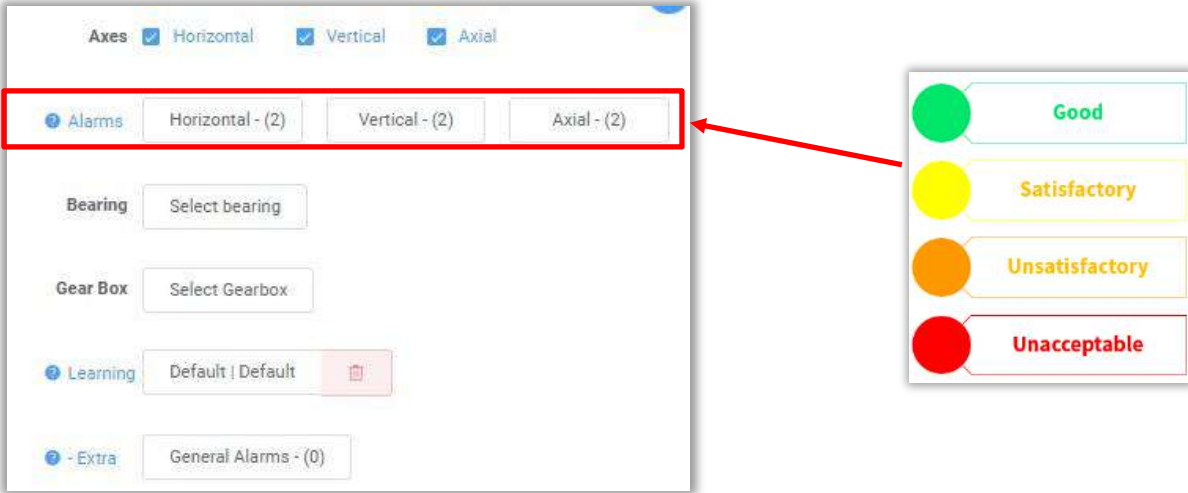



When adding a Machine, if you want to change the alarm values for all axes, open the **Options** Menu at top right of the Add Machine screen:

Click **Axis severity alarms**.

Select specific Axes or click OK for all (default).

The alarm config window will open.

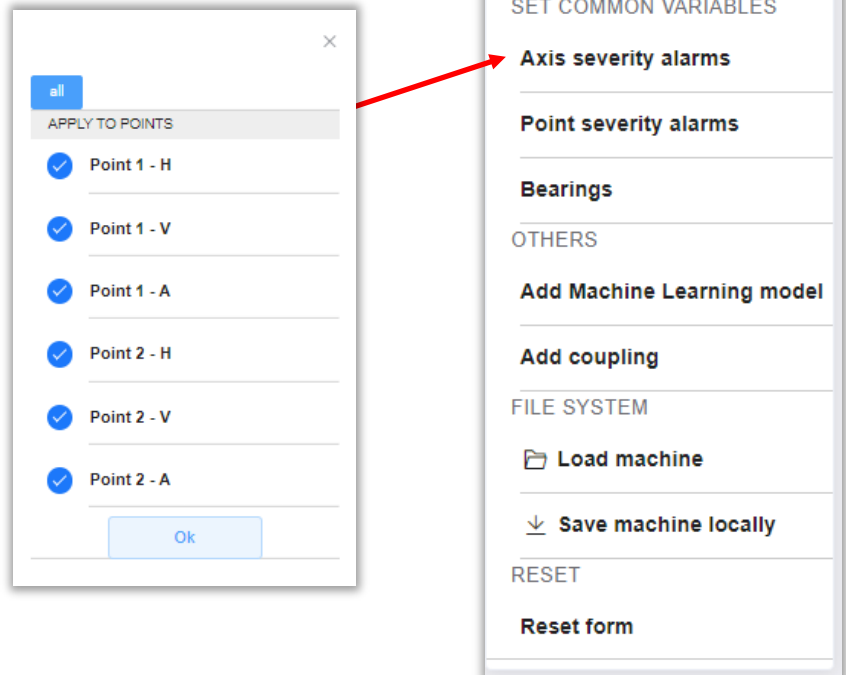

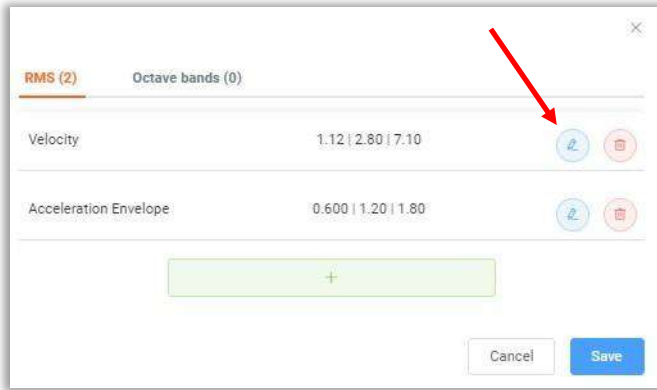


By default, velocity uses ISO 10816 Class 2 standards. Acceleration Envelope alarms are based on Standard Envelope alarm Class 2 standards.

Click on the **Edit** button to change the settings.



This opens the Alarm Settings window.

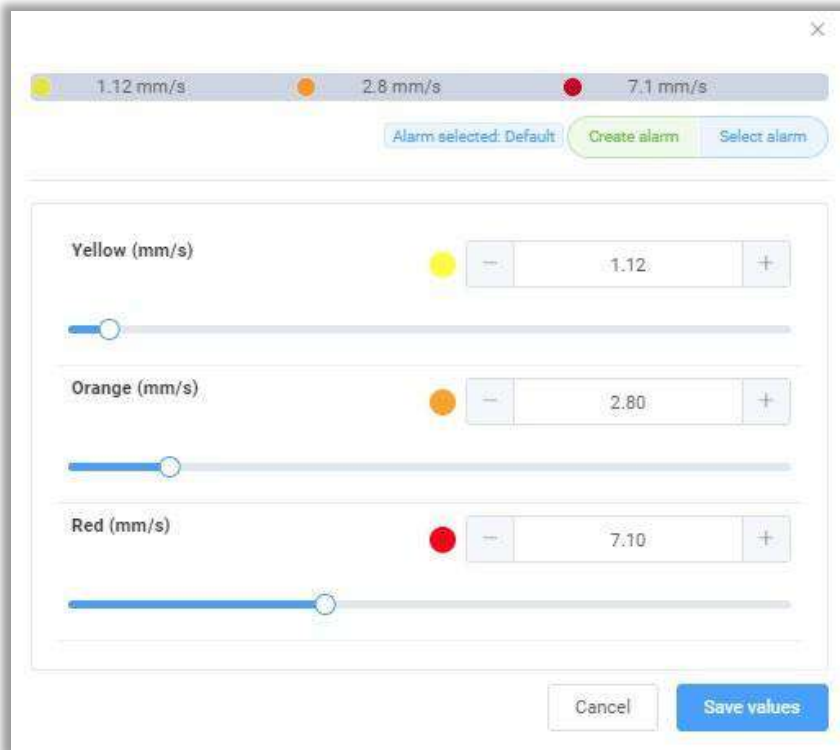

Previously created alarms can be applied by pressing Select alarm.

Select alarm

Change values by using the blue sliders, or by directly editing each box, or use the + and – buttons to adjust. Once set, the alarm values can be saved with two options:

To apply these values to the selected Axes, press Save Values.


Save values

To create a **new** alarm that can be assigned to any Axis, press Create alarm.

Create alarm

Enter a **Group** or add one with the  button and assign a **Name**, then press **Save alarm**.


To assign an alarm, press



The saved alarms are accessed via the drop-down box.


As shown, the ISO Class 2 alarms are the defaults. Select the Group and alarm Name – example Custom - Pumps2:

The settings screen reopens and shows the selected alarm.(Pumps2)

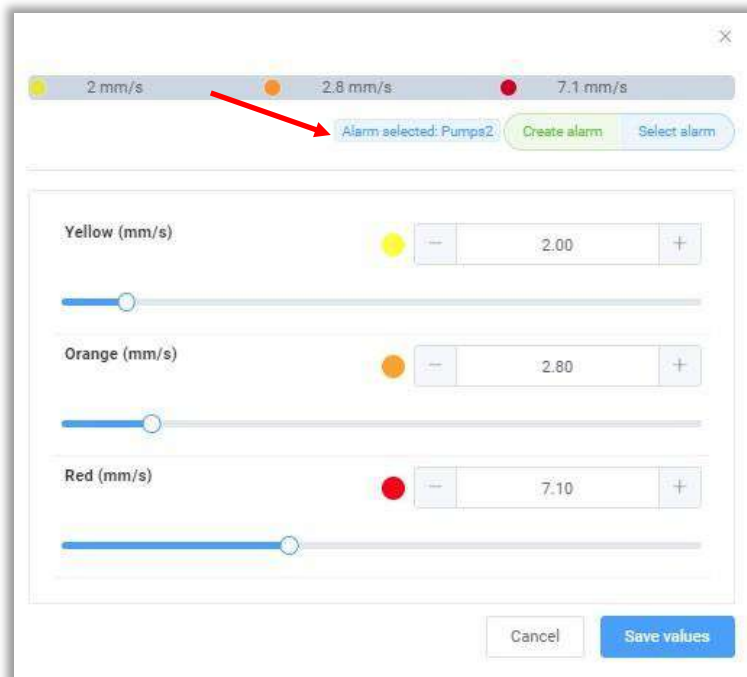

Press **Save values** to complete the changes.

By default, there are two parameters assigned for RMS alarms - Velocity and Acceleration Envelope.

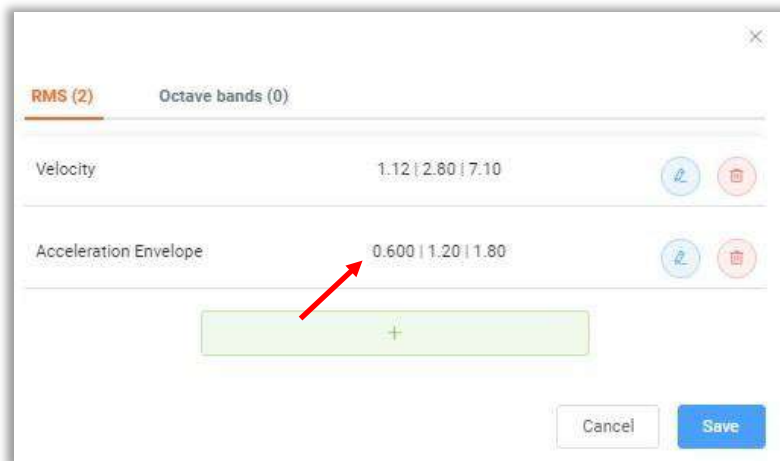

Click on the large green **Add** button to add RMS alarms for Acceleration and/or Displacement.

Once configured, colors will be shown in the Data Tree for Acceleration and/or Displacement, when chosen via the filter . This applies only to new data received after the alarms are applied.

As shown, the ISO Class 2 alarms are the defaults. Once changes are made, click on **Save**.

## Adding Bearings

The **Select Bearing** button opens the Bearing window.


Select bearing

DigivibeMX v11 features a Bearing database containing fault frequencies of over 40,000 common bearings from major manufacturers. Bearings may be permanently assigned to a machine measurement point or specified during Analysis. The Bearing database features a Search function, a Manual function for adding new bearings and fault frequencies to the database, and a Calculator to calculate bearing fault frequencies using bearing component measurements.

Enter complete or partial bearing part numbers to Search the database. Bearings can be manually created using calculated fault frequencies or those provided by the bearing manufacturer. The Calculator can be used to calculate fault frequencies using measurements or from data provided by the bearing manufacturer.



## Adding a Gear Box



To assign a gearbox to this machine point, or create a gearbox in the database, click on **Select Gearbox**.





This opens the Select Gearbox window, used to create a comprehensive library of gearboxes. Once created, the gearboxes may be permanently assigned to a machine measurement point or specified during analysis.

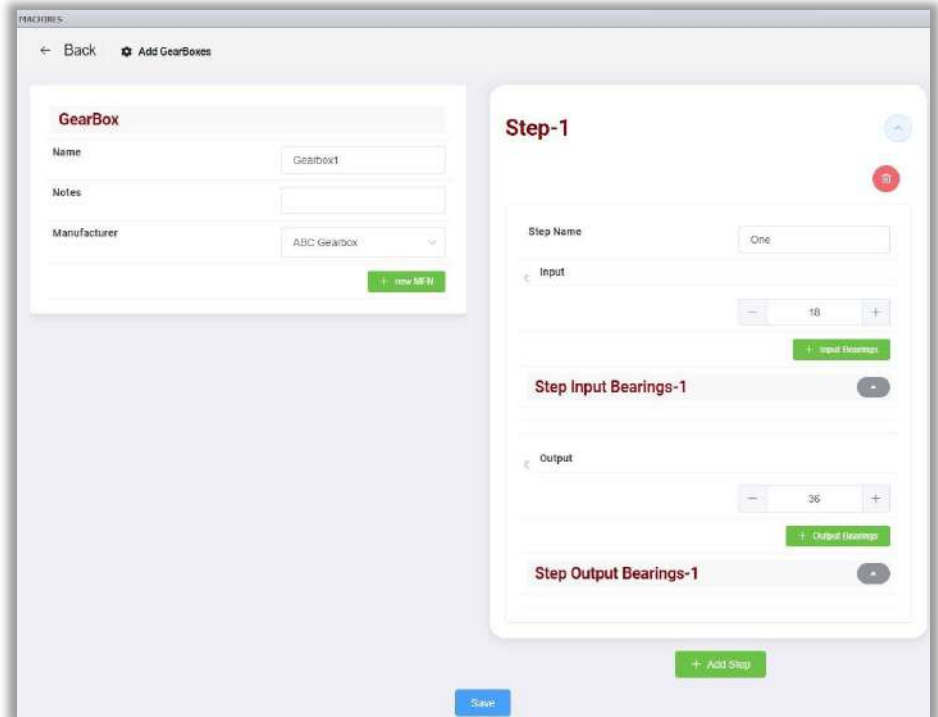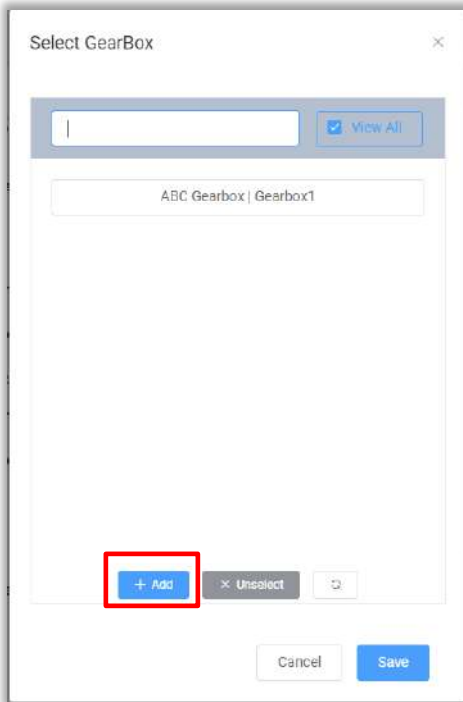Select a previously configured gearbox from the list or click the **+Add** button to create a new gearbox configuration.




- **Name:** Enter the name of the new gearbox.
- **Notes:** Add any desired notes.
- **Manufacturer:** Select from previously configured list or Click on the  button to configure a new Manufacturer.
- **Step Name:** Add the step name to the Step-1 panel.
- **Input:** Enter the number of teeth.
- **Input Bearings:** A bearing configuration may be added by selecting the  button.
- **Output:** Enter the number of teeth.
- **Output Bearings:** Add an output bearing, if desired.

Select the  button to configure another step in the Gearbox configuration.

Click  when finished. The new gearbox will be assigned to the current machine point.

- **Learning:** The Machine Learning feature uses predictive algorithms to analyze historical data and thereby identify when notification is to be made regarding the health status of a machine point. See the Machine Learning Guide for further information regarding the creation of machine learning models.
- **Extras:** In addition to vibration data, Extra Values such as Temperature, RPM and Amperage may be documented. Extra Values may be assigned at the Machine level, or at a Measurement Point. Click on the General Alarms button to set alarms for sensors that are assigned at the point level. These point level alarms have no relation to the Axis alarms previously described.

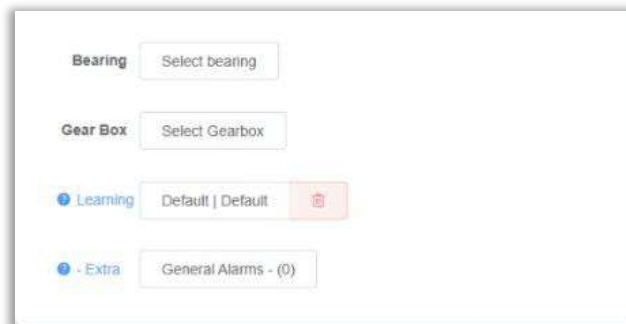

## Adding a Coupling

To add a Coupling, click the Add coupling button.

[Add coupling](#)

Enter a name and select which type of coupling is used for this machine.

A screenshot of a 'Coupling' configuration form. It has a title 'Coupling -' and a close button. Below the title is a 'Name' input field with a red trash icon. Underneath is a 'Coupling' section with four buttons: 'Direct', 'Belts', 'Coupling' (which is highlighted in blue), and 'Reducer + Belts'.

To add another machine point, click the green add button.



After adding all machine points, click on Save.

[Save](#)

You should see a confirmation message appear.


Machine added successfully

**Note:** At the top right of the Add Machine screen is an Options Menu.

For Alarms and Machine Learning, this menu allows configuration of ALL POINTS at once, rather than individual settings.

Machine configuration may be saved as a text file by using **Save Machine locally**.

**Load machine** loads a previously saved machine text file.

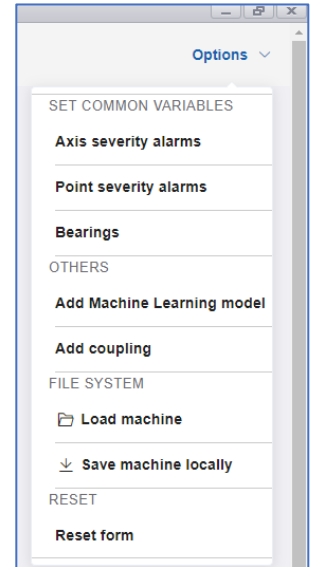

Once all machines are configured, Phantom sensors can be assigned. Vibration sensors are assigned at the *Point* level of a machine, while Specialty sensors such as temperature, RPM, etc., can be assigned at the *Machine* level or *Point* level in software.


## Step 9 - Create Phantom Database

### Phantom Management

This menu is used to manage the **Phantom** database and can be accessed in several ways:



#### Option 1 - DigivibeMX

To open Phantom Manager from DigivibeMX, click the **Wizard** icon on the Phantom menu.

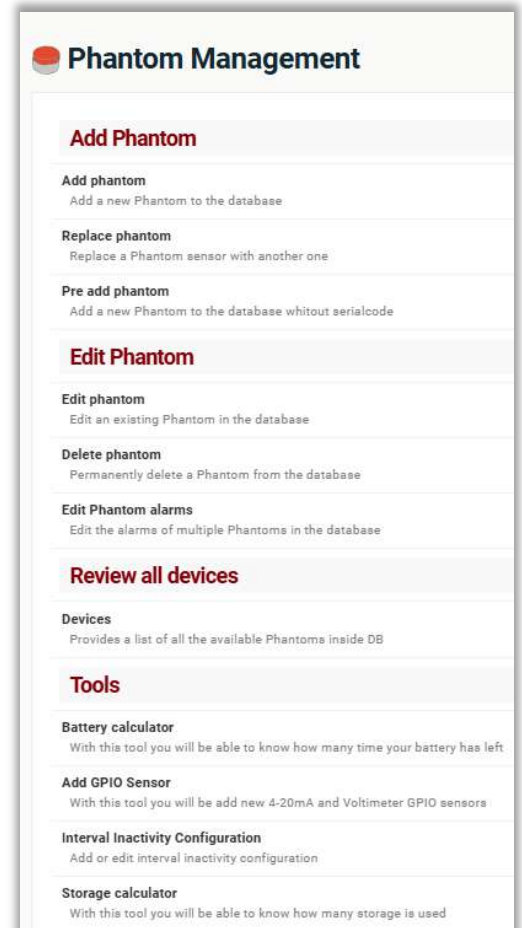

## Option 2 – EI Analytic web portal


To open from EI-Analytic, click **Devices** on the Main menu.

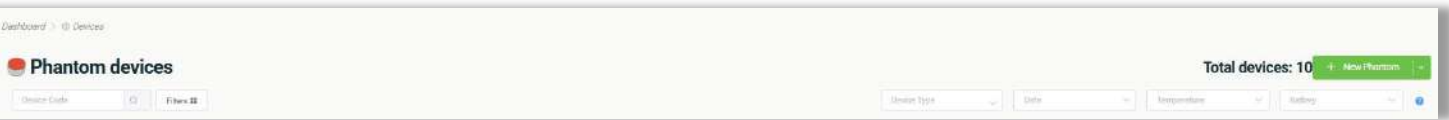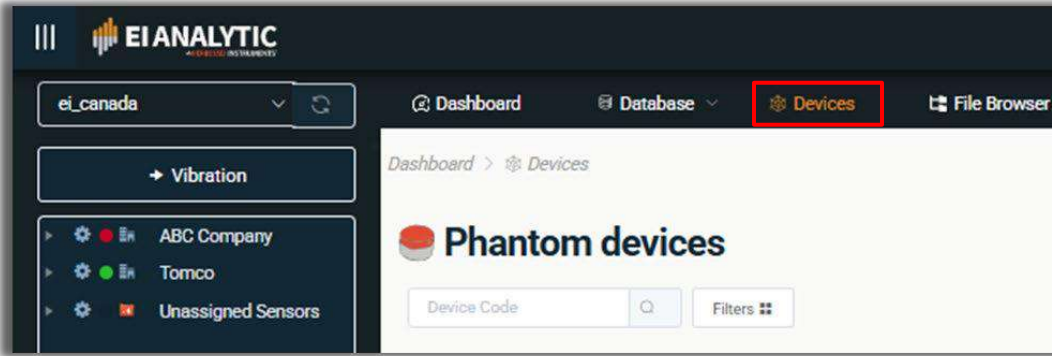

Use the **New Phantom** button to add Phantoms in EI-Analytic.




Some features are located under the Database>Phantom menu, including a link to the **Devices** screen:

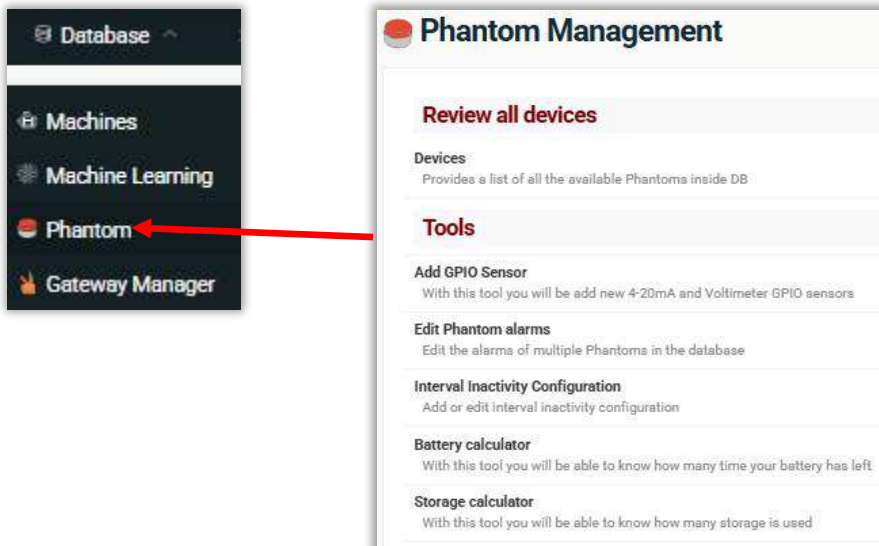

*Option 3 - WiSERVIBE*

To open from the WiSERVIBE mobile app, select **Phantom** from the main menu.

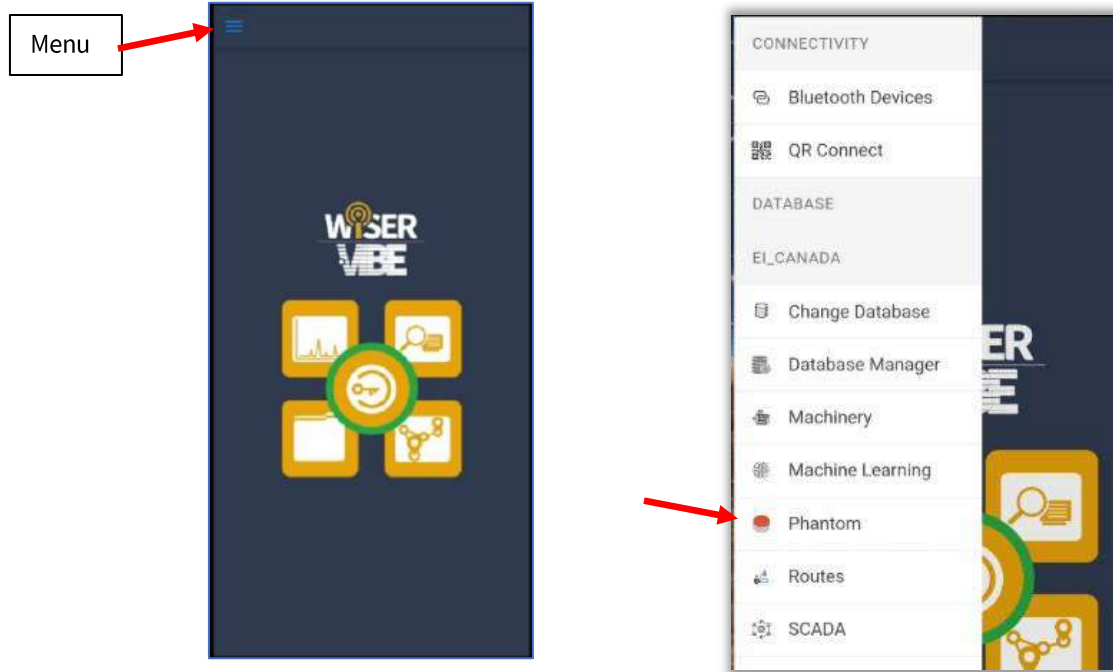


## Adding V10/V11 Vibration Sensors

To add a Phantom V10 or V11 vibration sensor:

1. Click **Add Phantom** or **New Phantom**; the Phantom Type screen will open:



2. Either scan the QR code of the sensor using the device's camera, or click **Enter code manually**, which opens a new screen:

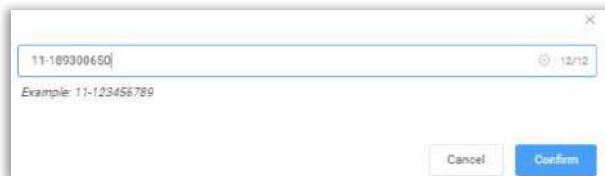

3. Enter the 11-digit code and **Confirm**. Technical info is then displayed for the sensor, based on the Phantom code provided.




4. Verify the type of sensor is correct and click **Next**.  
**Note** -If the sensor is already in use, a message will appear indicating the machine and point to which it is assigned (if in the same database). For other errors encountered at this step, contact Erbessd Tech support for assistance. (see the last chapter of this document for details)

5. Configure the **Group** and **Name** screen.

\*Fields with a red asterisk are required entries.

Phantoms are configured in Groups (you can administer them all in one group). Enter a **Group** name. For example, if a machine has 4 Phantoms assigned, the Group name may be the same as the Machine name. It is NOT recommended to use special characters other than the underscore in the Group name or Phantom name fields.

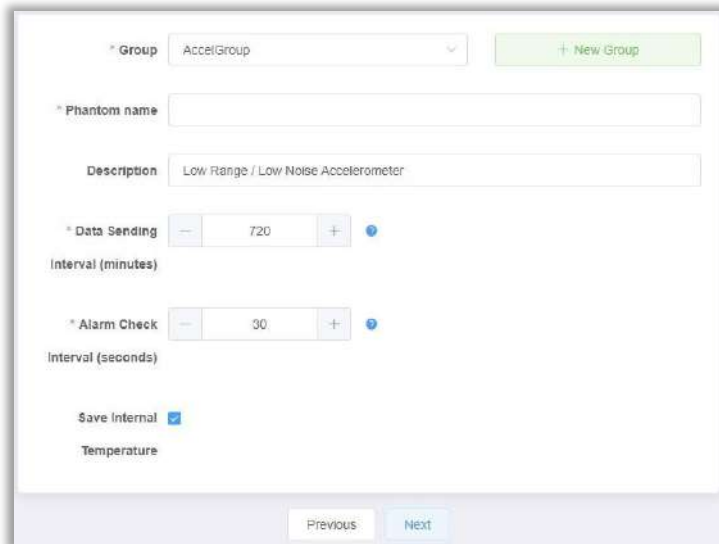


- The **Phantom name** should indicate the location of the sensor or anything else meaningful to distinguish it when all devices are listed. An example might be “Pump001NDE”.
- The **Description** field is auto-populated according to the type of sensor being added.
- **Data Sending Interval (minutes)\*\*** (For Gateway v1 ONLY!) is the time between Full data collections (RMS data interval is configured separately). The default is 720 mins (12 hr). The minimum interval for Phantom vibration sensors is 10 minutes. The maximum is 1440 minutes (24 hrs). For Gateway 2.0, data collection options for vibration sensors are configured via the Gateway Admin Console. See the next section for details.
- **Alarm Check Interval (seconds)\*\***(For Gateway v1 ONLY!) This is the time between alarm checks performed by the sensor. For Gateway 2.0, the **Sensor Update** interval serves as the Alarm check interval.
- **Save Internal Temperature:** Uncheck if the internal sensor temperature is not required as part of the RMS data sent by the sensor.

6. Click **Next** to open the Assignment screen. Expand the Company>Area>Machine tree and select the Point where this Phantom sensor is to be installed. There is also an option to create a new Machine at this step, by clicking the **Add Machine** button. Points with previously assigned Phantoms cannot be selected.



7. Press **Next** to open the Configuration screen:
8. Check and adjust, if necessary, the sensor **Axis configuration** . All Expert Phantoms have the axis orientation marked on top: The default setting is top-mount. For side mounting, invert X and Y axes.

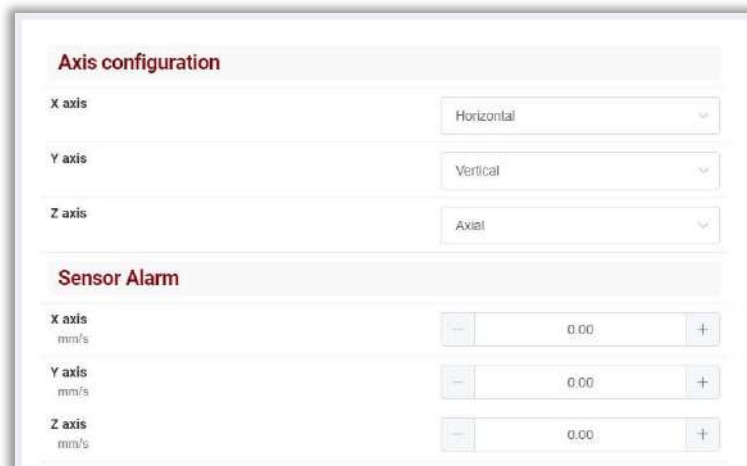

Axis configuration	
X axis	Horizontal
Y axis	Vertical
Z axis	Axial

Sensor Alarm	
X axis mm/s	0.00
Y axis mm/s	0.00
Z axis mm/s	0.00

The image below shows a Phantom Triaxial Vibration Sensor attached to the top of a common electric motor.

The X-axis corresponds to the horizontal direction; the Y-axis corresponds to the vertical direction; the Z-axis corresponds to the axial direction. The vibration sensor should be configured as X=Horizontal, Y=Vertical, Z=Axial.



When the same sensor is attached to the side of the motor, the axis orientation is different. For this setting, the configuration is X=Vertical, Y=Horizontal, Z=Axial.



9. Press **Next** to open the Configuration screen:
10. Check and adjust, if necessary, the sensor **Axis configuration**. All Expert Phantoms have the axis orientation marked on top: The default setting is top-mount. For side mounting, invert X and Y axes.
11. In the **Sensor Alarm** section, set values of RMS velocity for each axis as a threshold for Notification via email and push notification to Wiser Vibe app.

Click **Save phantom** and a confirmation message banner is displayed.

Axis configuration	
X axis	Horizontal
Y axis	Vertical
Z axis	Axial

Sensor Alarm	
X axis mm/s	0.00
Y axis mm/s	0.00
Z axis mm/s	0.00
Internal temperature °C	0.0
Battery	

For instructions regarding the installation of other types of Phantom sensors, see the *Adding Phantom Specialty Sensors* section of this guide.

## Step 10 - Pair Sensors to Gateways and Configure Settings



Sensors are shipped from the factory in *sleep* mode. They will not be detected by any gateway until they are reset using the provided magnetic key. This will “wake up” the sensor and make it visible to gateways.

1. Begin by placing the magnet on the sensor just left of the LED and hold until the LED illuminates. If it does not, move the magnet around the sensor’s radius until it does. Remove the magnet and the LED will stay lit for several seconds, then blink 3 times and turn off. The sensor is now activated/reset.



The Live State screen on the gateway Admin Console will show all sensors within Bluetooth range, listed by serial number.





Additional information is provided for each sensor, including:

- Signal strength (hover mouse over signal bars) 
- Sensor name (can be changed using edit icon) 
- When the gateway last communicated with this sensor
- The latest RMS velocity for each axis
- Battery voltage
- Temperature

**P1\_Pump\_NDE**

Serial: 189300650 version: 190  
Type: Triaxial Vibration (High range)  
EAnalytic Assignment: ABC  
Company\Area1\Pump\_001\Pump\_NDE

Last seen: 1 seconds  
Velocity RMS X: 0.12 mm/s  
Velocity RMS Y: 0.25 mm/s  
Velocity RMS Z: 0.14 mm/s  
Battery voltage: 2.68 V  
Sensor Temperature: 20.25 °C

UPDATE UNPAIR    



2. Some sensors require an update when they first connect to a Gateway 2.0. They will appear with an **update** button. Press to download and install the latest sensor firmware version. The blue status bar shows the update progress. You may need to reset the sensor using the magnetic key as part of the firmware update process.


Sensor firmware update: updating

**189289158**

Serial: 189289158 version: 170  
Type: Triaxial Vibration (High range)

This node needs an update to work with Erbesd Instruments Phantom Gateway v2. You may need to restart it manually to perform the update.  
Last seen: 4 seconds

UPDATE  

3. Select the sensors you would like to control from the gateway, and click **PAIR** for each. **Note** – all sensors in a Repeater Network are paired to the Main gateway only.
4. Rename the sensor by clicking  (recommend using the same name as entered in Phantom Manager)





Friendly name


CANCEL SET



The EI-Analytic assignment is shown for each sensor.

After pairing, more configuration options and info are available by clicking the **down arrow**.

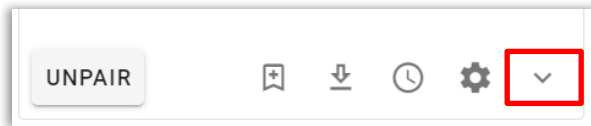

 **Favorite** Adds the sensor to the list of favorites.

 **Collect waveform now** Requests a data collection from the sensor. A blue message bar will appear, indicating the signal is downloading:

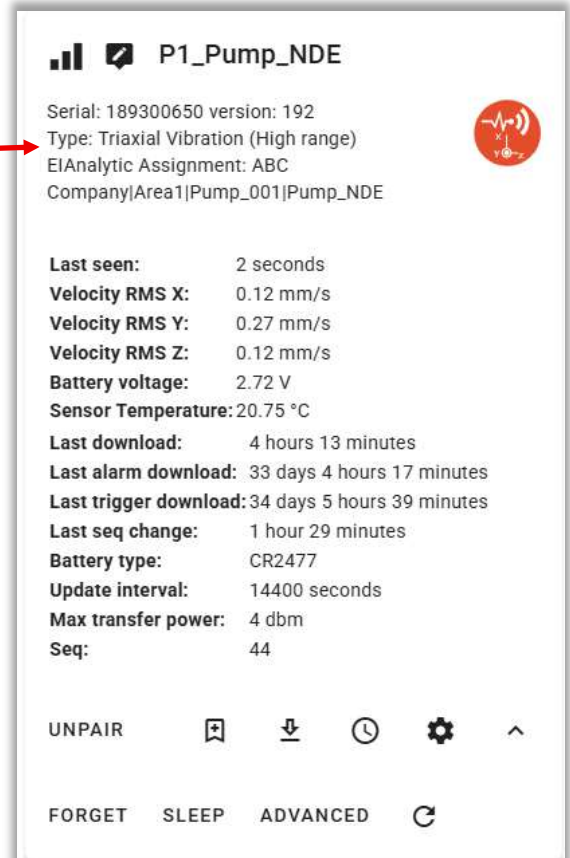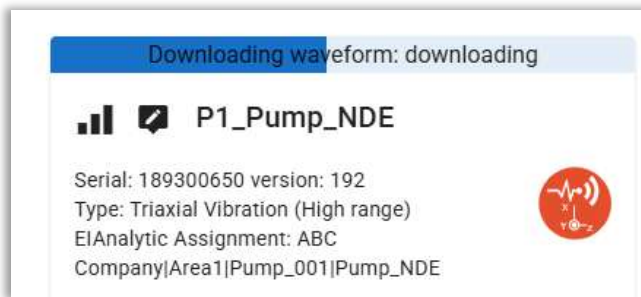







**P1\_Pump\_NDE**

Serial: 189300650 version: 192  
Type: Triaxial Vibration (High range)  
EiAnalytic Assignment: ABC  
Company|Area1|Pump\_001|Pump\_NDE

**Last seen:** 2 seconds  
**Velocity RMS X:** 0.12 mm/s  
**Velocity RMS Y:** 0.27 mm/s  
**Velocity RMS Z:** 0.12 mm/s  
**Battery voltage:** 2.72 V  
**Sensor Temperature:** 20.75 °C


**Last download:** 4 hours 13 minutes  
**Last alarm download:** 33 days 4 hours 17 minutes  
**Last trigger download:** 34 days 5 hours 39 minutes  
**Last seq change:** 1 hour 29 minutes  
**Battery type:** CR2477  
**Update interval:** 14400 seconds  
**Max transfer power:** 4 dbm  
**Seq:** 44

UNPAIR     


FORGET SLEEP ADVANCED 

🕒 **Sensor Collection settings** Contains multiple sub menus:


a) **Timed collection:** Allows you to select the sensor collection mode from the four available options:

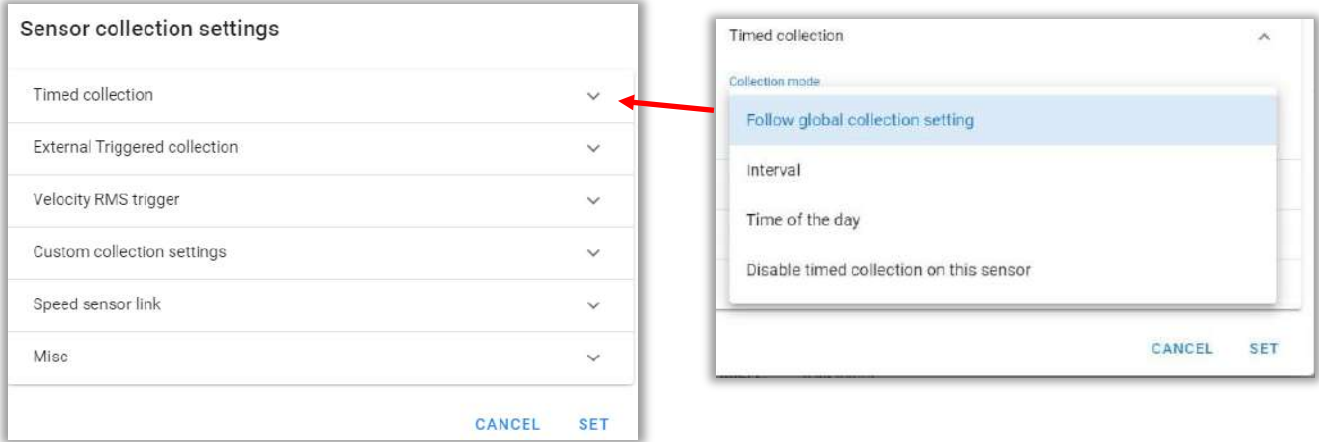


i. **Follow global collection setting:** Causes the sensor to record data according to the global configuration settings of the gateway. See *Global Collection Settings* in the next section of this guide.

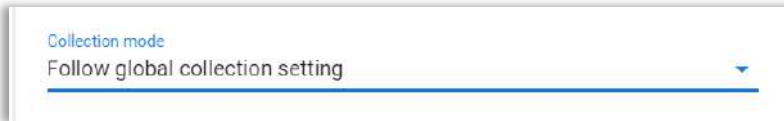


ii. **Interval:** Allows you to send data with a defined interval. You can switch between minutes, hours or days as long as you stay within the allowed range of the sensor. The default Interval is 720 minutes(12 hrs).

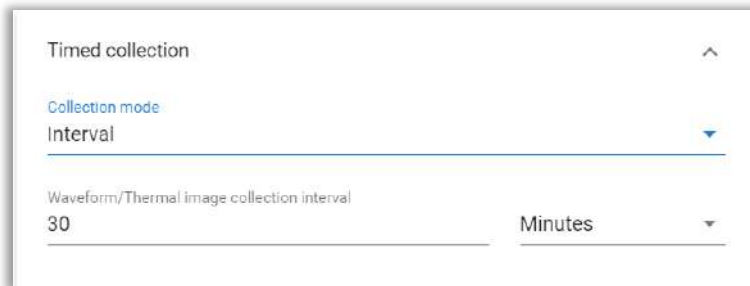


- iii. **Time of the day:** Multiple specific times of the day can be set to send data. Click on **Custom waveform collection time**, a clock will appear, allowing you to choose the time you want. Click on **ADD TIME** to add this time to the list. Add multiple Custom recording times by repeating this process, or delete them with **REMOVE**.

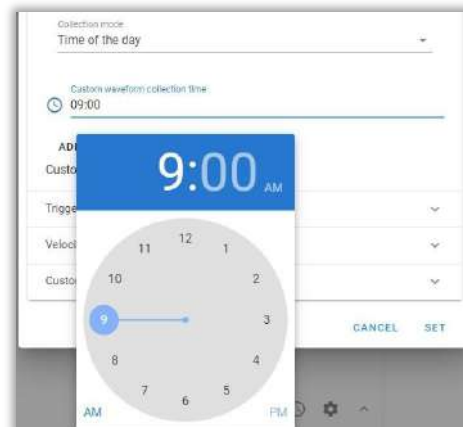

- iv. **Disable timed collection on this sensor:** Disables data collection. RMS velocity, temperature and battery level will continue to be reported. This is useful if the only full data collections required are *triggered* internally by a velocity RMS setting or externally by another sensor, see below for more details.



- b) In the **Externally Triggered collection** section, you can link vibration sensors with other Phantom sensors for parameters including current, speed, dry contact, 4-20 mA or 0-10 volt. For details see the *Triggering Sensors* section of this guide.

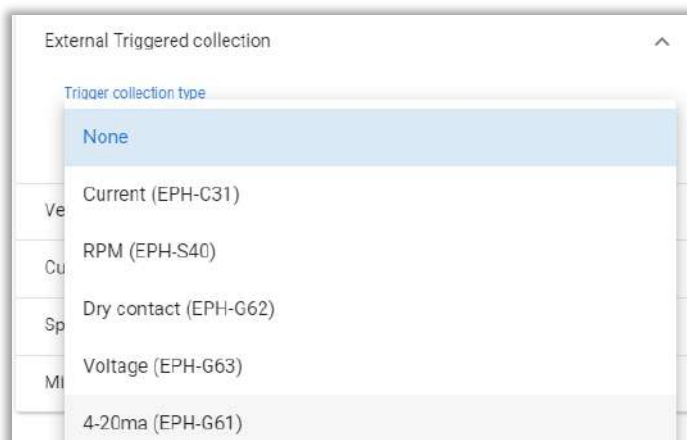

c) In the **Velocity RMS Trigger** section, configure optional sensor trigger thresholds.

**RMS Trigger level 1** will cause the sensor to send a data collection if the RMS velocity threshold is exceeded on any of the measured axes.

**RMS Trigger level 2** will trigger an email/push notification if the RMS velocity threshold is exceeded on any of the measured axes.

**Mode** determines whether to only send the original data that caused the trigger(RMS) to the database, or take a new time waveform To trigger a waveform collection, set this to: **Collect data with full settings** .


**Trigger count threshold:** This parameter defines number of consecutive *counts* for which an alarm condition exists before an alarm is triggered. A *count* is the amount of time defined by the **Sensor Update Interval** , which is set via the **In-Sensor Settings**(see next page).

**Time to ignore trigger after collection** indicates how much time must pass before the sensor can trigger again (applies to both Level 1 and 2).

Set to **Collect new data** to obtain a full waveform for Level 1 thresholds

- d) **Custom collection settings** can be used to **Override global collections settings** to modify the settings for *this sensor only*. Otherwise the sensor will take the global settings from the gateway. The options are explained in the next section (Global Collections).
- e) **Speed Sensor Link** When an EPH-S40 Phantom Speed sensor is installed in Continuous mode (powered locally via 5-24VDC), a parameter can be set to cause an RPM measurement to be sent whenever an Expert Triaxial Phantom sensor sends a full vibration signal file to the database.

The **RPM Source Sensor** drop-down will contain the phantom code for all available RPM sensors.

In **sensor settings**  allows you to modify the internal settings of the sensor.

In **General**, set the **Max transfer power**. The default and recommended setting is **8 dbm** for Expert Vibration sensors.

The **Sensor update interval** defines how often the sensor updates its status to the Gateway. For vibration sensors, this is the interval used to send an RMS velocity value, internal temperature and battery voltage level. This is called a sequence or **count**. This interval is also used to check the sensor's RMS velocity internal trigger threshold status.



Check **Long Range mode** if this sensor is to use Long Range instead of Regular Bluetooth scanning mode.

You can check the **Connect to Phantom Gateway v1** option if you want this sensor to connect to an older Gateway v1 receiver.


The **Vibration triaxial settings** contains the options for the **RMS** value calculation:


- **Lower cutoff or Higher cutoff:** Defines the frequency range.
- **Calculation range:** Choose the dynamic range.
- **Sample rate:** Sets the sample rate and maximum frequency.
- **Lines of resolution:** Select the resolution lines for calculation.

Click **SET** to save the changes in the sensor.

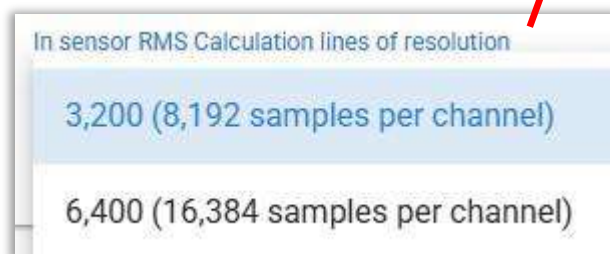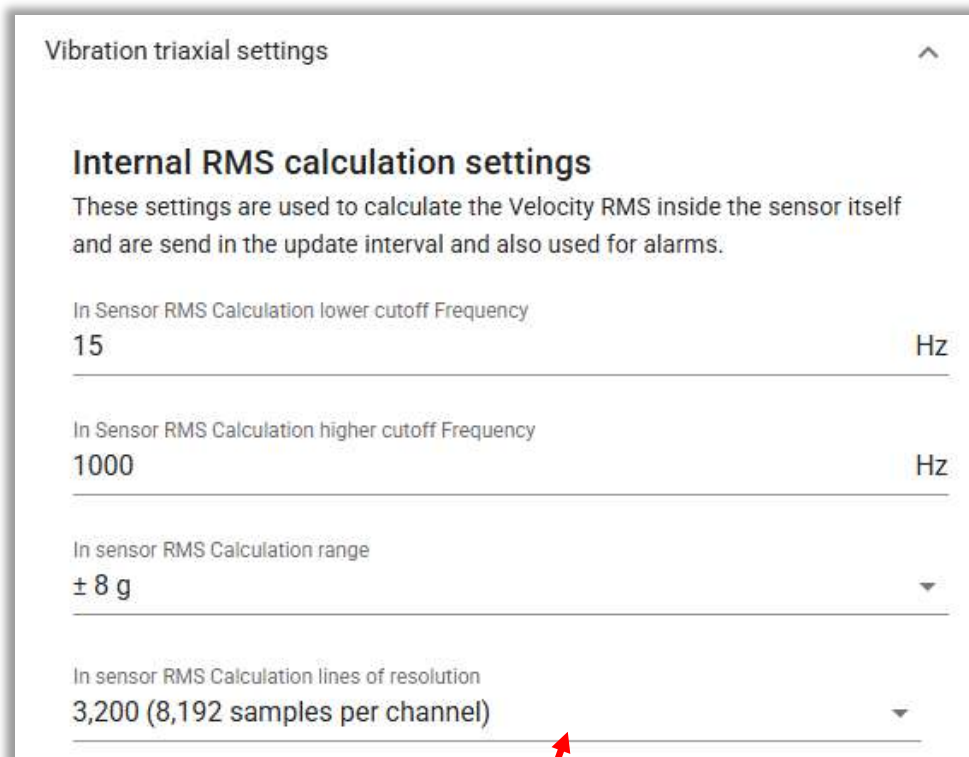

Additional information displayed after a sensor is paired includes:


- **Last download:** Time since last downloaded signal.
- **Last alarm download:** Time since last signal downloaded by alarm.
- **Last trigger download:** Time since last signal downloaded by trigger activation.
- **Last seq change:** Time elapsed in the last sequence (Sensor Update Interval).
- **Battery type:** Sensor battery type.
- **Update interval:** Sensor Update Interval (saved in sensor).
- **Max transfer power:** Maximum transfer power set in sensor.
- **Seq:** Number of sequences this gateway has logged.
- **Unpair:** Unlinks the sensor from the Gateway.
- **Forget:** Forgets this sensor and its settings. It will not appear in the Gateway list until it sends data again.
- **Sleep:** Disables the sensor for battery conservation. The sensor will not take measurements or save new settings until it is reset with the magnetic key. **Note** -You must *unpair* a sensor before activating sleep mode.
- **Advanced:** Allows you to add codes for specific firmware updates. This option requires the Gateway to have internet access. To avoid damage to your Phantom sensors, do not enter a code without the help of a Technical Support assistant.
- **Request Measurement Update**  Causes the sensor to send an immediate RMS reading and resets the Update Interval timer to 0.

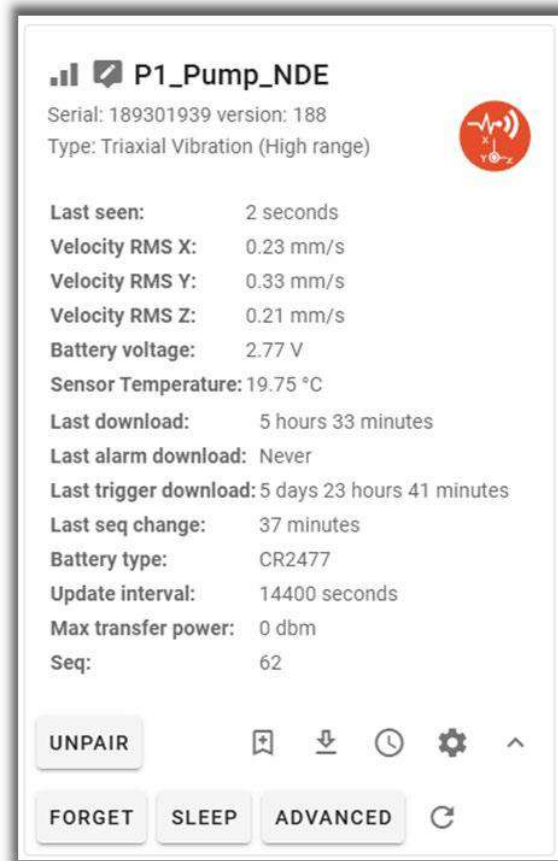

## Live State Screen Search and Sort

The Live State screen offers **Search** and **Sort** options:

Use the **Search** field to find sensors by serial number or name:

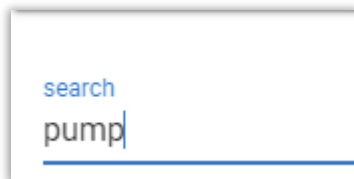

In this example, a search of “motor” results in 3 sensors being displayed.

**Main\_Gateway**  
Serial Number: 589248404  
Version: 648T370S24

Date/Time: 11/5/2025, 10:27:53 AM  
Uptime: 1 day 19 hours 21 minutes  
Total memory: 498 Mb / Free: 392 Mb  
System Temperature: 30° C / BT: 29° C  
CPU Load: 36%  
Main Cable connection IP: 192.168.0.25  
Main Cable TX: 13MB RX: 12MB  
Wireless Sensors: 11 Paired: 11  
Storage total: 28 Gb Free: 28 Gb

search  
motor

sort by  
Serial Number

show only  
All

Sensor Name	Serial	Version	Type	Company	Last seen	Velocity RMS X	Velocity RMS Y	Velocity RMS Z
P1_Motor_NDE	189286917	192	Triaxial Vibration (High range)	Company\Area1\Pump_001\Motor_NDE	1 seconds	0.43 mm/s	0.23 mm/s	0.2 mm/s
P1_Pump_DE	189296418	192	Triaxial Vibration (Low range)	Company\Defiant\Test_rig\Motor_DE	0 seconds	0.06 mm/s	0.13 mm/s	0.1 mm/s
P1_Motor_DE	189301939	192	Triaxial Vibration (High range)	Company\Area1\Pump_001\Motor_DE	1 seconds	0.21 mm/s	0.33 mm/s	0.19 mm/s

The **sort by** field offers multiple options:

sort by

- Serial Number
- Last seen
- Node type
- Signal strength
- Battery
- Last download

The **show only** field allows filtering the view by:


show only

- All
- Paired
- Unpaired
- Low battery
- Low signal
- Favorites
- Secured
- Unsecured

The Sort Order button  toggles the display between sorted ascending or descending.

## Global Collection Settings

The **Collection** tab on the Config menu is used to configure the Global Settings.

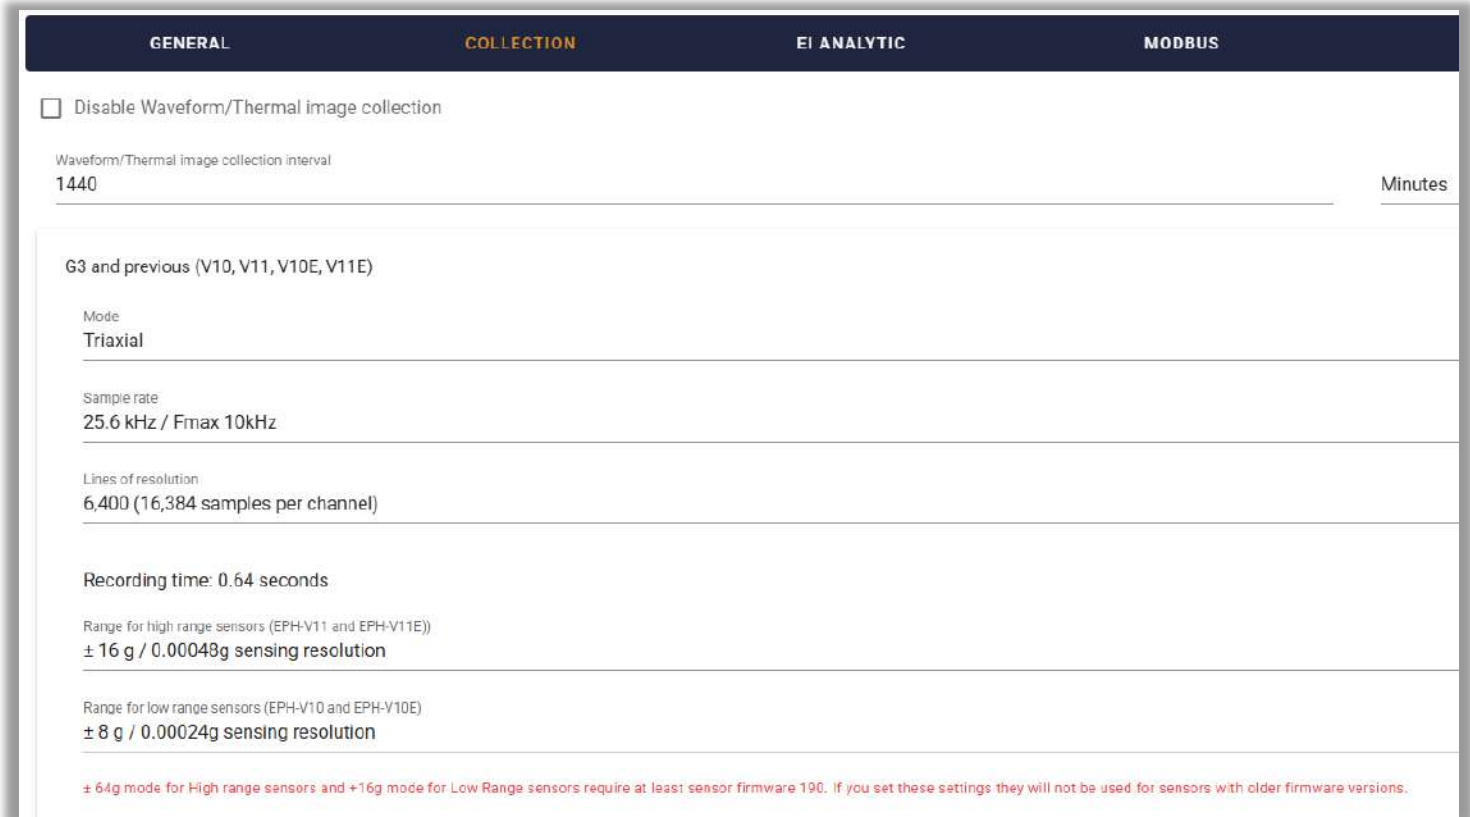

**Disable Waveform/Thermal image collection** - stops data collection of Time Waveform data from all vibration sensors and thermographic images from Phantom EPH-T70 sensors. RMS values will continue to be reported.

**Waveform/Thermal Image Collection Interval** : This is the collection interval for Time Waveform data from vibration sensors, and thermographic images from Phantom EPH-T70 sensors. It can be configured in days, hours, or minutes. The minimum interval for Phantom vibration sensors is 1 minute. The default is 720 minutes(12 hrs).

**Mode** switches the type of data collection between **Triaxial** (three axes simultaneously) or **Single Axis** (one axis or three axes sequentially). When you select **Single Axis**, the **Axis** option will appear, where you can choose the axis on which you want to collect data (**x**, **y** or **z**), or if you want to collect on all axes **sequentially**.



Sample rate allows choice of rate and related Fmax of the sensor.



The following tables show the relation between recording time, sampling rate and Fmax.

**V10, V17, V10E and V15 High Sensitivity sensors**

Recording time (s) 3 axes	0.64	1.28	2.56	5.12	10.24	20.48	40.96	81.92
Recording time (s) 1 axes	2.56	5.12	10.24	20.48	40.96	81.92	163.84	327.68
Sample rate (Hz)	25,600	12,800	6400	3200	1600	800	400	200
Max frequency (Hz) [x,y]	4000	4000	2500	1250	625	312.5	156.25	78.125
Max frequency (Hz) [z]	1800	1800	1800	1250	625	312.5	156.25	78.125
Lines of Resolution	Triaxial-12,800 Single Axis-25,600							
Spectral noise (@10 Hz)	130 µg/Hz							


**V11, V18, V11E and V16 High Range sensors**

Recording time (s) 3 axes	0.64	1.28	2.56	5.12	10.24	20.48	40.96	81.92
Recording time (s) 1 axes	2.56	5.12	10.24	20.48	40.96	81.92	163.84	327.68
Sample rate (Hz)	25,600	12,800	6400	3200	1600	800	400	200
Max frequency (Hz) [x,y]	10,000	5000	2500	1250	625	312.5	156.25	78.125
Max frequency (Hz) [z]	5100	5000	2500	1250	625	312.5	156.25	78.125
Lines of Resolution	Triaxial-12,800 Single Axis-25,600							
Spectral noise (@10 Hz)	630 µg/Hz							

Triaxial mode supports 6400 or 12,800 resolution lines; :Single axis mode supports up to 25,600 resolution lines:




According to the selected collection type, sample rate and resolution lines, the collection time will change and will be displayed in **Recording time**.

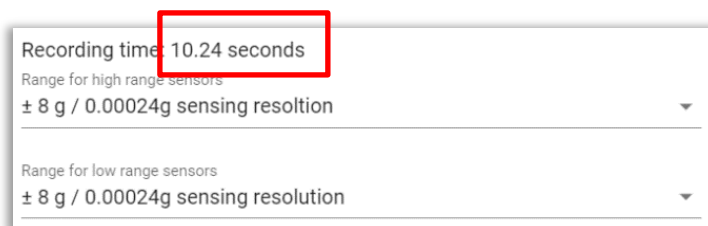


Select the dynamic range for the sensors.

For high range sensors, choose from the following options. **Note** ±64 g requires sensor firmware version 190 or higher.

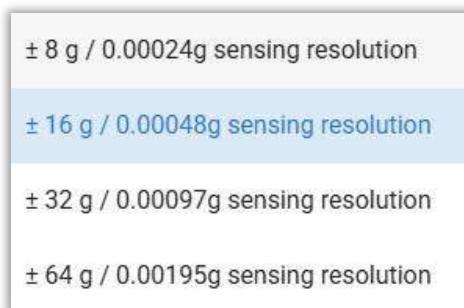

For high sensitivity sensors, choose from the following options:

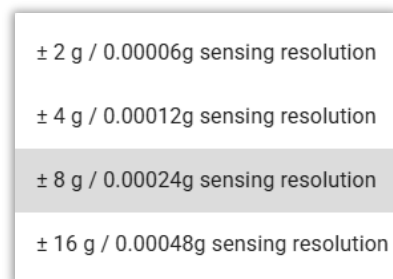

## Step 11 – Check Sensor Status and Test

Although detailed status information is displayed in the Live State screen of the Gateway Admin Console, it is limited to sensors connected to an individual gateway. For an all-encompassing status display, there are several options:

1. DigivibeMX - Phantom menu Status window
2. EI-Analytic – Devices tab on the main menu
3. The Review All Devices option in the Phantom menu in the Wiser Vibe app.

### Option 1 – DigivibeMX Phantom Status

1. After logging in to a EI-Analytic database, click the **Status** button in the DigivibeMX **Phantom** menu.

This opens the Status Devices window. The screen is divided into 2 functional sections.



The screenshot shows the 'Status Devices' window. At the top, there is a 'Group' dropdown menu and a toolbar with icons for 'ALL', '3X LR', '3X G2 HR', '3Ch', '4Ch', a speedometer, and a camera. Below the toolbar is a tree view showing 'ABC Company' and 'Tomco'. The main area contains a table with the following columns: Device, Device T..., Device C..., Device N..., Battery L..., Temperat..., Signal Str..., Firmware, Last Upd..., Machine ..., Point Name, Gallery, Edit, and Alarm Status. The table contains six rows of sensor data. A red box highlights the toolbar and tree view, and a green box highlights the table.

Device	Device T...	Device C...	Device N...	Battery L...	Temperat...	Signal Str...	Firmware	Last Upd...	Machine ...	Point Name	Gallery	Edit	Alarm Status
	Accelero...	189298418	V10E8418	1	23.5	-54	182	2023-08-...	Pump002	Motor-NDE	Lab	Edit	Show
	Accelero...	189286917	V11E6917	1	21.75	-55	182	2023-08-...	Pump001	Motor-NDE	Lab	Edit	Show
	Temperat...	189262176	Ext001Te...	1	23.75	-55	117	2023-08-...	Extruder...	-	Lab	Edit	Show
	Current v2	189261227	AMP1227	1	24	-43	135	2023-08-...	Compres...	-	Lab	Edit	Show
	RPM	189259579	P1RPM	1	20.75	-80	143	2023-08-...	Pump001	-	Lab	Edit	Show
	Thermogr...	189275016	TCam1	1	21	-50	108	2023-08-...	TCam	-	Lab	Edit	Show

Number of sensors:6

**Section 1 - Filters:** In this section of the Status window, select sensors can be displayed on the main screen. There are 3 different sorting options to choose from:

- **Group:** Displays and selects the sensors assigned or saved to a specific group, regardless of the type of sensor or its location within the database.
- **Tree:** Selecting items from the tree can easily locate sensors located in a specific machine, area or company. The screen will display the sensors assigned to a selected level of the database tree.
- **Sensor type:** By selecting a particular sensor icon, sensors are displayed according to the type of sensor selected.



**Section 2 - Information:** This area displays general information sent by the sensor, divided into a table to facilitate easy reading. Column value details are as follows:


- **Device:** Shows the iconography designed for that sensor type.
- **Device Type:** Shows the Device Type name.
- **Device Code:** Shows the serial number of the sensor.
- **Device Name:** Shows the name of the sensor created in the Phantom database.
- **Battery Level:** Shows the remaining battery percentage: Green(1)=85-100%, Yellow(2)=50-84%, Red(3)=0-49%.
- **Temperature:** Shows the internal temperature of the sensor. **NOTE:** This temperature value is for the internal circuit temperature of the sensor - not room temperature or surface temperature where installed.
- **Signal Strength:** Shows the signal strength between sensor and gateway in dBm. (-50 to -75 is Good, -76 to -90 is OK and less than -90dBm is considered Poor).
- **Firmware:** Shows the installed firmware version.

- **Last update:** This column shows the time of most recent Sensor Update transmission or full recording file.
- **Machine name:** Indicates the machine where the sensor is assigned.
- **Point Name:** Indicates the point of the machine where the sensor is assigned.
- **Gallery:** Indicates the group where the sensor is assigned.
- **Edit:** This editing interface is deprecated and should not be used. It was previously used to edit alarms and data collection settings.
- **Alarm Status:** opens a window to view any alarms registered for this sensor.

**IMPORTANT:** Sensor battery life and temperature values will not display accurate values until the sensor has sent a full recording file to the database.

## Option 2 – EI-Analytic Devices


Open the **Devices** tab on the EI-Analytic main menu:

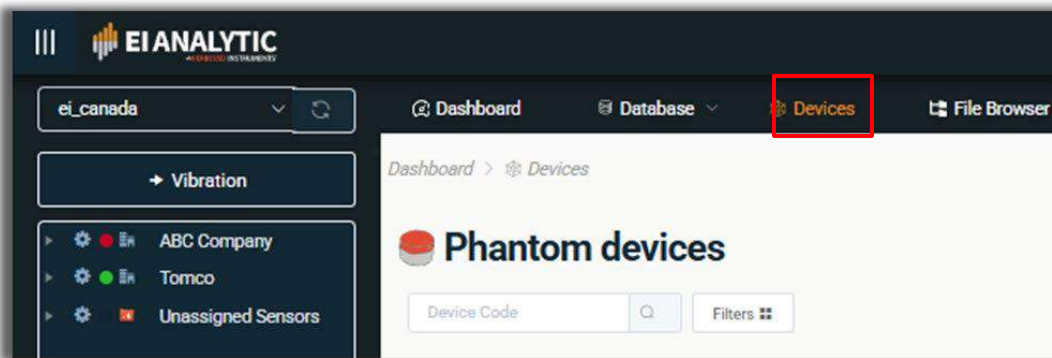






The same information as shown in DigivibeMX above is displayed for each sensor in the database:

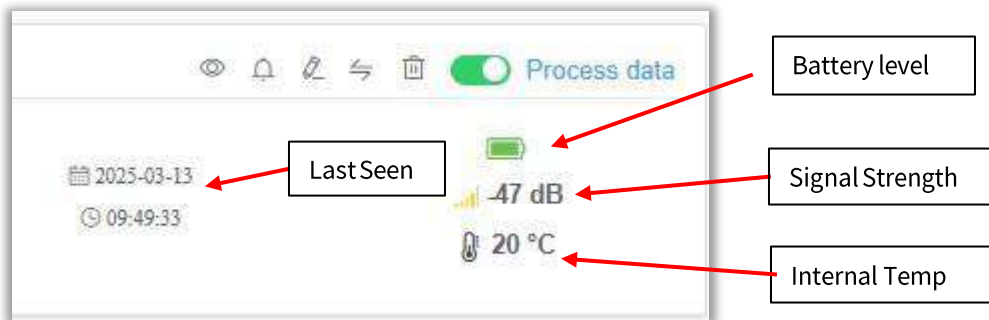

See the right side of the Devices display:



Additional toolbar items include:

-  **Sensor Alarm Log**
-  **Tasks** for this sensor – see *Notifications* section of this guide for more details.
-  **Edit Sensor config** – change settings for this sensor.
-  **Replace Phantom** – exchange one Phantom for another (same model only, e.g., V11E for V11E)
-  **Delete sensor.** - Provide serial number to confirm deletion.

## Option 3 – Wiser Vibe

Select the **Devices** option in the Phantom Management screen on the Wiser Vibe app.

All sensors are displayed in an identical format to the EI-Analytic interface described above.


## Testing Sensors



To test your sensor for successful data collection and relay of the time waveform signal file to the database, you can request an on-demand download from the Live State screen. If you do not have access to the gateway web interface, you can also reset a sensor using the magnetic key, which will cause it to send a data collection.

**Note** – If a gateway 2.0 cannot relay the data to a database (either local or cloud), it will store the files on the gateway’s internal SD card until the connection to the database is re-established. The files will then upload automatically. See *Offline Storage* in the *Gateway 2.0 Additional Features* section of this guide for more details.

To test a data collection from a gateway:

1. Open the gateway Admin Console.
2. Click **Request Download** on the sensor to be tested.

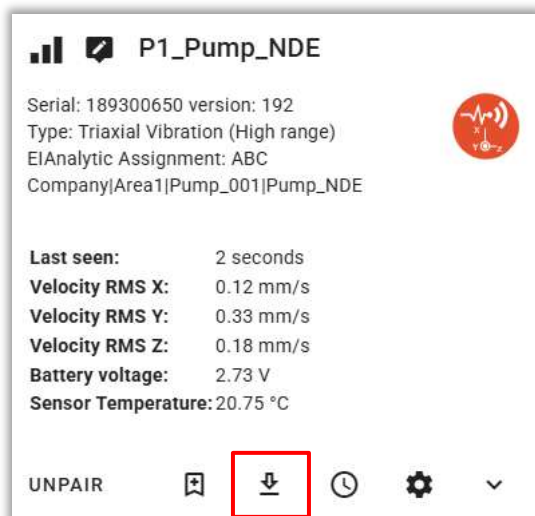

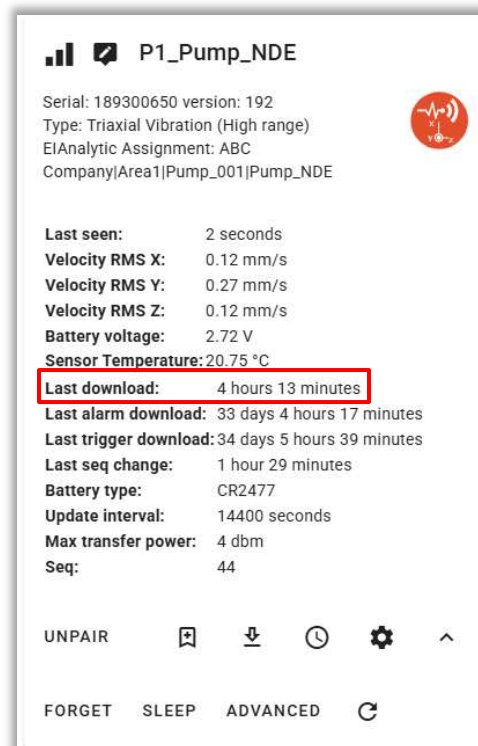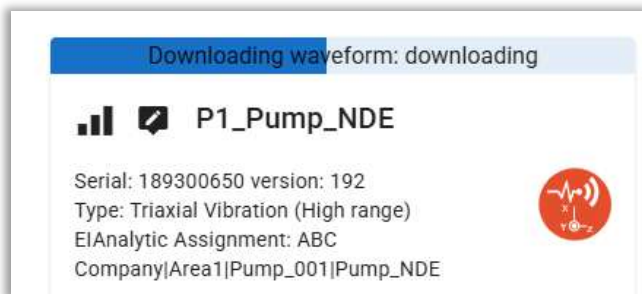


- Note the blue downloading message; once it is complete, expand the sensor information box. The date/time of the **Last download** will show if the test was successful. An error message will appear if the download was NOT successful. For example, if it was received by the database, but the sensor serial number has not been assigned to a Machine or Point.
- The database should then be examined to ensure the file was sent successfully, and can be opened for analysis.

### Checking with DigivibeMX

You can check a local or cloud database using DigivibeMX software:


- From the DigivibeMX Phantom menu click the **Status** button.

The **Last Update** field shows the most recent update time.

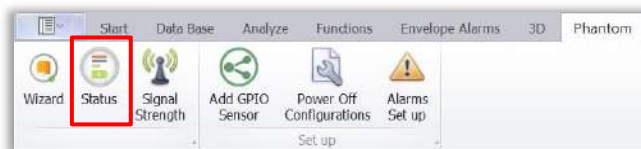


Device	Device T...	Device C...	Device N...	Battery L...	Temperat...	Signal Str...	Firmware	Last Upd...	Machine ...	Point Name	Gallery	Edit	Alarm Status
Acceler...	189298418	V10E8418	1	21.5	-54	182	2023-08-...	Pump002	Motor-NDE	Lab	Edit	Show	
Acceler...	189286917	V11E6917	1	19.25	-63	182	2023-08-...	Pump001	Motor-NDE	Lab	Edit	Show	
Temperat...	189262176	Ext001Te...	1	21.75	-69	117	2023-08-...	Extruder...	-	Lab	Edit	Show	
Current v2	189261227	AMP1227	1	22.5	-55	135	2023-08-...	Compres...	-	Lab	Edit	Show	
RPM	189259579	P1RPM	1	19	-76	143	2023-08-...	Pump001	-	Lab	Edit	Show	
Thermogr...	189275016	TCam1	1	19	-54	109	2023-08-...	TCam	-	Lab	Edit	Show	

- Open the Historic Measures window by clicking on any axis of the Machine point in the data tree for the tested Phantom. The signal files are listed by date. Check the date filter and open any file for analysis by clicking **Open file**.

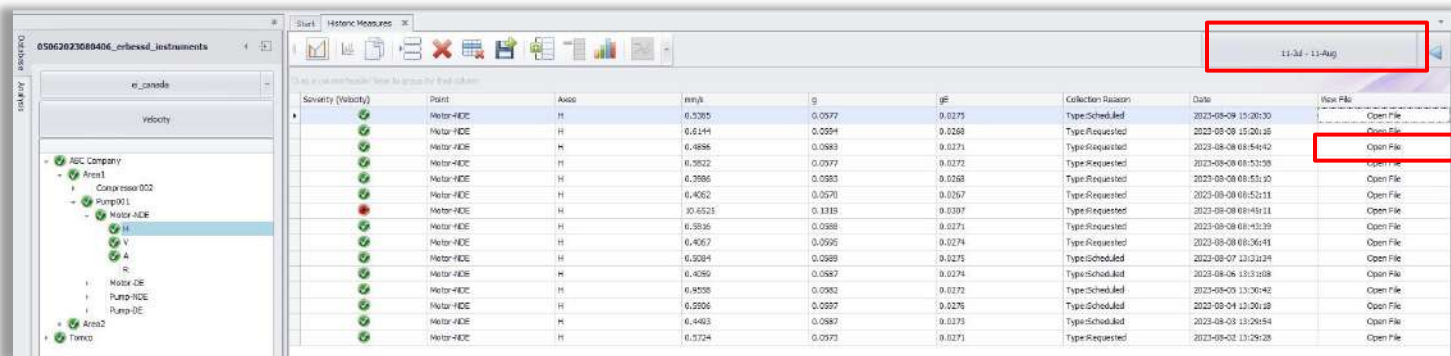



Check to ensure the time waveform and FFT are successfully rendered.

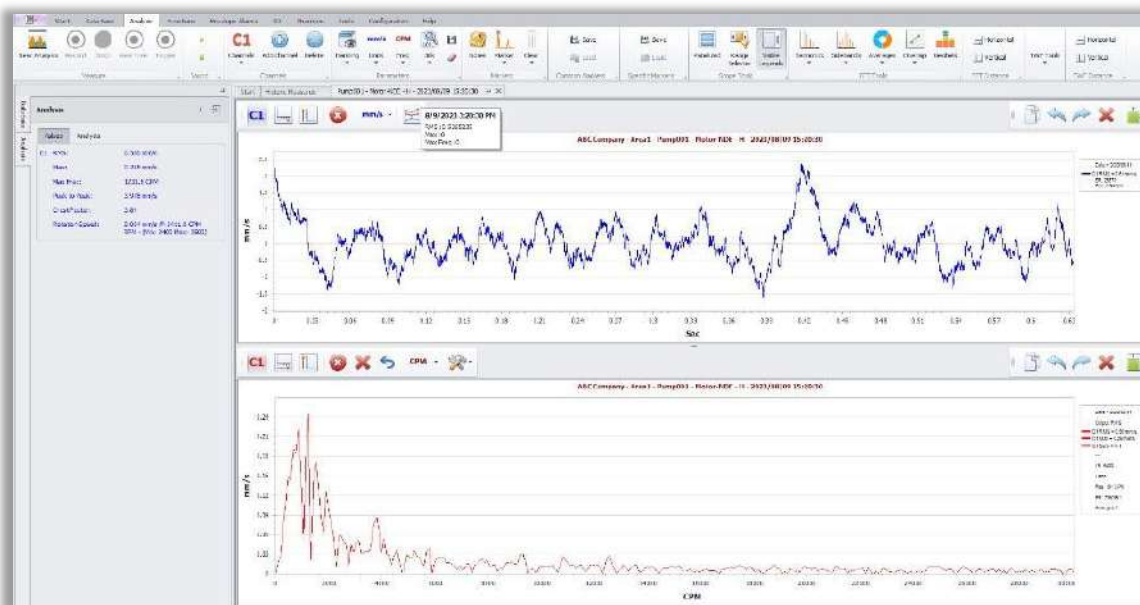

### Checking with EI-Analytic

To check a cloud database using EI-Analytic:

- Login to the Account and select the database of the tested sensor.
- Click **File Browser > Online File Browser** and drill down to the axis level of the database for the sensor being tested.

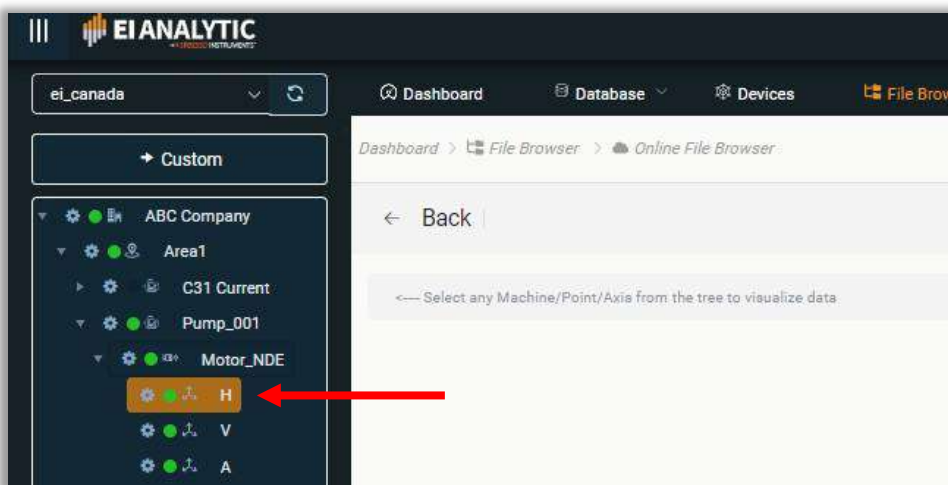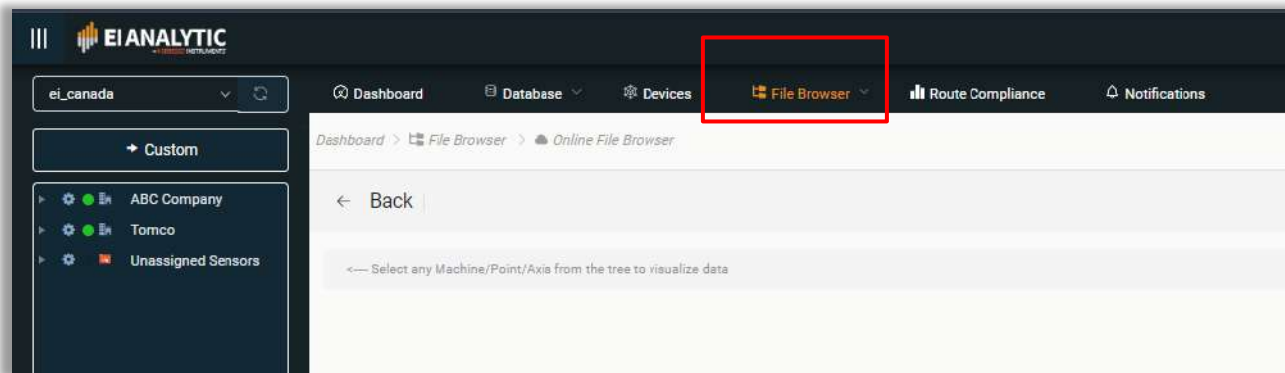


All files are listed by date, if received by the cloud database successfully. **Note** – there will be a small delay between the time the sensor creates the signal file and it appears in the cloud database.

Click on the **Open file** button to open a signal file time waveform and FFT:

The screenshot shows the 'Online File List' table. The table has columns for 'Date', 'Reason', 'Accel(g)', 'Vel(mm/s)', 'Acc Ft/m(s²)', and 'Actions'. A red arrow points to the 'Open File' button in the 'Actions' column of the first row.



Date	Reason	Accel(g)	Vel(mm/s)	Acc Ft/m(s²)	Actions
2025/07/16 13:30:38	⊙	0.206	2.04	0.09	Open File
2025/07/15 09:31:15	⊙	0.208	2.72	0.09	Open File
2025/07/15 05:30:57	⊙	0.21	1.92	0.09	Open File
2025/07/15 01:30:39	⊙	0.214	1.98	0.1	Open File
2025/07/14 09:30:39	⊙	0.199	1.95	0.09	Open File


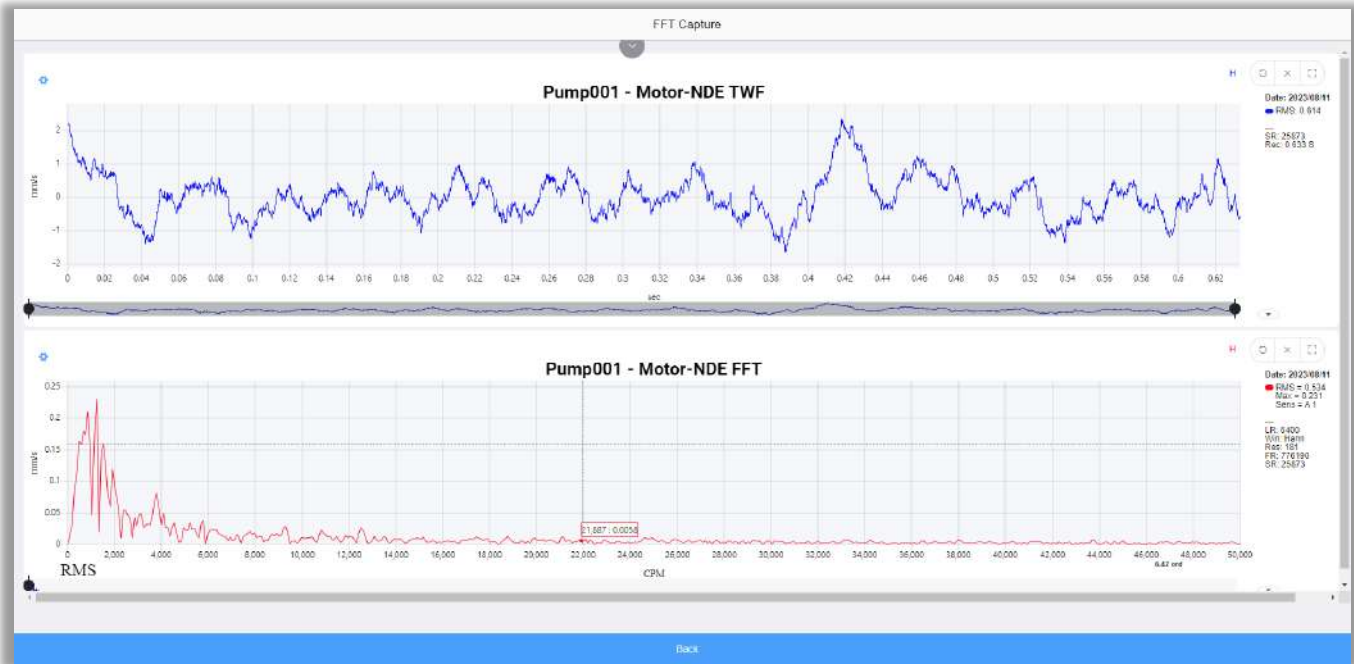


### Checking with the WiSER VIBE App

To check sensor status and database from the WiSER VIBE mobile App:



1. Open the App and login to your EI-Analytic account.
2. Open the **Online File Browser** from the main Menu, and open the axis level of the database for the sensor being tested.
3. Click on the file from the test download and the FFT Capture screen will open.

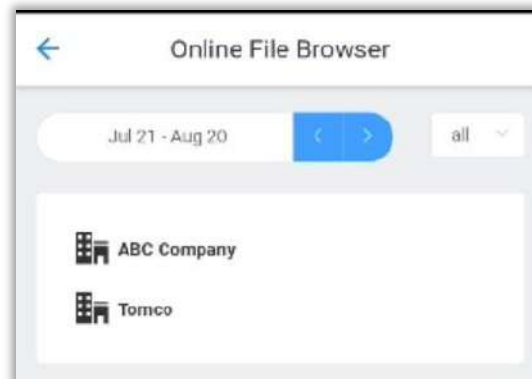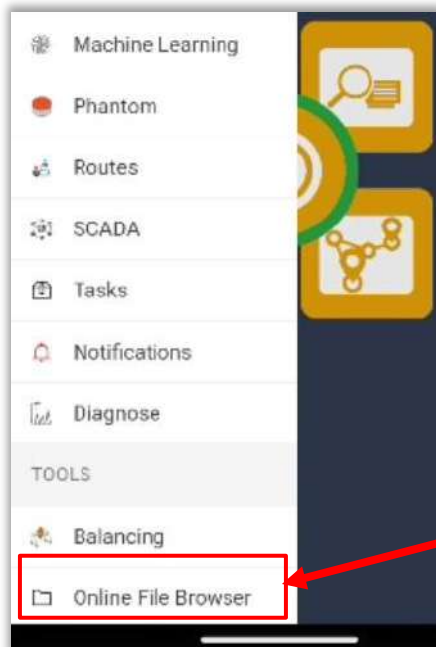

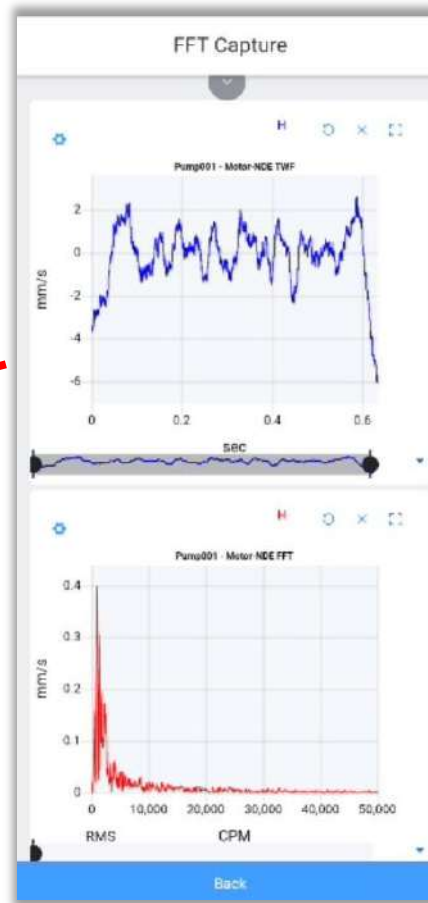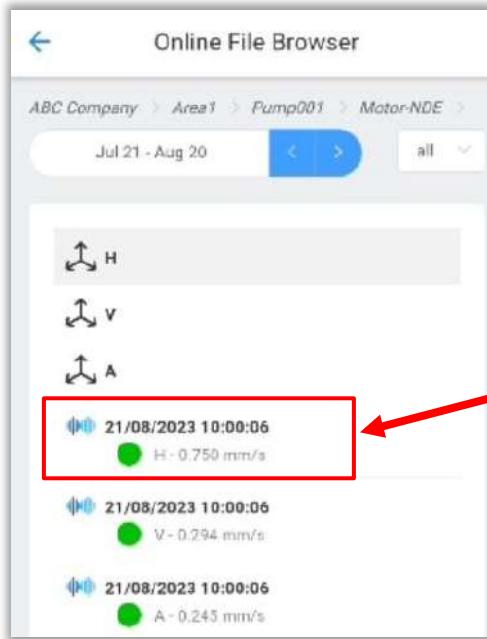


## USB Gateway Setup

1. Download the Zip file containing the Windows Gateway Utility software from the Erbesd-instruments website: <https://www.erbessd-instruments.com/usb-phantom-gateway/>
2. Plug the Gateway 2.0 PC into a USB port on the PC/tablet.
3. Extract and open the downloaded gateway-usb-utility.zip file.
4. Double-click on GWJSGUI.
5. Click **Install Windows Service** This will install and run the Windows Service software on the PC/tablet and start it when the computer boots. Once installed, the Install Window Service button will be greyed-out, and the Gateway may be accessed by simply using the <http://localhost> address in any web browser. The GWJSGUI does not need to be running.
6. Open the Gateway Admin Console using the <http://localhost> link.

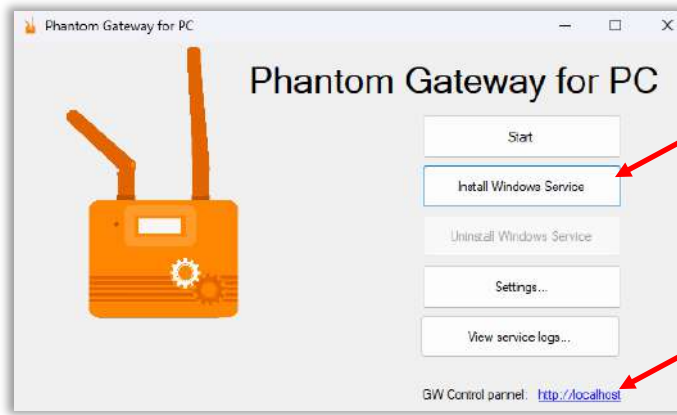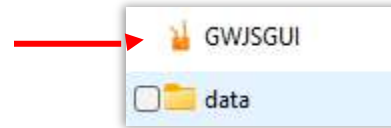


The initial Live State screen will be displayed, indicating a database destination has not been set.

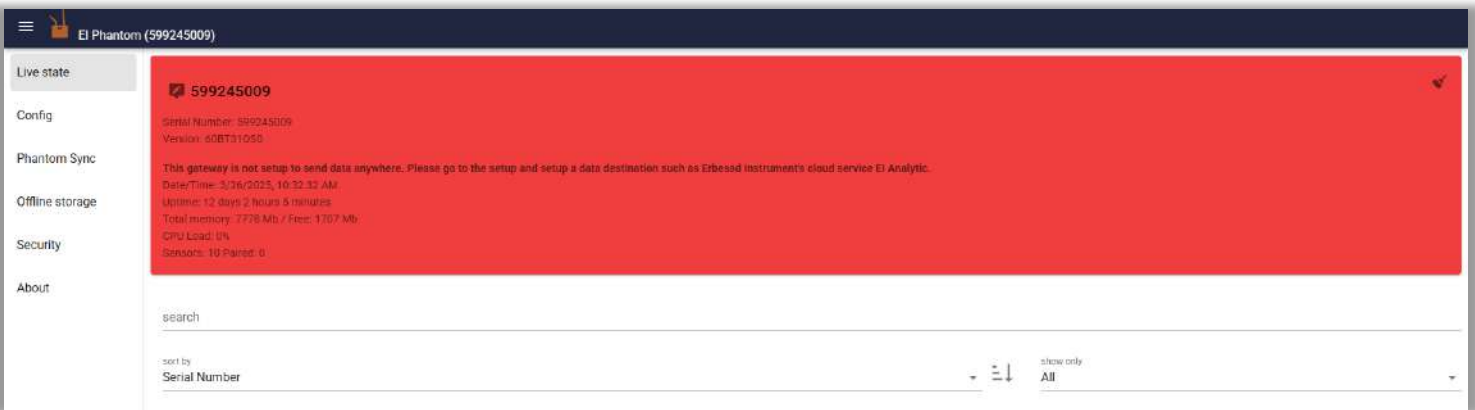


**Note** – there are NO network parameters to configure in the General Tab, since the Gateway uses the PC’s network connection. The gateway also uses the computer for time and time zone information.

Add and Register a gateway in EI-Analytic using its serial number.


1. Login to the EI-Analytic account at [www.eianalytic.com](http://www.eianalytic.com) and select the database that the gateway will be associated with.
2. Select **Gateway Manager** from the **Database** drop-down menu.
3. Click Gateway Manager again, then **Add Gateway**
4. Enter the gateway serial number .
5. Click **Add Gateway**.

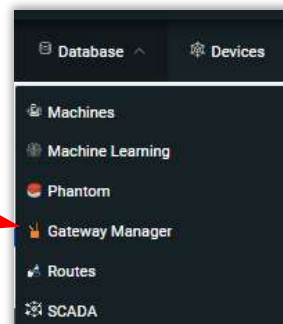

6. Once the gateway is registered, **copy** the **Auth Token** and **paste** it into the EI-Analytic screen on the USB gateway Admin Console.

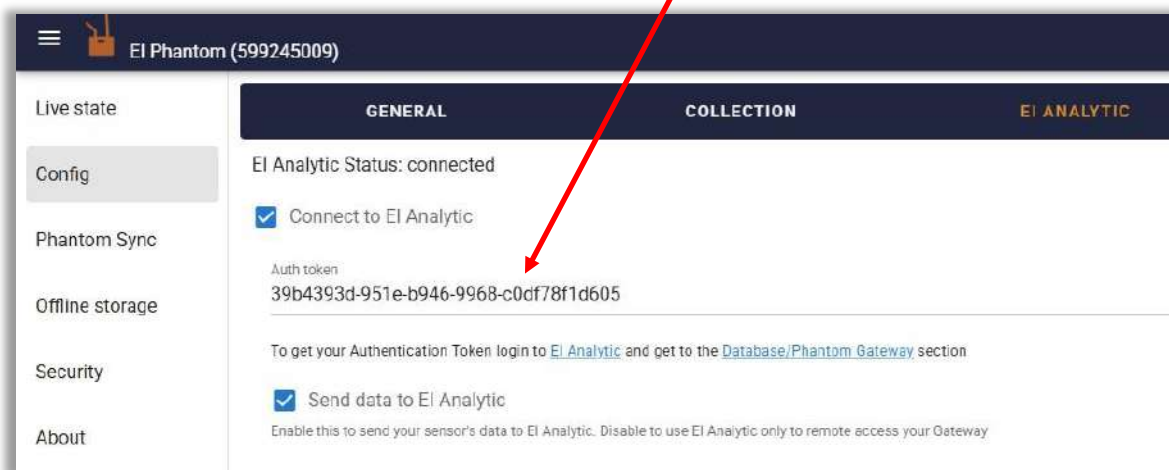

7. Ensure both **Connect to EI-Analytic** and **Send data to EI-Analytic** boxes are checked as shown.
8. Click on **Save** and the gateway will restart. Upon reboot it will start sending data to the EI-Analytic database.

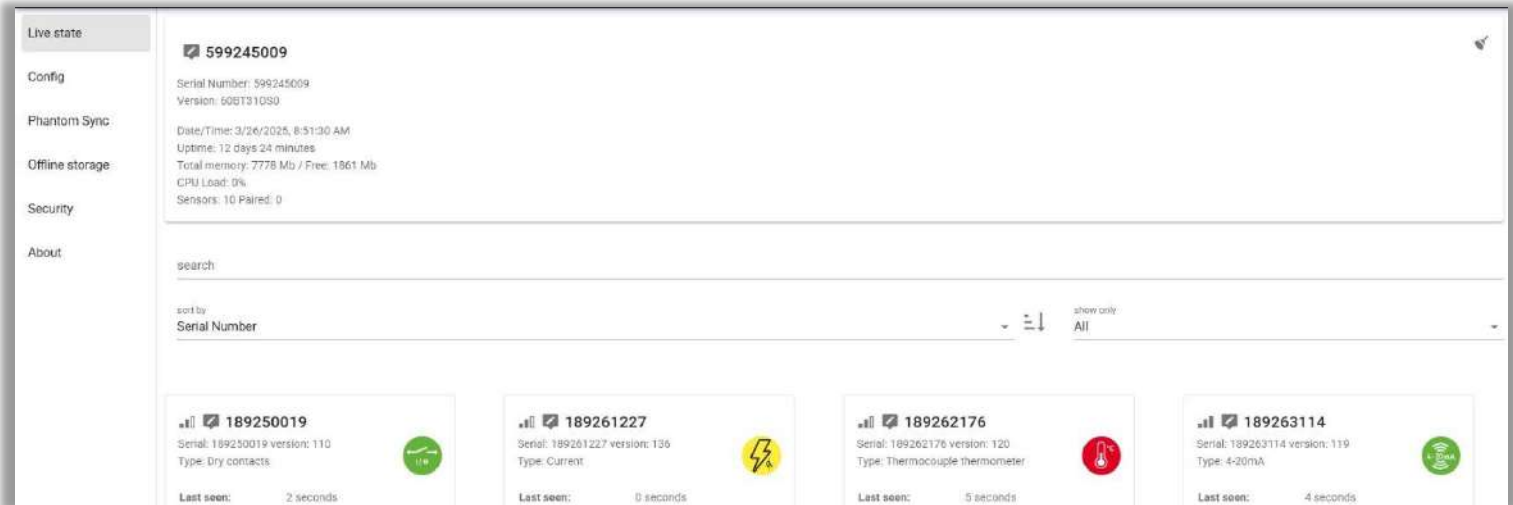

For details regarding Gateway and sensor features and settings, see the *Phantom Setup Guide V5 document*.

<https://www.erbessd-instruments.com/wp-content/uploads/2024/01/Phantom-Setup-Guide-v4-X.pdf>

## Updating Firmware

Download the latest firmware Zip file from the Erbessd website, e.g., <https://pfw.erbessd-instruments.com/gateway-usb-60.zip>

1. Extract and open the downloaded.zip file.
2. Double-click on GWJSGUI.
3. Click **Uninstall Windows Service**.
4. Click **Install Windows Service**.
5. Connect to the gateway using a web browser using the <http://localhost> link.

## Adding Phantom Specialty Sensors

### Adding an EPH-C31 Phantom Current sensor

The Erbesd EPH-C31 current sensor supports 4 channels up to 500 Amperes. Four types of current clamp are available -50A, 100A, 250A and 500A. (sold in sets of 3)

An insulated wire bundle may contain multiple individual lines of inrush current. Even if the bundle contains only 1 phase of inrush current, installing the clamp over an entire wire bundle, as seen in this picture, will result in inaccurate amperage draw measurement.





Current clamps must be installed on each individual current conductor, as shown in this picture.

Remove the Phantom current sensor base plate to connect the current clamp wires to the sensor. The current clamp wires should be fed through the cable glands and connected to the Pitch connector plug portion of the connector, which is removable for easier installation.


To add an EPH-C31 Phantom:

1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (31-189xxxxxx) and press **Next**.
3. Add the **Group** and assign a **Phantom Name**.and click **Next**.




4. Assign one or more of the 4 channels to Machines or Points and click **Next**. You also have the option of adding a new machine dedicated to this sensor by clicking the **Add Machine** button.
5. Select the **Clamps configuration** for each channel, either pre-set amperage or Custom Amps.

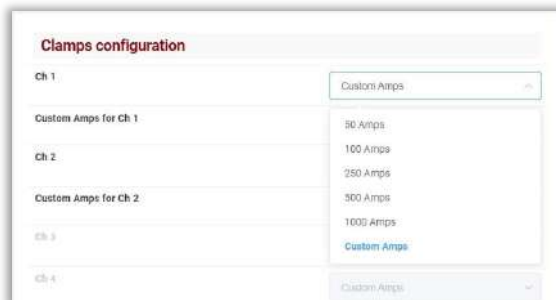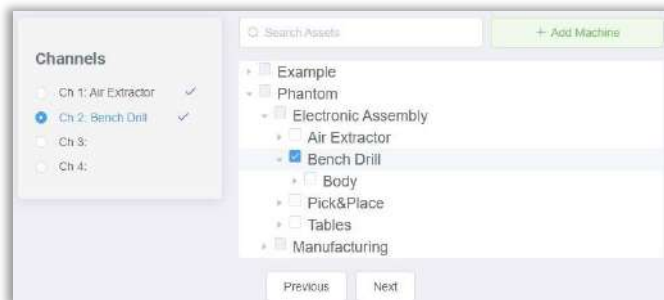

- Set any notification alarm thresholds and click **Next**.
- Click **Save Phantom** if the summary info is correct.

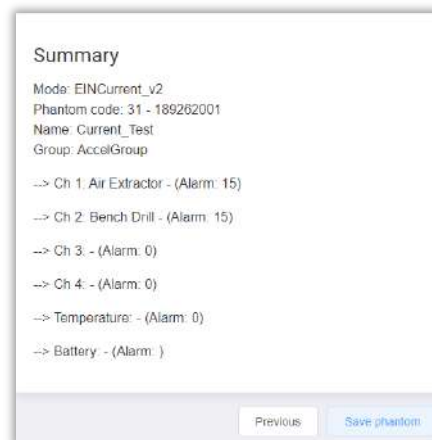

- Open the Gateway Admin Console and click on the **In sensor settings** for the sensor being added. Under **General**, set the **Max transfer power** setting at 0dbm (default) for Phantoms when using AA batteries. The **Sensor update interval** defines how often current measurements are sent to the gateway/database along with the internal sensor temperature and battery voltage level. **Note** - The Amperage reading for each channel is updated to the gateway by default **every 5 seconds** for triggering applications. The range is 10 to 86400 seconds (1 day). **Note** - this setting has a direct impact on battery life. This sensor can also be powered locally with hardwired 5-24VDC.
- Check the **Current Sensor settings** to ensure the **probe types** are the same as was entered in Phantom Manager when configuring the sensor.

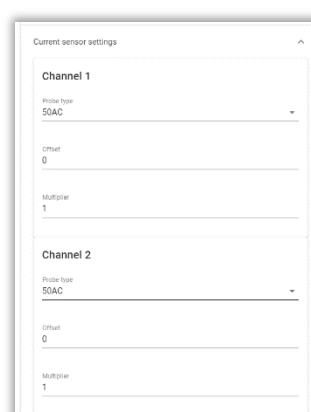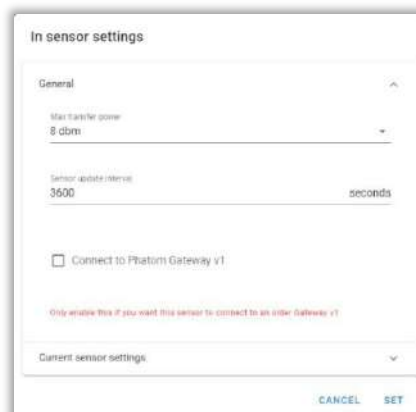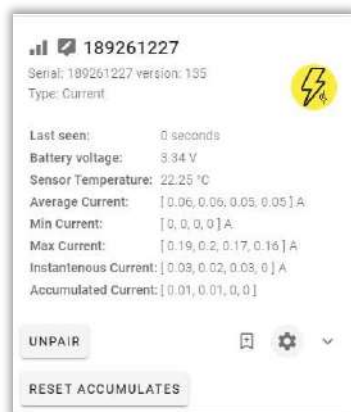

For an EPH-C31, the sensor status displays both the **Instantaneous Current** and **Accumulated Current** values, updated every 5 seconds. The Accumulated Current values can be reset on-demand.

## Adding an EPH-T20 or T25 Phantom Temperature Sensor

Erbessd offers two types of Phantom temperature sensor, the EPH-T20 is a non-contact spot infrared sensor, and the EPH-T25 supports K type thermocouples and has 3 channels.



EPH-T25





K-Type Thermocouple

EPH-T25 Thermocouple Phantoms may be mounted at the full extension of the thermocouple wire away from the monitored area. The thermocouple is installed in the monitored component. Wires are connected to the sensor module Pitch connectors.


To add a Temperature Phantom:

1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (20-189xxxxxx or 25-189xxxxxx) and press **Next**.
3. Add the Group and assign a Name. Click **Next**.
4. Assign the channel(s) to Machines or Points (or create a new machine).
5. Set an optional alarm threshold(s) for the sensor.
6. Click **Save Phantom** if the summary info is correct.

- Open the Gateway Admin Console and click on the **In sensor settings** for the temperature sensor being added. Set the **Sensor update interval** as desired. The measured temperature from the infrared sensor or thermocouple for each channel is sent, along with the internal sensor temperature and battery voltage at this interval. The range is 10 to 86400 seconds(1 day). **Note-** this setting has a direct impact on battery life. It is recommended to keep the Update interval at 3600 sec (1 hr) or higher and the **Max transfer power** setting at 0dBm (default) for Phantoms that use AA batteries. The T25 sensor can also be powered locally with hardwired 5-24VDC. Press the **SET** button to save any changes.

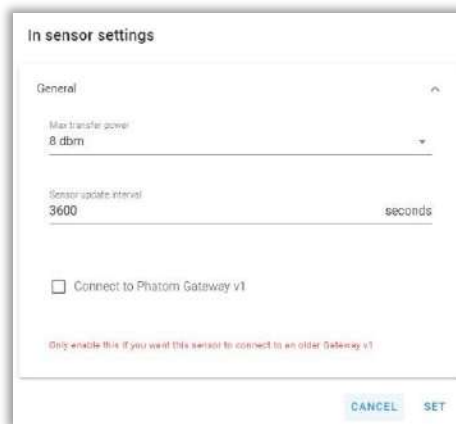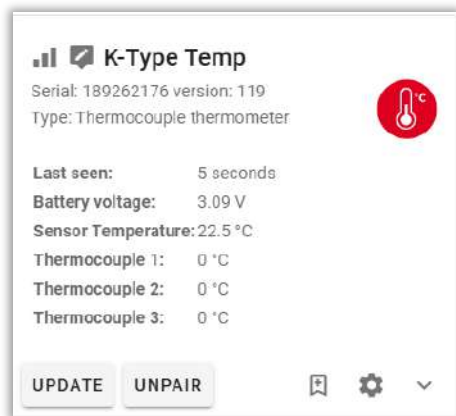

The EPH-T20 Non-contact Temperature Phantom has an effective range of 1 to 10 cm.

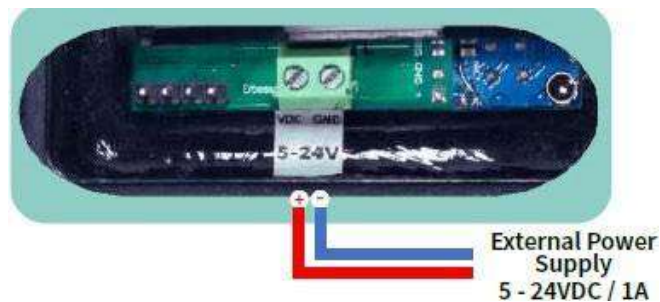

The EPH-T20 sensor can set the **emissivity** from the Gateway Admin Console.

Enter a value between 0.1 and 1.0, depending on the type of material to be measured.

**In sensor settings**

General ∨

Infrared Thermometer ∧

Emissivity

0.8 ↕

CANCEL SET


Material	Emissivity
Polished silver	0.02
Polished copper	0.03
Polished gold	0.03
Aluminum foil	0.07
Wood	0.85
Asphalt pavement	0.9
White paint	0.9
Vegetation	0.94
White paper	0.94
Water	0.95
Black paint	0.98

### Adding an EPH-S40 Phantom Speed Sensor

The RPM Phantom is optimized for use with a Hall effect sensor. Its case design enables screw or adhesive mounting and is capable of switching up to 28Vdc and 20mA.


**IMPORTANT:** To correctly install the Phantom Speed Sensor:


- It is recommended to use epoxy to affix the magnet.
- The receptor must be fixed 1/3 in (1 cm) from the magnet. The best way to read the signal is to focus the sensor directly over the magnet.
- Hall-effect sensor wires are connected to the sensor module bus bar. The base of the sensor is secured by 1.3mm hex-head machine screws.

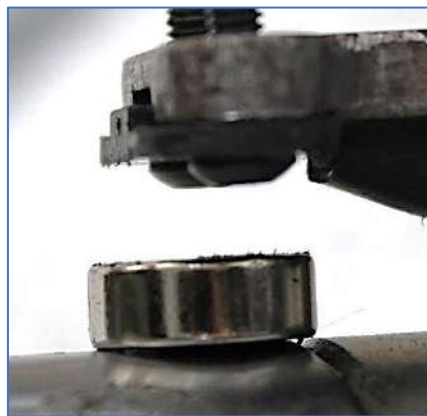



To add a Speed Phantom:

1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (40-189xxxxxx). Press **Next**.
3. Add the Group and assign a Name; click **Next**.
4. The Speed sensor has only one channel. Assign Channel 1 to a Machine or Point and click **Next**.
5. Set the alarm threshold, if desired, to receive notification if the RPM exceeds this limit, and click **Next**.
6. Click **Save Phantom** if the summary info is correct.

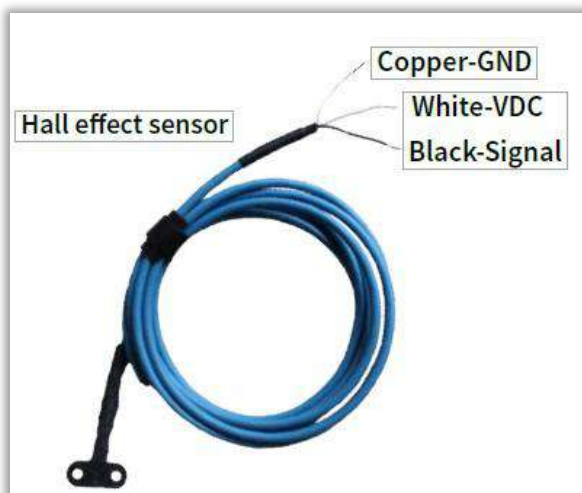

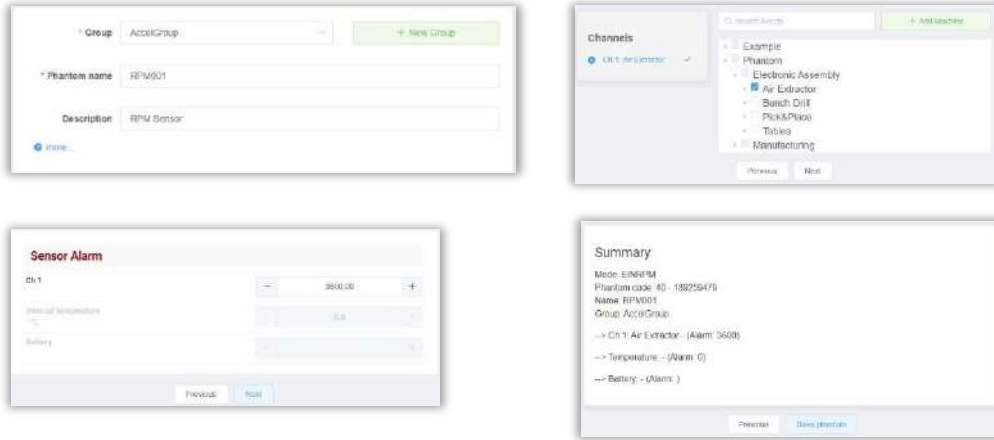



7. Open the Gateway Admin Console and click the **In sensor settings** for the sensor being added.
8. Set the **Sensor Update interval** in the **General** section as required. The RPM reading is sent, along with the internal sensor temperature and battery voltage at this interval. The range is 10 to 86400 seconds (1 day). **Note**- this setting has a direct impact on battery life. It is recommended to use hardwired 5-24VDC power if the desired Update interval is less than 3600 sec (1 hr).
9. Set the **Max transfer power** setting at 0dBm (default) if using AA batteries unless signal strength is low, then increase to 8dBm.
10. In the **RPM** section, there is an option to set **Continuous mode** for speed sensors that have hardwired 5-24VDC power. The **Timeout** defaults to 1 second to preserve battery life.
11. Press the **SET** button. To make any changes.

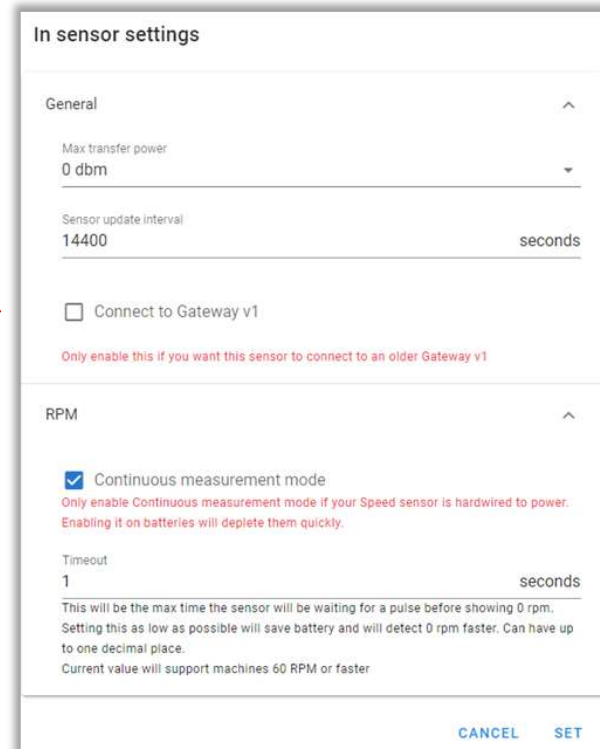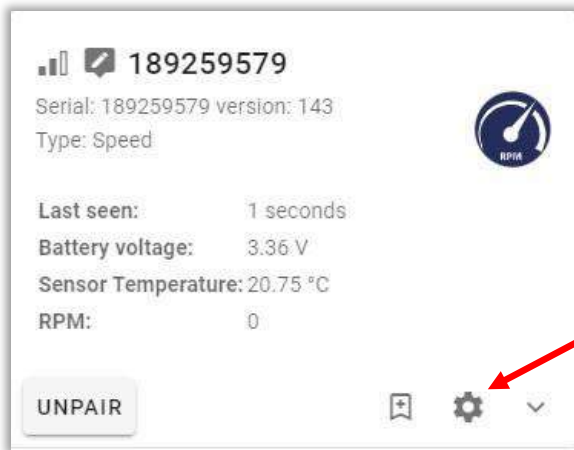

## Speed Sensor Link

The Speed Sensor Link feature allows the RPM from a Phantom S40 speed sensor to be sent to the database synchronous with vibration data from any V10/V11 Phantom connected to the same Gateway network.


This feature should only be used when the S40 is set to **Continuous** mode (must be powered locally).

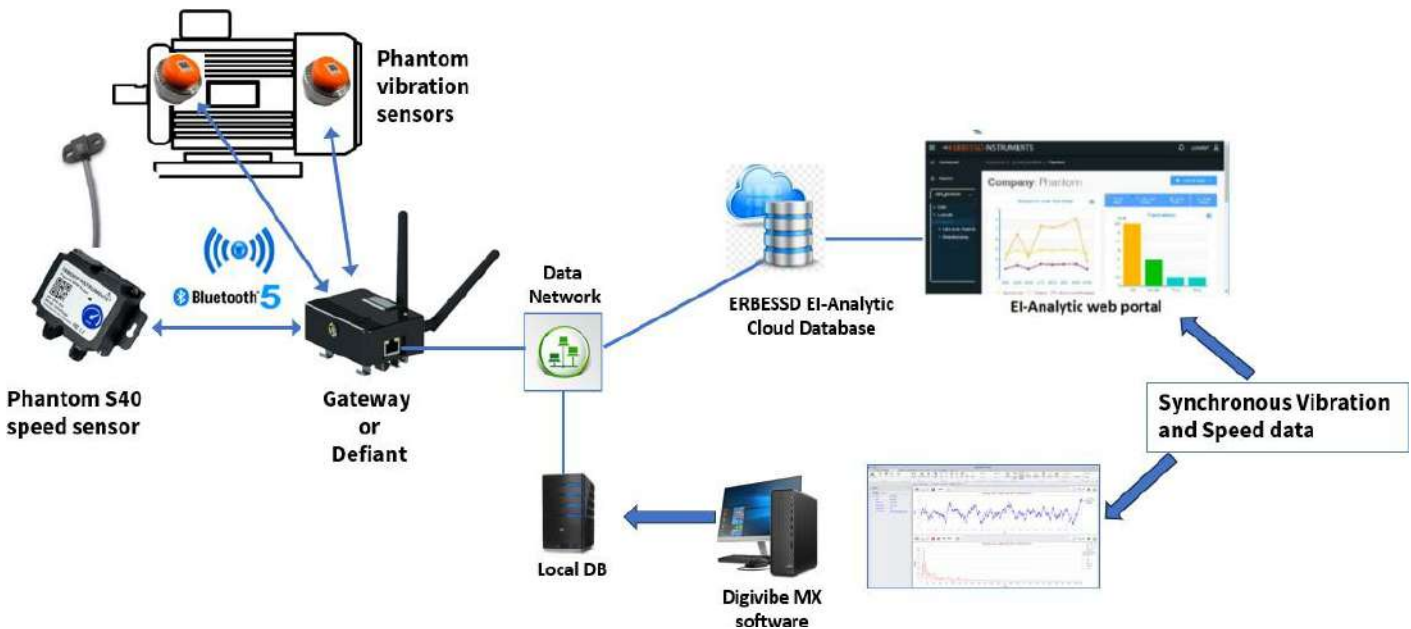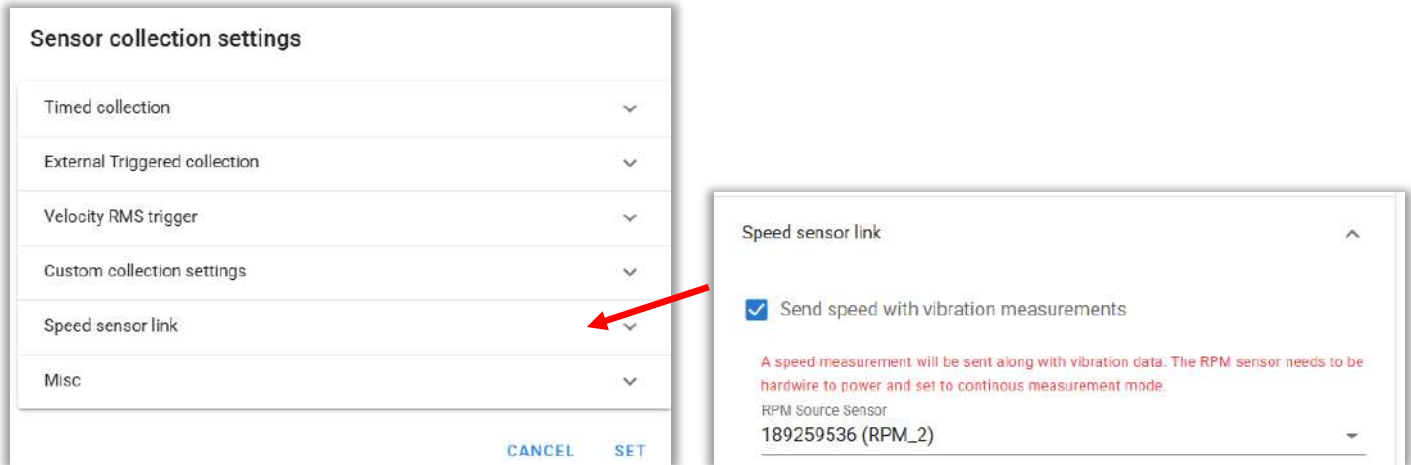


### Adding an EPH-T70 Phantom Thermographic Camera

The Erbessd Phantom thermographic camera has a 32 by 24 pixel infrared sensor array with a 110 degree high by 75 degree wide field of view. It is intended for use with objects/targets at a distance of 1 meter (approx 39 in.) or less.


1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (70-189xxxxxx). Click **Next**.

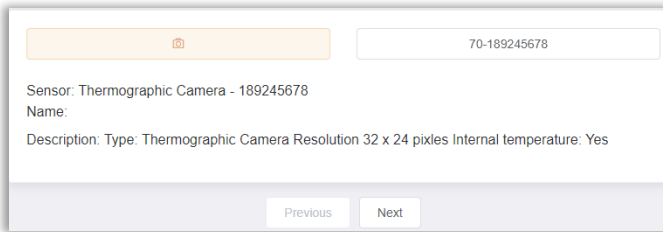

3. Add the Group and assign a Name. Click **Next**.

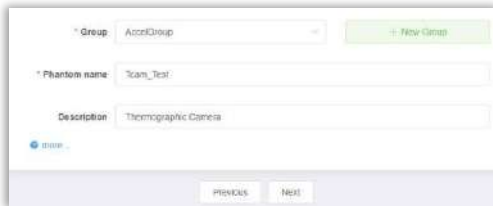


4. Assign Channel 1 to a Machine or Point. Click **Next**.

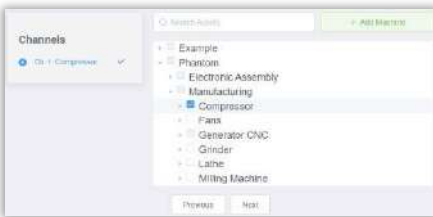


5. Set Alarm threshold, if desired.




6. Press **Save Phantom** if the summary is OK.

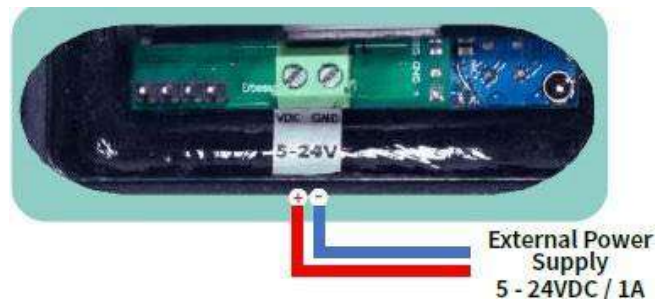

- Open the Gateway Admin Console and click the **collection settings** for the thermographic camera being added. Set the **Timed collection** interval as desired, using the Global or a custom setting.

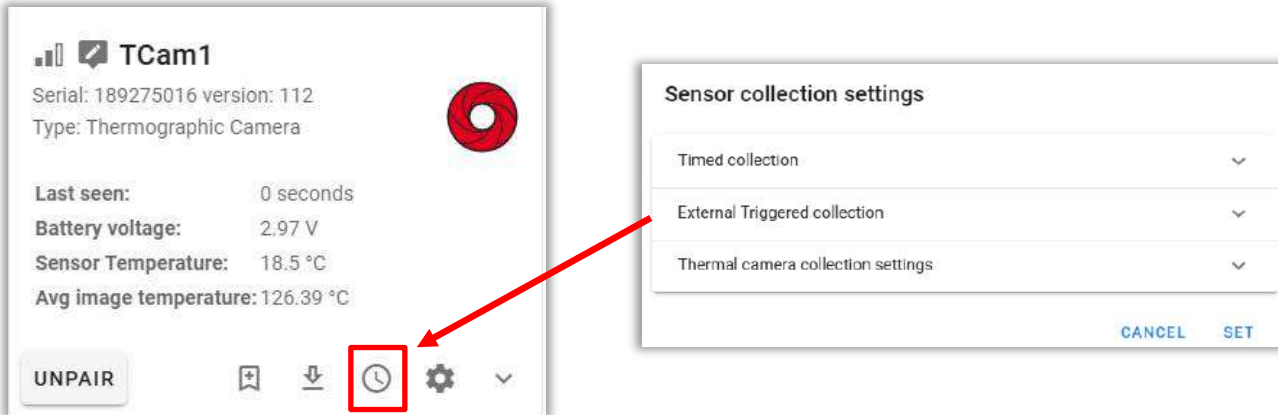

- Open the **Thermal camera settings** and set the **emissivity** and number of **Frames** from 1 to 16.

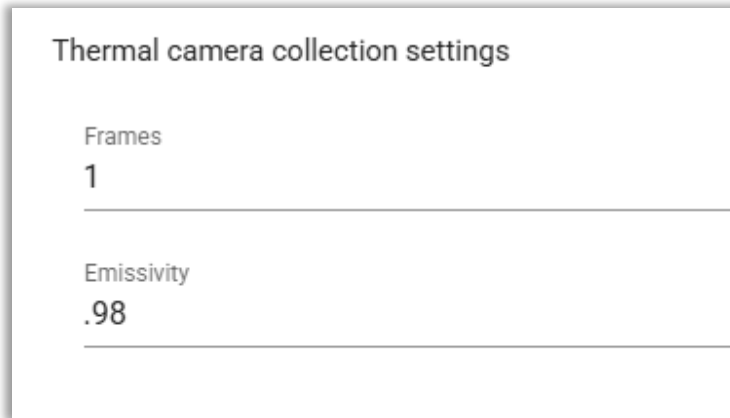



Material	Emissivity
Polished silver	0.02
Polished copper	0.03
Polished gold	0.03
Aluminum foil	0.07
Wood	0.85
Asphalt pavement	0.9
White paint	0.9
Vegetation	0.94
White paper	0.94
Water	0.95
Black paint	0.98

- Set the Sensor Update interval in the in-sensor settings; the internal sensor temperature and battery voltage are updated to the gateway at this interval. It is recommended to keep the update interval at 3600 sec (1 hr) or higher and the **Max transfer power** setting at 0dBm (default) for Phantoms that use AA batteries. Press the **SET** button to save any changes.


## Viewing Thermal Camera Images in DigivibeMX

The thermographic image files are viewable with DigivibeMX software.

1. Open the database and select the machine or point to which the thermal camera is assigned in the data tree.
2. Click on **Extra Parameters**, then press the **Choose parameter** button.

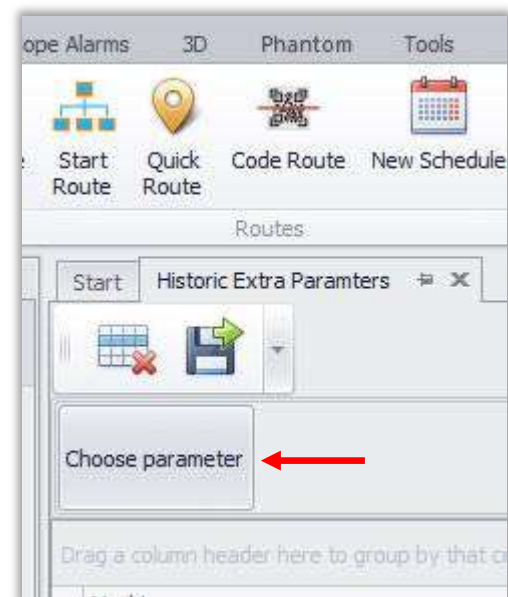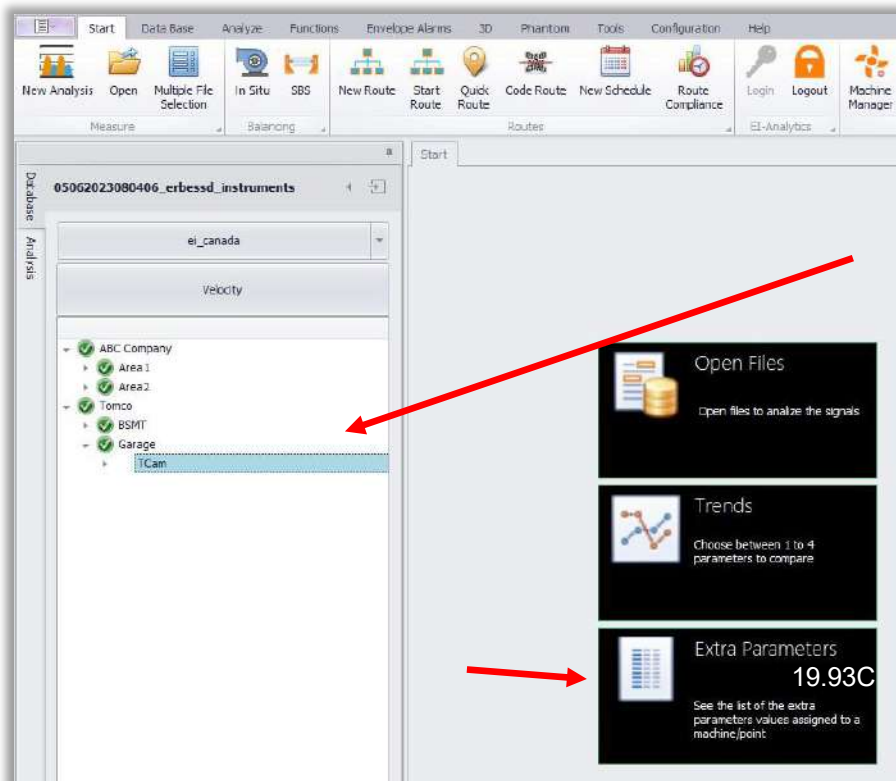

3. Select Thermal Camera.

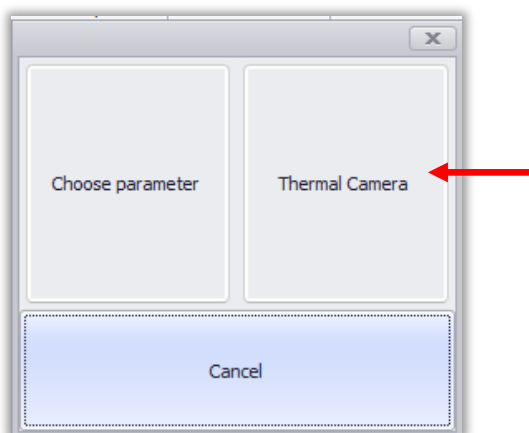


4. Click **Open Image** to view an image file for analysis.

Machine	Value	Unit	Date	Open Image
TCam	22.66	Thermal Camera	2023-08-20 22:32:53	<a href="#">Open Image</a>
TCam	22.63	Thermal Camera	2023-08-20 22:24:17	<a href="#">Open Image</a>
TCam	22.37	Thermal Camera	2023-08-19 22:24:06	<a href="#">Open Image</a>
TCam	22.35	Thermal Camera	2023-08-18 22:23:54	<a href="#">Open Image</a>


If you have set more than one frame to capture, you may scroll through or Play them using the control buttons.

When the mouse pointer is hovered over any part of the image, the temperature for that pixel is displayed.

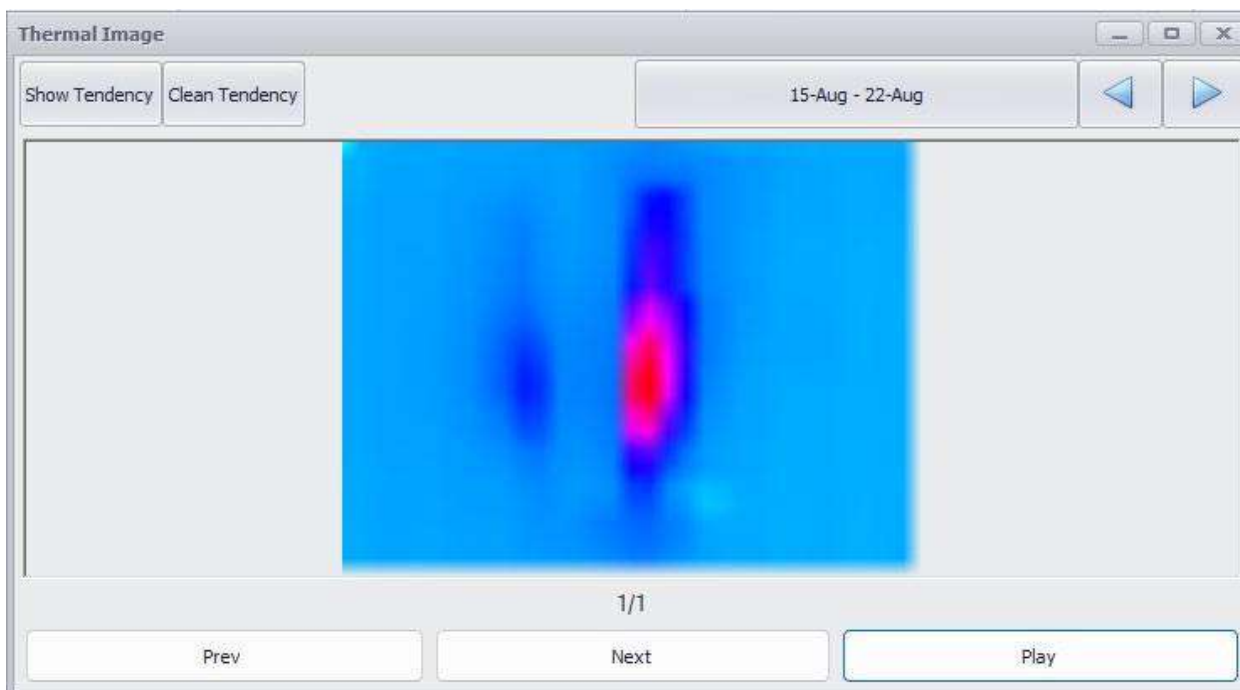

## Viewing Thermal Camera Images in EI-Analytic

Right mouse click on the Machine or Point to which the Phantom thermographic camera is assigned in the Data Tree of EI-Analytic.

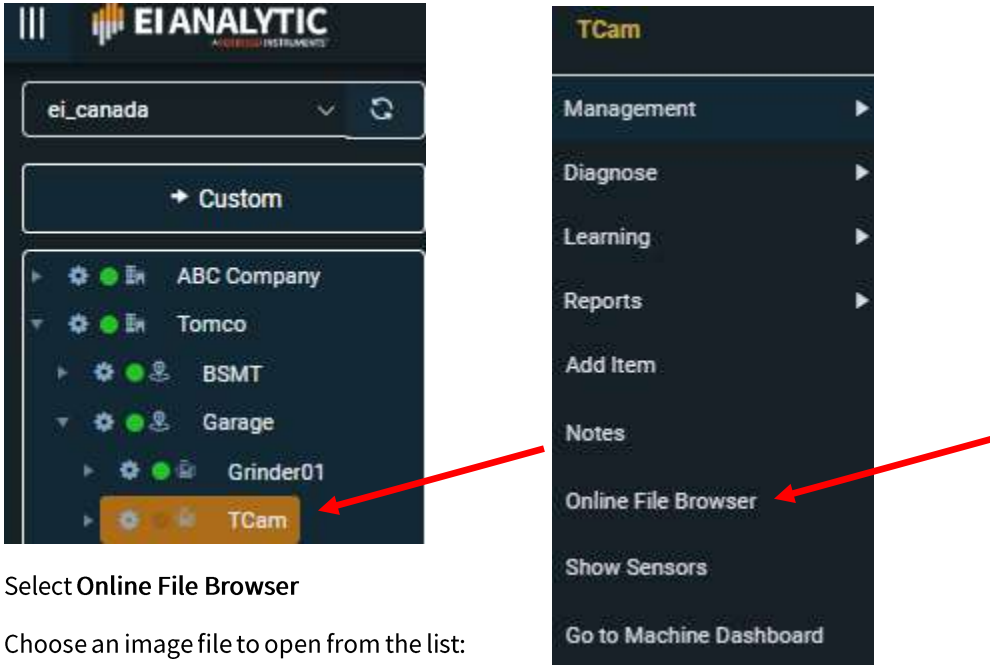


Select Online File Browser

Choose an image file to open from the list:


Date	Point	Reason	Temp(Avg °C)	Temp(Min °C)	Temp(Max °C)	Actions
2025/07/16 08:14:51			23.32	17.88	29.09	Show data (Thermal)
2025/07/15 08:14:40			22.4	17.27	28.06	Show data (Thermal)
2025/07/14 08:14:30			23.23	18.77	28.3	Show data (Thermal)
2025/07/11 13:33:55			24.18	19.12	29.07	Show data (Thermal)
2025/07/10 13:33:44			24.29	18.91	29.11	Show data (Thermal)

This example T70 camera capture shows the 24 by 32 pixel array:

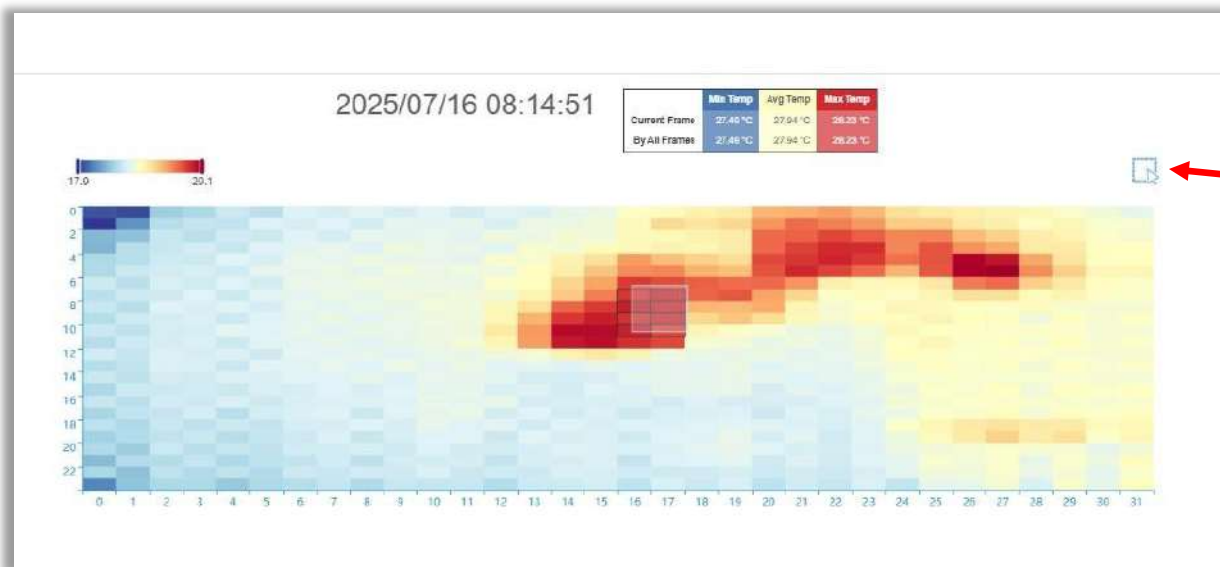

Hover a pointer anywhere on the graph to see the temperature of that pixel.

Click the **Activate Selection** button, then select an area to see the Trends for those pixels and a summary chart.

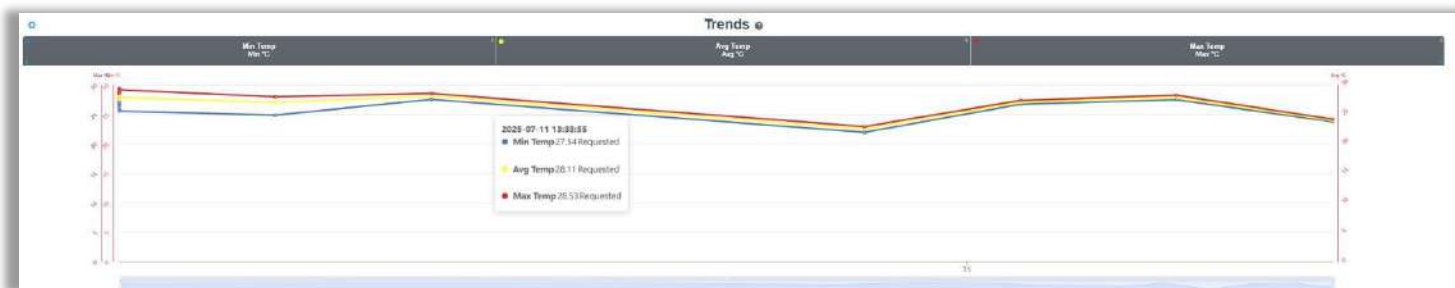

## Adding General Purpose Phantom Sensors

When adding a Phantom General Purpose Input/Output (GPIO) sensor, the first two digits of the serial number entered in Phantom Manager will determine the subsequent fields presented for configuration.

General Purpose Phantoms include:

Sensor Type	Interface	Channels
EPH-G60	2 V peak-to-peak sensor	2
EPH-G61	4-20 mA sensor	4
EPH-G62	Dry Contact	4
EPH-G63	0-10 Volt sensor	4



## Adding an EPH-G60 2VPP Phantom sensor

The EPH-G60 Phantom is 2-channel device, compatible with any 2 volt peak-to-peak sensor, to make it wireless.




To add an EPH-G60:


1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (60-189xxxxxx). Click **Next**.
3. Add the Group and assign a Name. **Note** - Disregard the warning that the data sending interval is not configurable! When used with a Gateway 2.0, the **Sensor Update** interval defines when data is sent (administered from the Gateway Admin Console), see below.
4. The **Alarm Check** interval **\*\*NOTE-** This field only applies to sensors used with a Gateway v1. This is the time between alarm checks performed by the sensor. It can be set from 30 to 120 seconds. For Gateway 2.0, the **Sensor Update** interval serves as the Alarm Check interval. Click **Next** to continue.

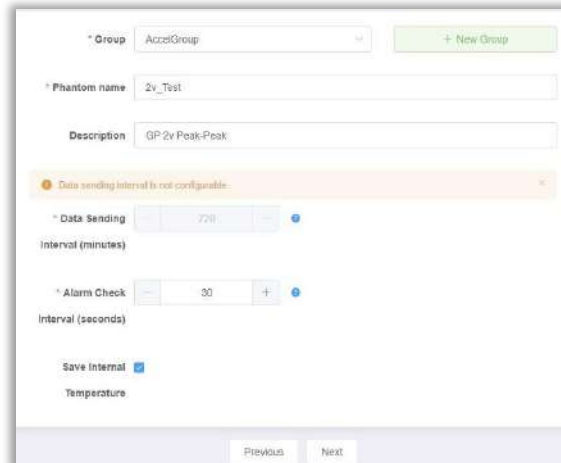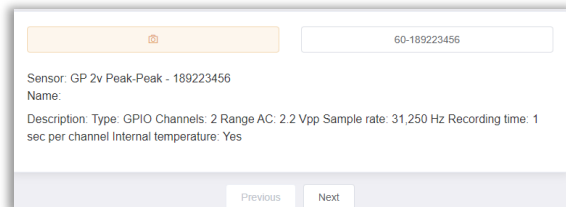

5. Assign the channel(s) to a Machine or Point and press **Next**.

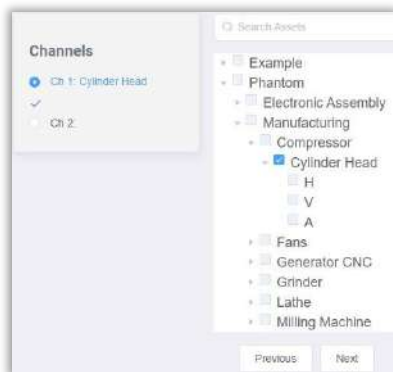

6. Set the Axis configuration for the channel 1 and 2 sensors.

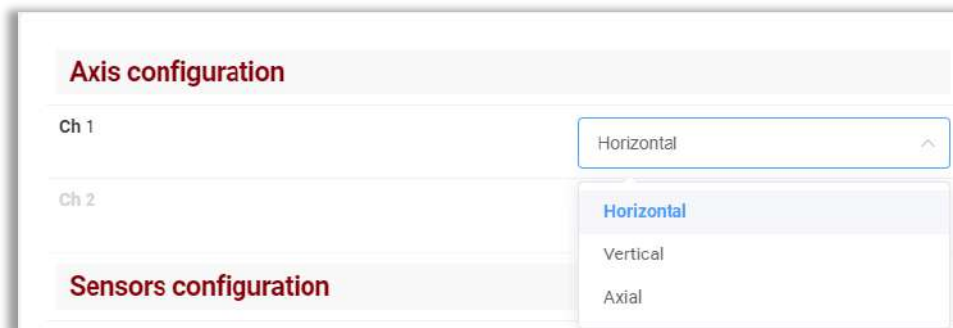


7. Set the Sensor config.

8. Set the sensitivity of the monitored sensor.


9. Set an optional Alarm threshold and press **Next**.

10. Click **Save Phantom** if the info summary is correct.

- Open the Gateway Admin Console and click the **collection** settings for the sensor being added. Set the interval or time-of-day or use the Global data collection setting and press **SET**.

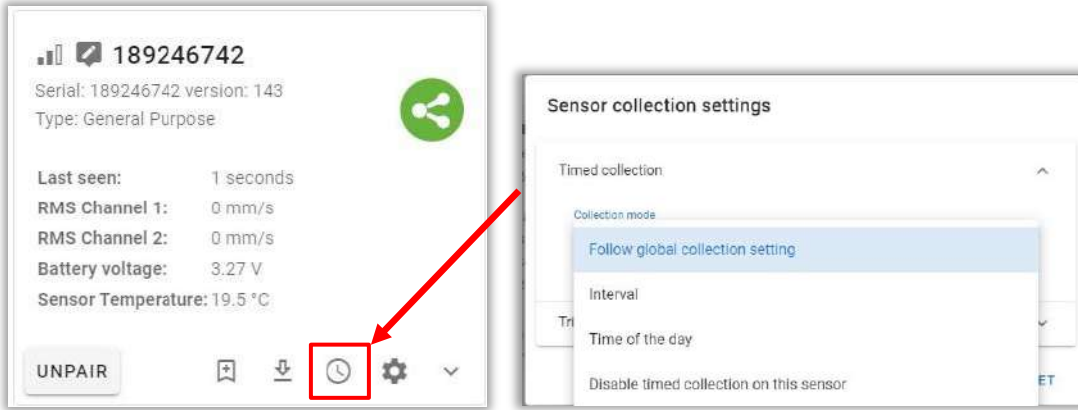

- Set the **Sensor Update Interval** in the **General** section of the **In sensor settings** and the high/low RMS frequency settings in the **General Purpose** section.

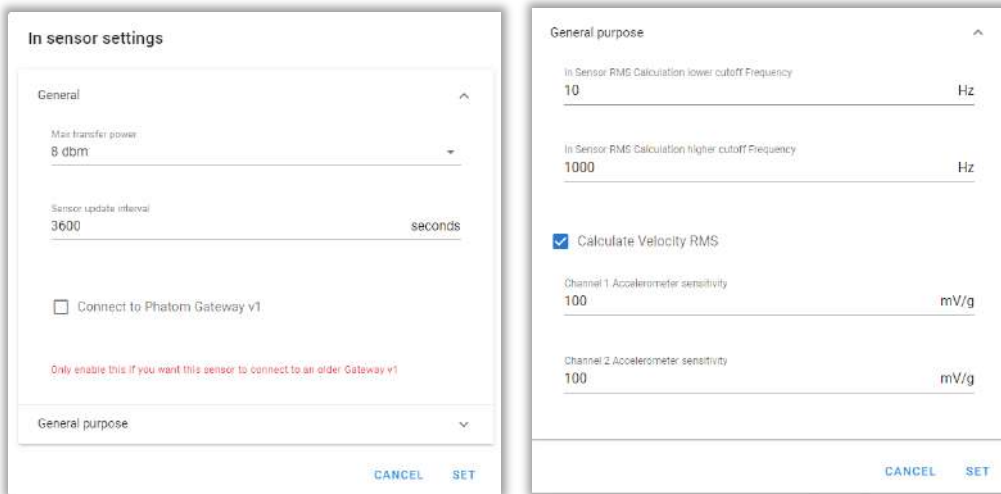

- Click **SET** to save any changes.

## Adding an EPH-G61 (4-20 mA) Phantom sensor

Any sensor with a 4-20mA constant current output range is compatible with this General Purpose Phantom sensor. Note – the EPH-G61 does not provide the loop current for the channels connected for monitoring.




In this example, a 4-20 mA Phantom sensor is used to interface with an oil condition monitoring sensor, making it wireless. This device outputs a variable current related to the measured oil condition (called the OC number), which ranges from 1 to 100. Oil with an OC number under 50 is acceptable, but if it reaches 75, an alarm notification should be sent.

To add the Phantom:


1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (61-189xxxxxx) and click **Next**.
3. Add the Group and assign a Name and click **Next**.


4. Assign one or more channels to Machines or Points and click **Next**.

5. Click the **Add Sensor** button.

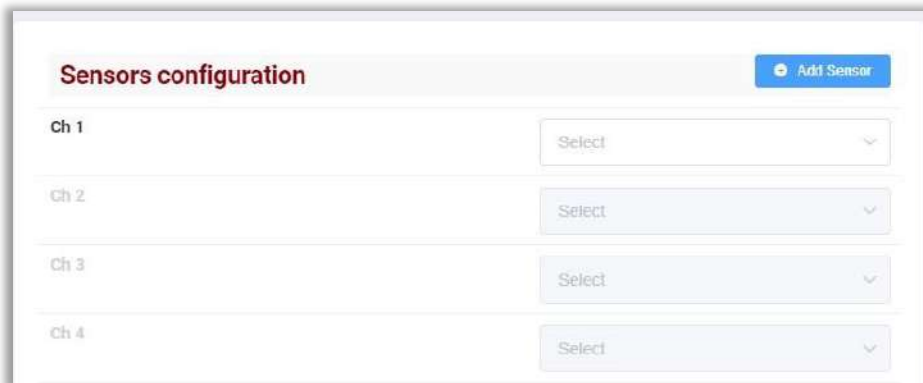



6. The 4-20mA Module screen opens containing several panels for a 4-20 mA sensor:

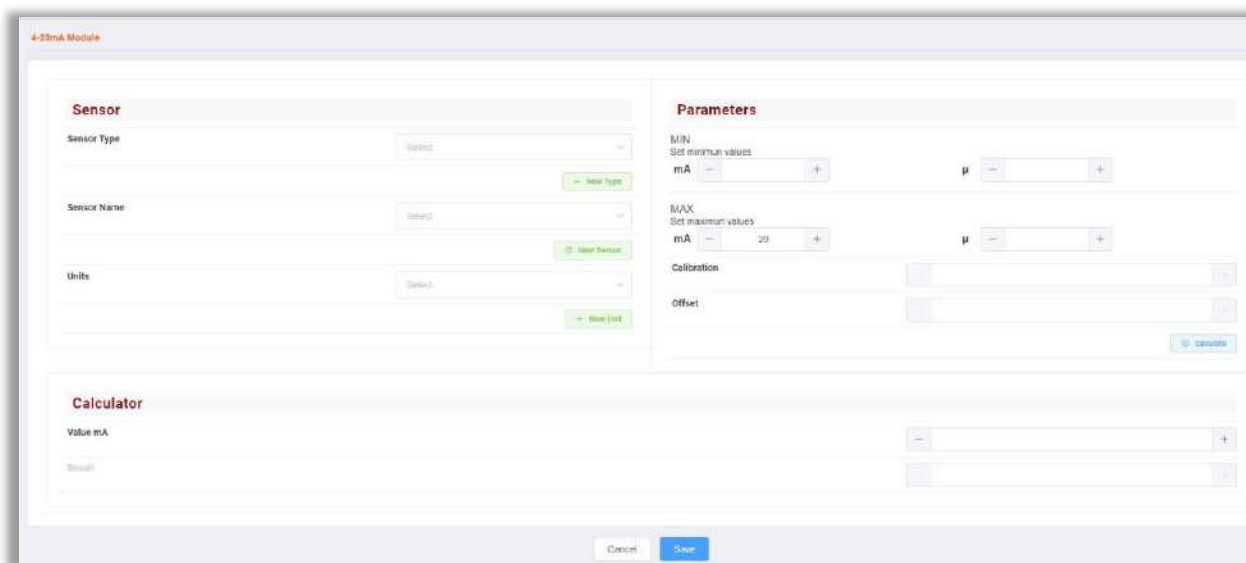


7. In the **Sensor** panel click on the  button to choose what type of sensor you are using.


8. Then add a **sensor name** using 


9. Add the **units** of the value you want to measure from the drop-down box. If the unit does not exist, you can add it with the

 button. This opens another screen to enter the relevant information. In this example, the OC number is added. Press  to save your settings.

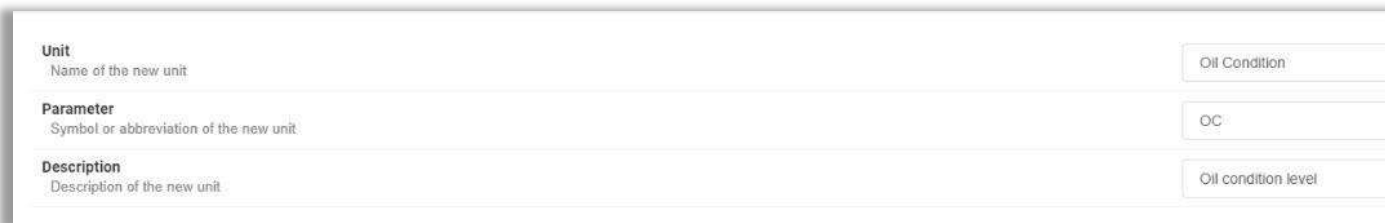


10. In the **Parameters** Panel, set the **MIN** and **MAX** values (1 to 100 for this example).

Based on the MIN/MAX values, software calculates the **Calibration** and **Offset**. These characteristics have the multiplicative function for each mA introduced to the sensor (Calibration) and as the initial reference point considered 0 for the measurable values (Offset). These values are automatically populated by the program when you click on the  button. Press **Save** to complete.

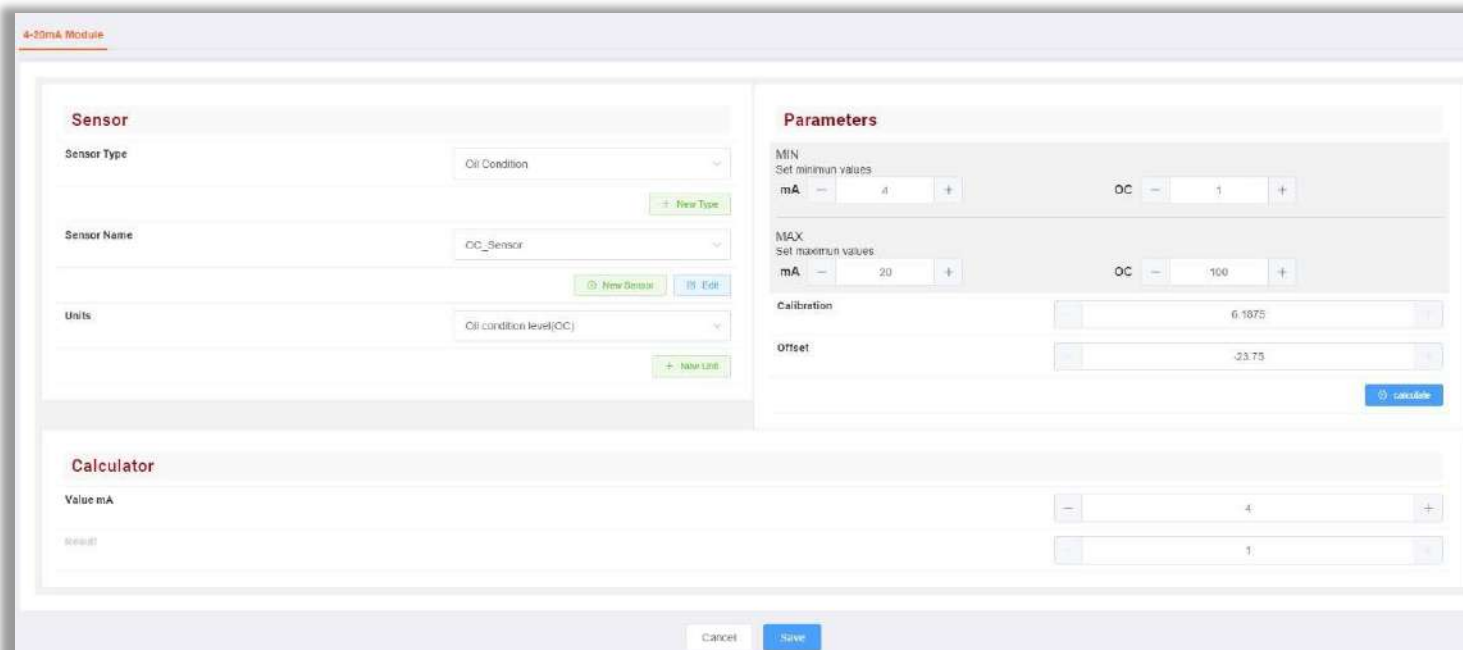

11. You can now set the channel assignment from the drop-down box, and the optional alarm threshold, then click **Next**.


**Note** – If the oil condition sensor outputs another parameter such as temperature on a separate 4-20mA circuit, you can assign it to a separate channel. Click Add Sensor and create New Type, New Sensor and New units for temperature, then assign to a channel.

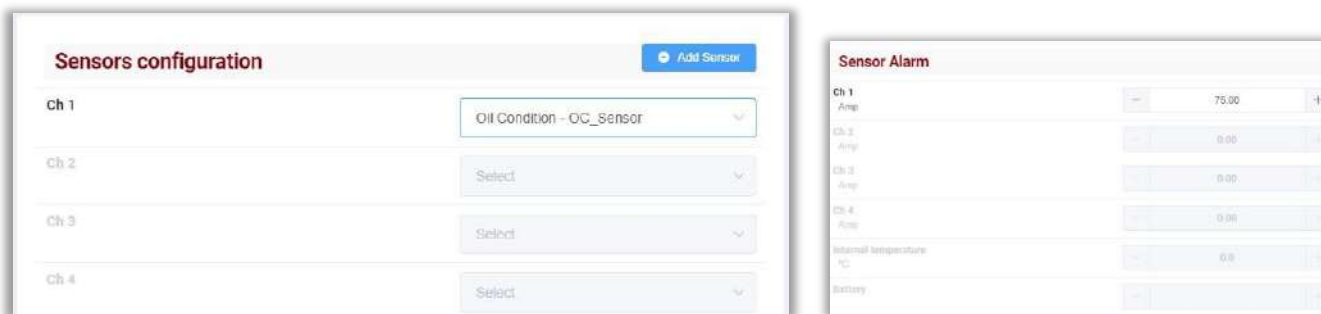

12. Click **Save Phantom** if the info summary is correct.



Open the Gateway Admin Console and click the **in sensor settings** for the sensor being added. Set the **Sensor Update interval** in the **General** section as required. The internal sensor temperature and battery voltage info is sent at this interval. The range is 10 to 86400 seconds (1 day). **Note**- this setting has a direct impact on battery life. It is recommended to keep the Update interval at 3600 sec (1 hr) or higher and the **Max transfer power** setting at 0dbm (default) for Phantoms that use AA batteries. Press **SET** to save any changes.

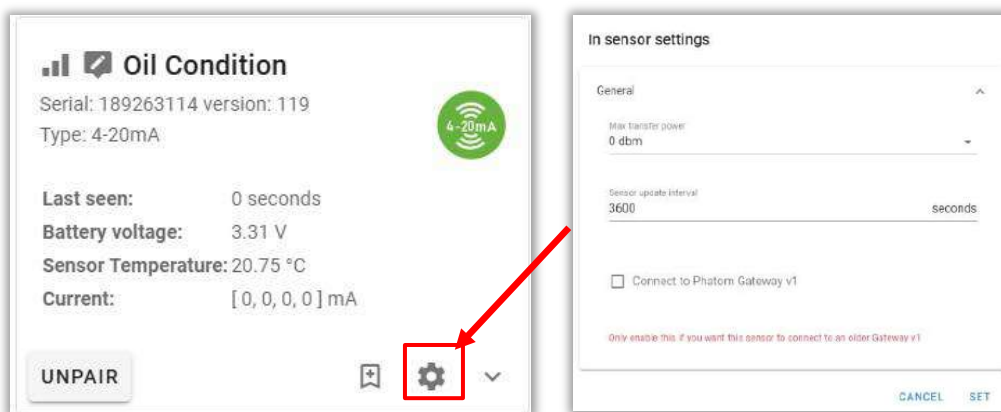

## Adding an EPH-G62 Dry Contact Phantom sensor

The EPH-G62 is designed to work with any normally-open relay contacts. When the contact is closed, it triggers a state change in the sensor from 1(open) to 0(closed). This sensor is often used to manually trigger a group of Phantom vibration sensors to send data collections on-demand. See *Triggering Phantoms* section of this guide for more details.




To add an EPH-G62:

1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (62-189xxxxxx). Click **Next**.
3. Add the Group and assign a Name.

4. Assign the channel to a Machine or Point and press **Next**.
5. Click **Save Phantom**.

6. Open the Gateway Admin Console and click the **in sensor settings** for the sensor being added. Set the **Sensor Update interval** in the **General** section as required. The internal sensor temperature and battery voltage info is sent at this interval. The range is 10 to 86400 seconds(1 day). **Note**- this setting has a direct impact on battery life. It is recommended to keep the Update interval at 3600 sec (1 hr) or higher and the **Max transfer power** setting at 0dBm (default) for Phantoms that use AA batteries. The **Debounce** parameter sets the minimum amount of time a dry contact sensor channel must remain in the same state before switching states, in order for the change to be detected. A relay may switch from on to off or vice versa too quickly for the sensor to detect. The value defaults to the lowest setting – 20 ms.
7. Press **SET** to save any changes.

**Note**-Sensor Alarms are not supported with the EPH-G62 sensor.

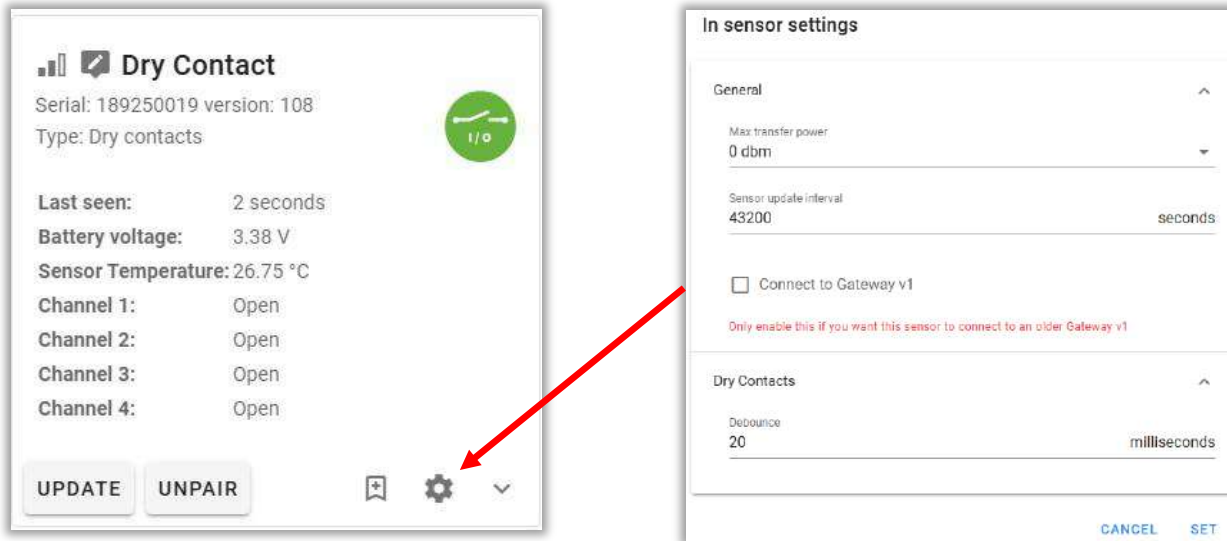



### Adding an EPH-G63 0-10 volt Phantom Sensor

Any sensor with a 0-10V output range is compatible with the EPH-G63 General Purpose Phantom.




To add an EPH-G63:

1. Open Phantom Manager or Devices in EI-Analytic and click **Add Phantom/New Phantom**.
2. Scan the QR code or enter the sensor code manually (62-189xxxxxx). Click **Next**.
3. Add the Group and assign a Name, then click **Next**.

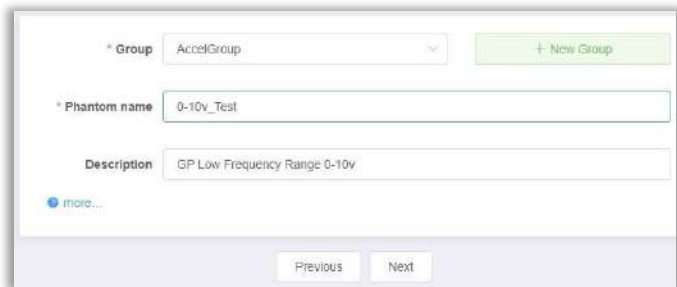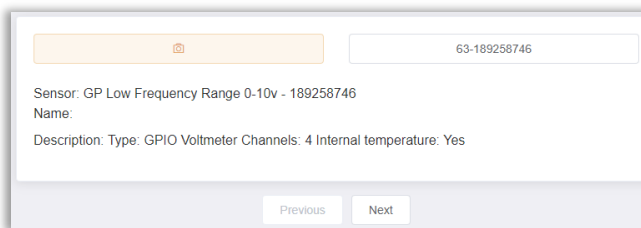


4. Assign one or more channels to Machines or Points and click **Next**.

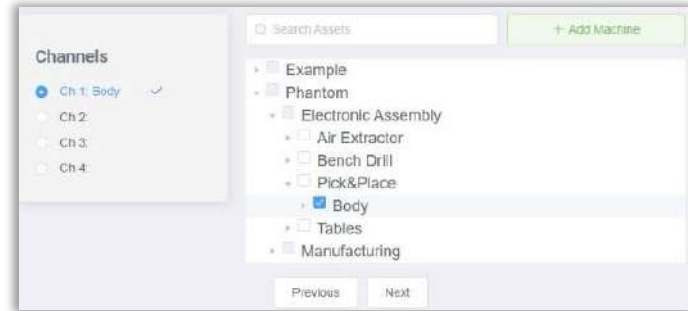





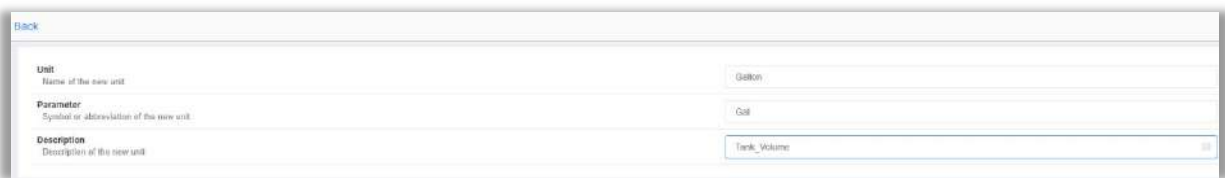
5. Click the **Add Sensor** button when the Sensor Config screen opens.

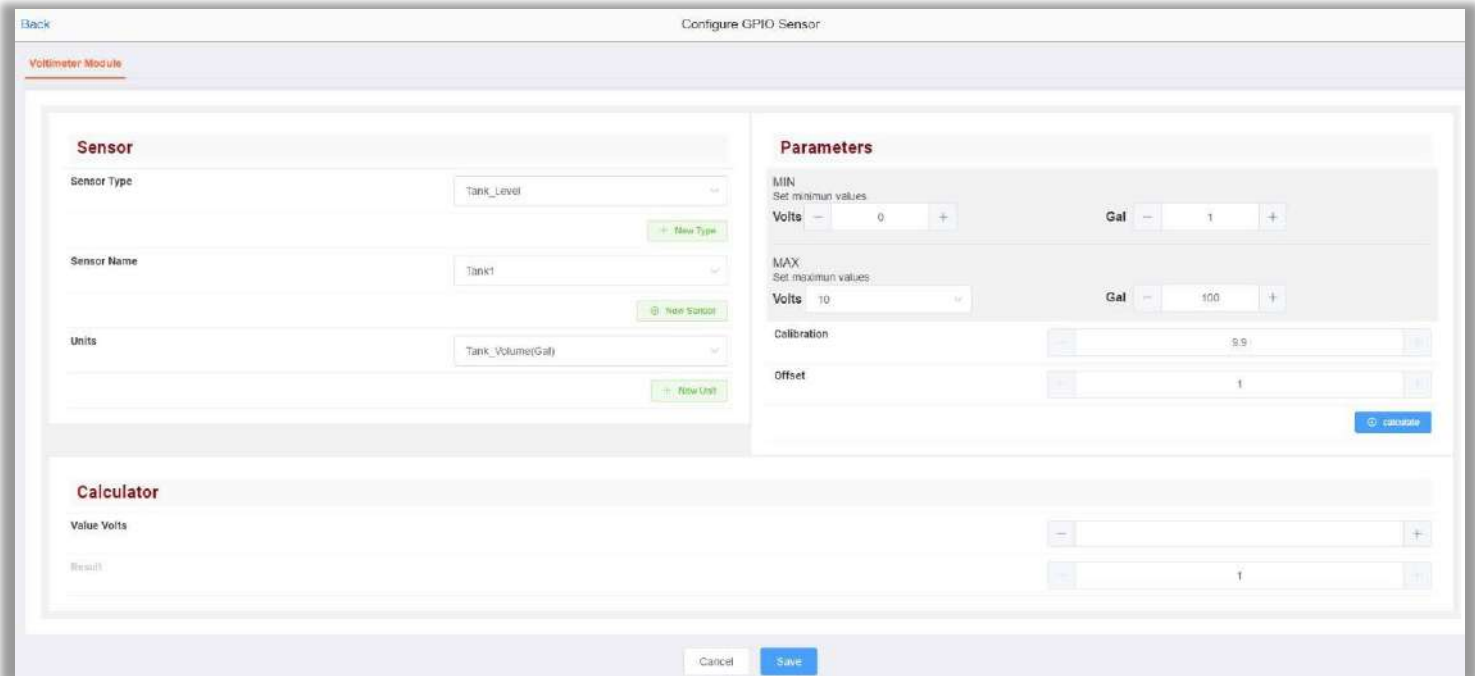

6. The Voltmeter Module opens, containing several panels to configure. In this example, a tank level indicator that outputs 0-10 volts is connected to the Phantom to wirelessly obtain a reading of the tank's fluid level in gallons.




- In the **Sensor** panel click on the  button to choose what type of sensor you are using.
- Then add a **sensor name** using .
- Add the **units** of the value you want to measure from the drop-down box. If the unit does not exist, you can add it with the  button. This opens another screen to enter the relevant information. In this example, the Gallons unit is added. Press  to save your settings.




- In the **Parameters** Panel, set the **MIN** and **MAX** values (1 to 100 for this example).

Based on the MIN/MAX values, software calculates the **Calibration** and **Offset**. These characteristics have the multiplicative function for each mA introduced to the sensor (Calibration) and as the initial reference point considered 0 for the measurable values (Offset). Click on the Calculate button to automatically populate the values. Press **Save** to complete.




- You can now set the channel assignment from the drop-down box, and the optional alarm threshold, then click **Next**.

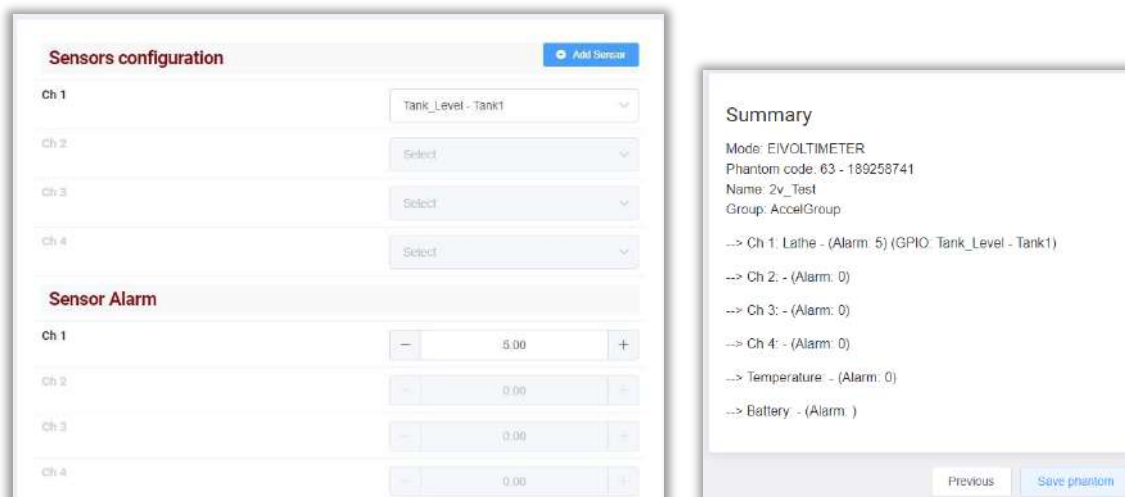

- Press **Save Phantom**. A “Phantom saved successfully” message is displayed.
- Open the Gateway Admin Console and click the **In sensor settings** for the sensor being added. Set the **Sensor Update interval** as required. The internal sensor temperature and battery voltage info is sent to the gateway at this interval.


The range is 10 to 86400 seconds(1 day). **Note-** this setting has a direct impact on battery life. It is recommended to keep the Update interval at 3600 sec (1 hr) or higher and the **Max transfer power** setting at 0dBm (default) for Phantoms that use AA batteries. Press **SET** to save any changes.

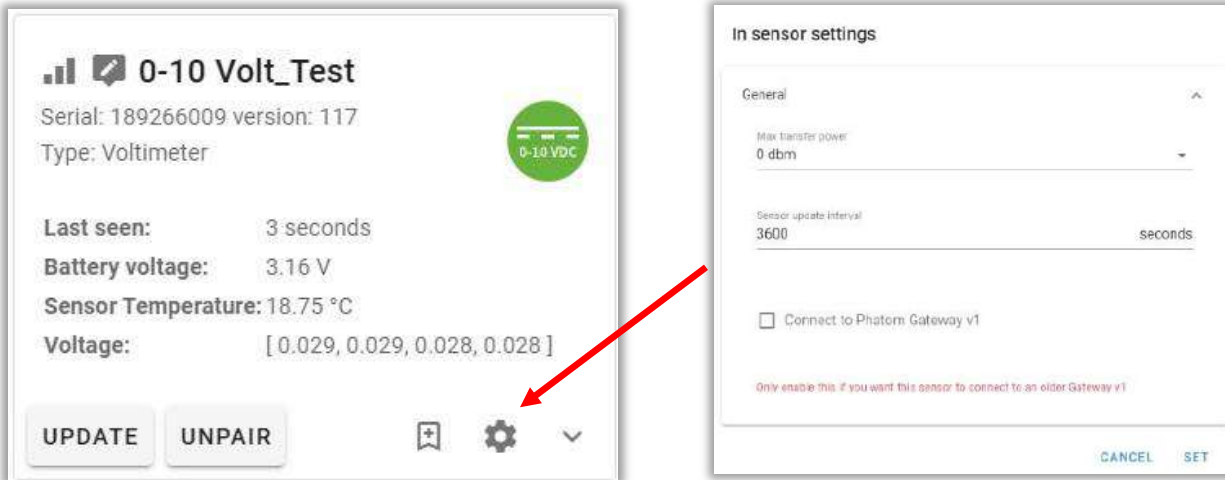

## Adding a GP-8

As its name implies, the GP-8 has 8 channels to interface with any standard ICP accelerometer, velocimeter or proximeter with a 2VDC peak-peak output and a BNC connector.


The GP-8 is shipped with a 4-pin aviation to USB-A male cable to connect a power source (requires 5VDC @ 1 amp).

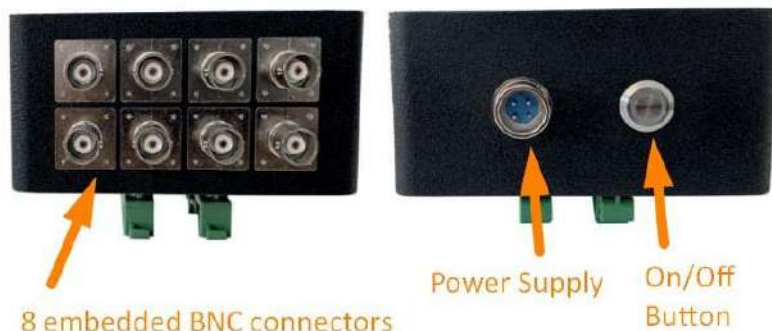

The GP8 has 8 channels, however, this device uses only 4 unique Phantom serial numbers in the database, each serial number is assigned two channels. (The software sees this unit as four -EPH-G60 2vpp sensors). Example:




Each channel can be activated/deactivated using the blue dip-switch bank on top of the unit.

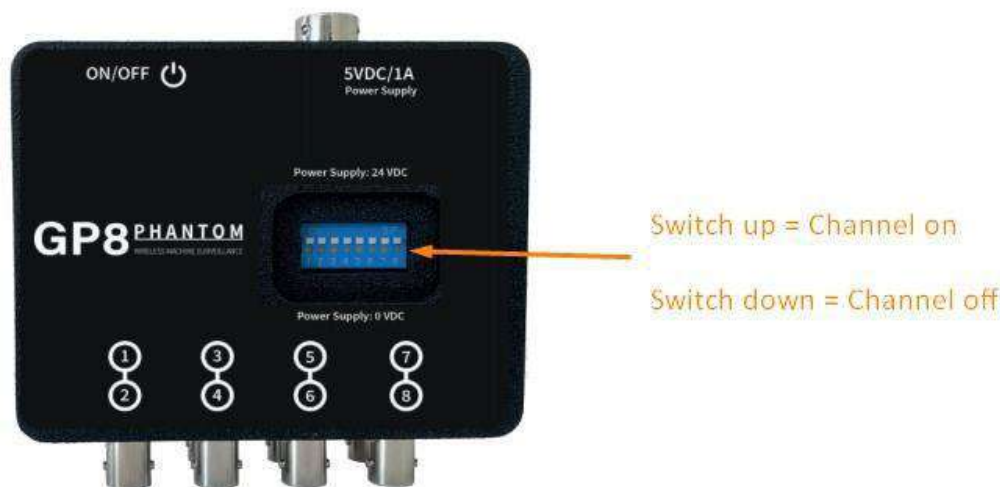


To configure a GP-8:


1. Open Phantom Manager and click **Add Phantom**
2. Scan the QR code or enter the sensor code manually (60-189xxxxxx) and click **Next**.

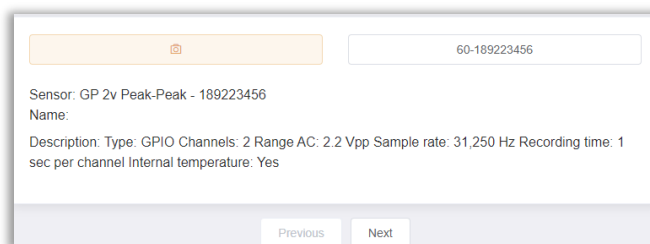


3. Add the Group and assign a Name. **Note** - Disregard the warning that the data sending interval is not configurable! When used with a Gateway 2.0, the **Sensor Update** interval now defines when data is sent (administered from the Gateway Admin Console), see below.
4. The **Alarm Check** interval **\*\*NOTE- This field only applies to sensors used with a Gateway v1.** This is the time between alarm checks performed by the sensor. It can be set from 30 to 120 seconds. For Gateway 2.0, the **Sensor Update** interval serves as the Alarm Check interval. Click **Next** to continue.

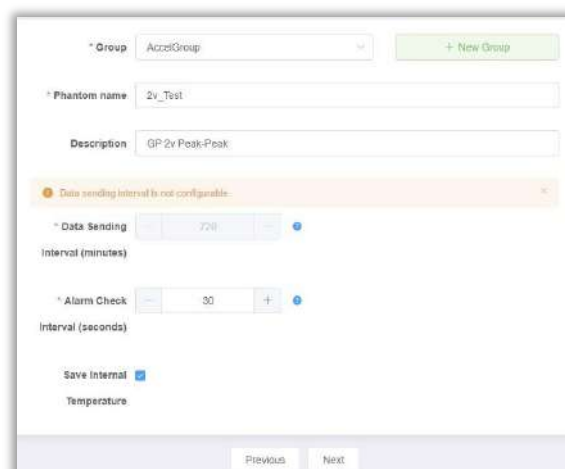

- Assign the channel(s) to a Machine or Point and press **Next**.
- Set the Axis configuration for the channel 1 through 8 sensors.

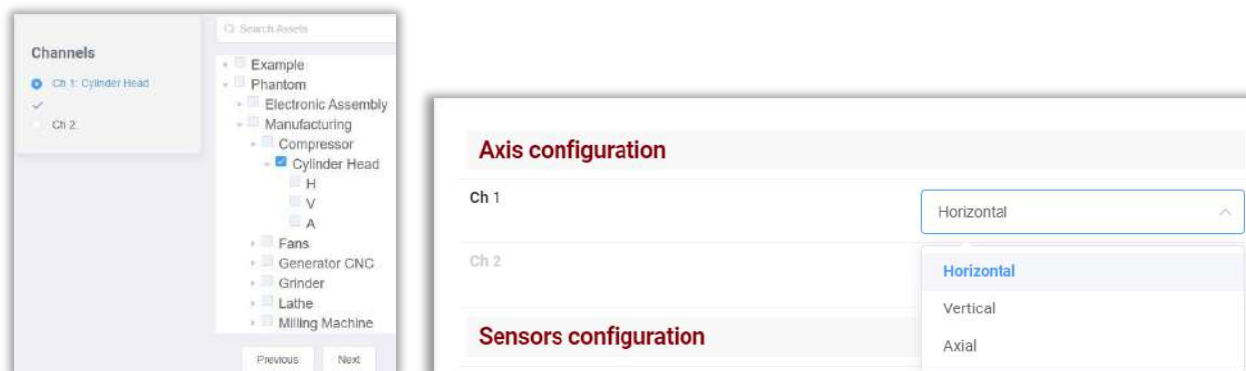



- Set the Sensor config from one of three choices:

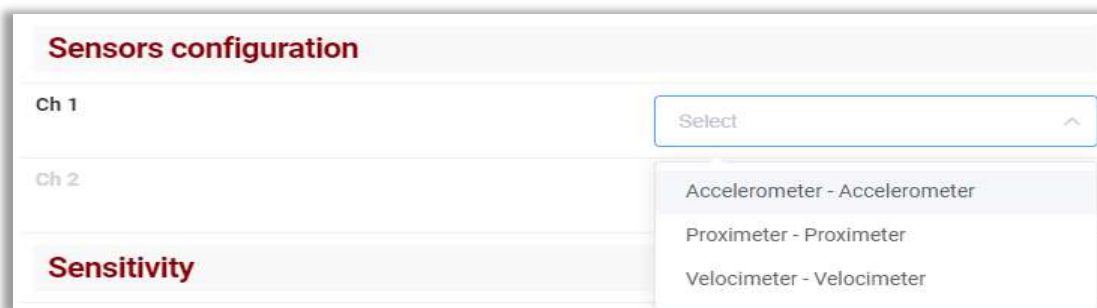

- Set the sensitivity of the monitored sensor.



- Set an optional Alarm threshold and press **Next**.
- Click **Save Phantom** if the info summary is correct.

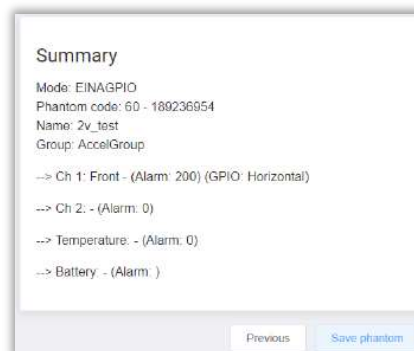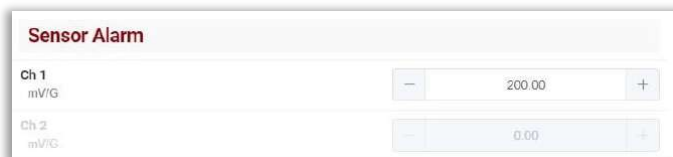

## Other Phantom Tools

In addition to adding Phantoms, the Phantom Manager tool has options to:

- Replace Phantoms
- Pre add Phantoms
- Edit Phantoms
- Delete Phantoms
- Edit Phantom Alarms(a shortcut)
- Add GPIO sensors (a shortcut)
- Internal Inactivity Configuration
- Estimate battery life with a Battery Calculator tool.
- Storage calculator for database size estimates.

## Replace Phantom

To replace one Phantom with another in software, click **Replace Phantom** and input the Phantom code(or scan) and press **Next**. **Note** – both Phantom sensors must be the same model. A V10 sensor cannot be replaced with a V11 for example.

Enter the replacement Phantom serial number and click **Next**.

Make sure the numbers are correct and press **Replace Phantom**. A message will be displayed upon success.

### Pre-Add Phantom

Phantom sensors may be configured and assigned to a Machine point without identifying the serial number of the sensor. This allows creation of the Phantom database in advance. The Phantoms can then be edited in the future to add the serial numbers.

189259479 => 189278945

Previous Replace phantom

Phantom 189259479 successfully replaced with: 189278945

### Interval Inactivity Configuration

This feature is used to set minimum thresholds for saving sensor data in an EI-Analytic database. All data collected with values below the specified threshold will be discarded, rather than saved to the database. This prevents wasting database capacity on unwanted recordings from inoperative equipment.

To configure sensors thresholds:

1. Open the Inactivity Configuration tool in Phantom Menu (from DigivibeMX or EI-Analytic/WiSERVIBE).

2. Select the Type of Phantom from the drop-down field. All matching Phantoms in the database will be displayed.
3. Click the box(es) beside the desired sensor serial number(s).


Code	Name	Type	Parameter	Assigned	Actions
189203650	PH_Motor_DE	High Range Vibration	No parameter	ABC Company/Area1/Pump_001/Motor_DE	[+]
189201939	PH_Pump_NDE	High Range Vibration	No parameter	ABC Company/Area1/Pump_001/Pump_NDE	[+]

4. Use the button to add, edit or delete configurations. If no previous configurations were set up for the sensor, the Parameter column shows “No parameter”


5. Click the **+ New** button to add a parameter.



6. Add a **Name** and **Value** for the Unit (options are shown based on sensor type) **Note-** ensure you click on the Unit to highlight it before pressing **Add** or an error will be displayed.

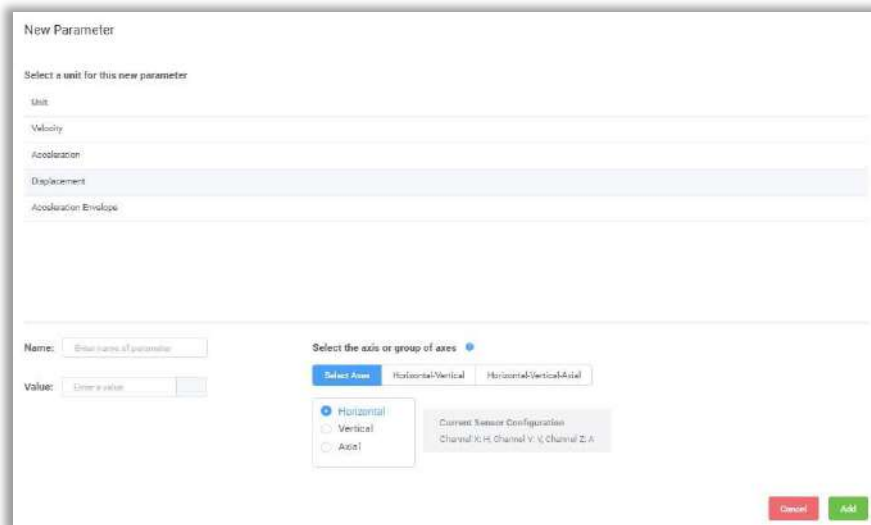

7. Highlight the Parameter by clicking on it. Press Save , and a completion message is flashed at the top of the screen.

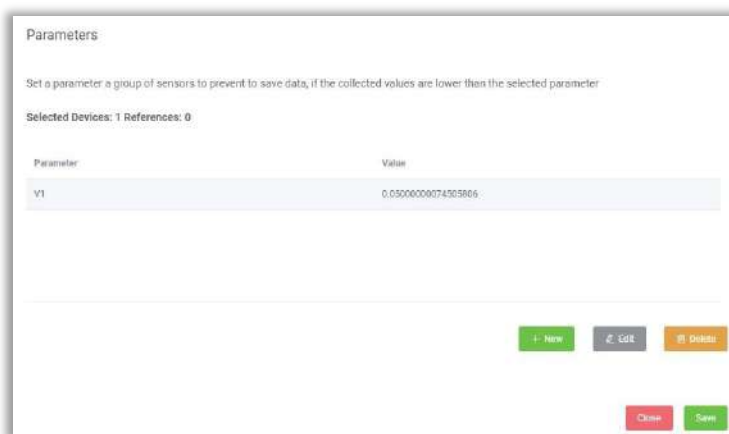

## Battery Calculator

This tool provides an estimate of the battery life for Phantom vibration sensors, based on settings. There is no tool available for Phantoms that use AA batteries. To use the tool, first select the version of sensor:

- **Expert** - Gen 1 triaxial -with a 3.6v lithium battery (E.g. Tadiran TL-5135+).
- **G2** - Gen 2 triaxial with a CR123 battery.
- **G3** - Gen 3 triaxial with a CR2477 battery.

Input the desired parameters to determine the estimated lifespan, which is displayed at the bottom.

In this example, a G3 Phantom taking a full data collection once a day, with a Sensor Update interval of 1 hour, is installed less than 37 meters from a gateway, and has the Max transfer power set to 8 dBm, can expect a battery life of 4 years.

Like any battery, the ambient temperature and other factors can shorten the lifespan. The frequency of alarms, and manual data collections also will have a noticeable effect.

**Settings**

Interval send data  
Time in minutes: 1440

RMS time interval  
Time in seconds: 3600

Recording settings  
Max. freq: 10khz (1 sec)

Alarms  
Sensor alarms set

Sensing alarm time  
Time in seconds: 120

Permanent incoming connections allowed

Distance to Gateway  
less than 37 meters

Max transfer power  
8

**4 years**

The calculated value is an estimate. There are several other factors that may affect battery life, such as:

- The number of alarms
- Manual collections
- Temperature

## Storage Calculator

Use this tool to calculate the amount of storage used in a database for triaxial vibration sensors.

Enter the number of sensors and the interval. Each triaxial full time waveform data collection uses 150 kb of space. This applies to all models of sensor, G2, G3 or G4.

RMS data collections vary in size by sensor model and are less than 100 bytes.

## Phantom Triggering

Triggering is an enhancement of the Phantom system to improve recording accuracy by collecting sensor data only when a machine is in operation. This reduces the amount of unwanted database entries resulting from collections when a machine is not running. This unwanted data will also skew trend values.


- All triggering is controlled by the Phantom Gateway
- All Phantom sensors involved with a triggering setup must be served by the same Gateway or Gateway network (Main or Sub-ordinate), i.e. Inter-Gateway triggering between Main GW's is not supported.
- Multiple Phantoms may be configured to be triggered by the same source sensor, there is no practical limit, it is dependant only on gateway traffic.
- There are two types of triggers – **Internal** and **External**.

## Internal Triggering

Phantom vibration sensors (V10, V11) provide periodic RMS velocity measurements to the Gateway, which can be configured to trigger the sensor to collect a Time Waveform and send it to the database(local or EI-Analytic). Optionally, it can also be set to trigger an Email/push notification when a threshold is reached. (EI-Analytic databases only).

This is formerly known as “RMS Velocity alarms”

Velocity RMS trigger setup is found in the Sensor Collection settings:

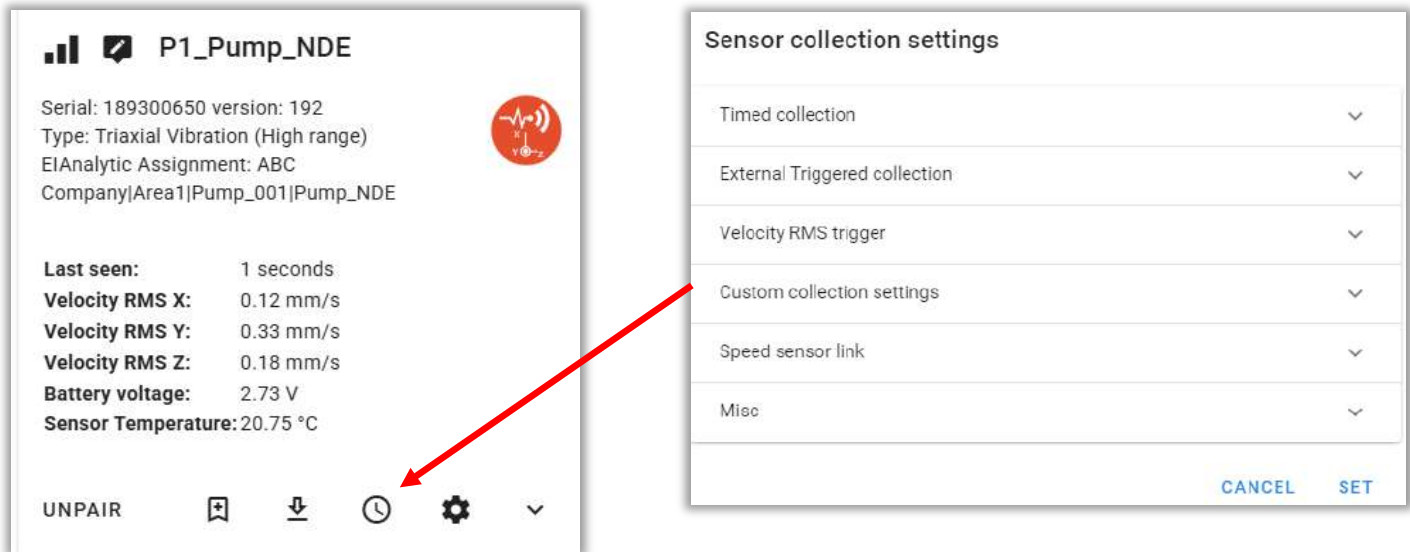



**RMS trigger level 1** will cause the sensor to send a waveform collection if the RMS velocity threshold is exceeded on any of the measured axes (updates the Gateway using the Sensor Update interval – see below).

**RMS trigger level 2** will trigger an email/push notification if the RMS velocity threshold is exceeded on any of the measured axes. Emails are sent to the address associated with the EI-Analytic account profile. Push notifications are sent to Wiser Vibe mobile App users. Not supported with local databases.

**Note** – Level 1 and 2 triggers may be set independently, level 1 is not a pre-requisite to use level 2.

The **Mode** field determines whether to use the original data that caused the trigger (RMS), or take **new** data.

**SET THIS TO COLLECT NEW DATA**

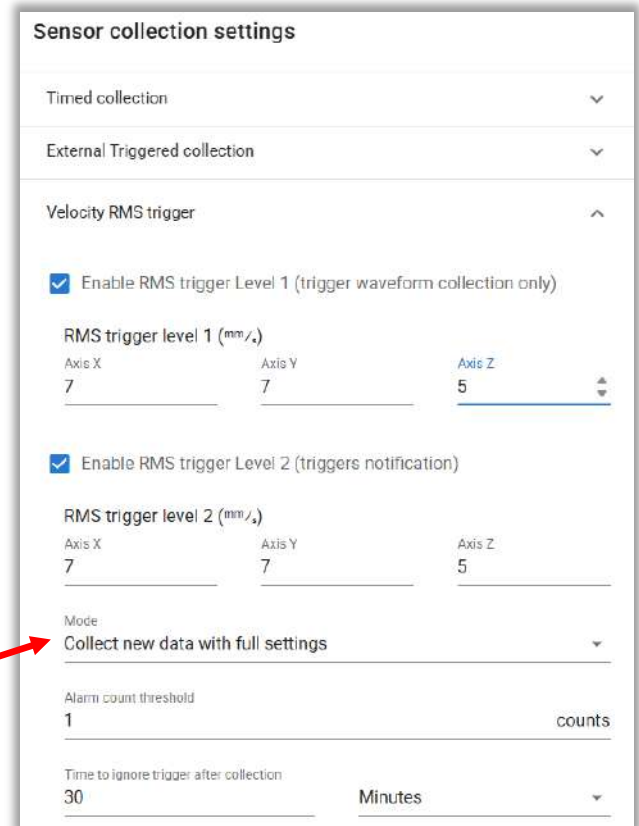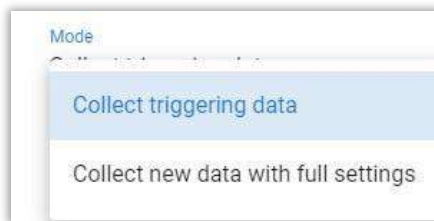

**Count threshold:** This parameter defines number of consecutive *counts* for which the thresholds are exceeded before triggering. A *count* is the amount of time defined by the **Sensor Update Interval**, which is set via the **In-Sensor Settings**.


**Time to ignore trigger after collection** indicates how much time must pass before the sensor can be triggered again (applies to both Level 1 and 2).

For Internal triggering applications this becomes the waveform collection interval for the sensor.

**Note** – A Triggered collection setting is independent of the normal **Timed collection** setting for the V10/V11 vibration sensor.

If regular Timed collections are not desired, set the Timed collection to **disabled**. Only triggered collections will now be provided.



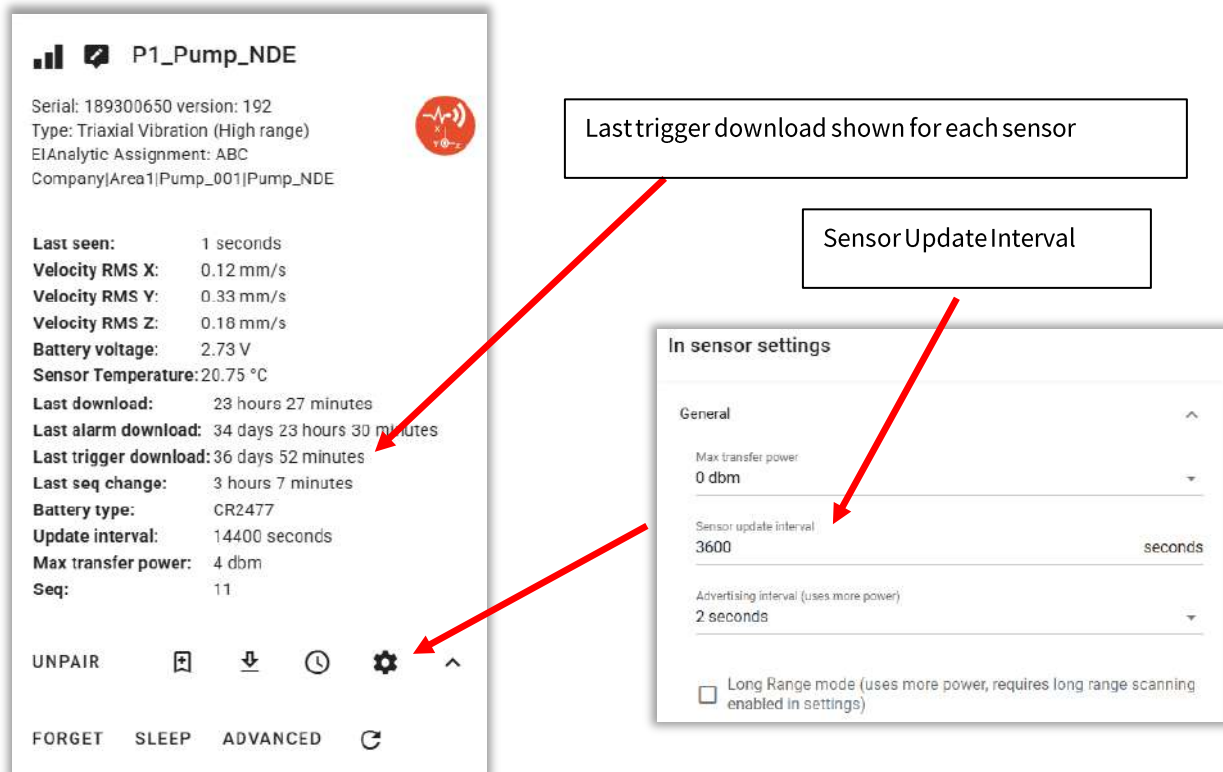

## Managing the Sensor Update Interval

When the Sensor Update Interval elapses, a Phantom sensor will transmit a small packet of information to the Gateway, based on the sensor model. This includes:


1. Velocity RMS for each axis
2. Internal Temperature
3. Signal Strength
4. Battery voltage
5. Firmware version

This information is automatically sent by the Gateway to the database (EI-Analytic or local).

Since the Sensor Update Interval also serves as the Trigger check interval for RMS Velocity thresholds, it is sometimes desirable to set this to a low value, for example one minute. While having the desired effect of providing a frequent RMS update to the Gateway, it unfortunately **also** results in an RMS entry added to the database every minute. Even though RMS data is extremely small in size, it requires action to periodically delete the unwanted entries. Setting the Sensor Update Interval to one minute will create 1440 database entries per sensor, per day!

A **Misc** parameter can be set for each sensor to determine how often the Gateway will send RMS information to the database, based on the Sensor Update Interval.

This allows the Update interval to be set to a lower value, but not impact the database. For example, setting it to 4 counts for a 3600 second Sensor Update interval (default) would cause the Velocity RMS thresholds to be checked by the Gateway every hour, but an RMS data packet would only be sent to the database every four hours. The first 3 RMS data packets are discarded by the Gateway. The 4th is sent to the database, and the Gateway's counter resets to 0 for that sensor.

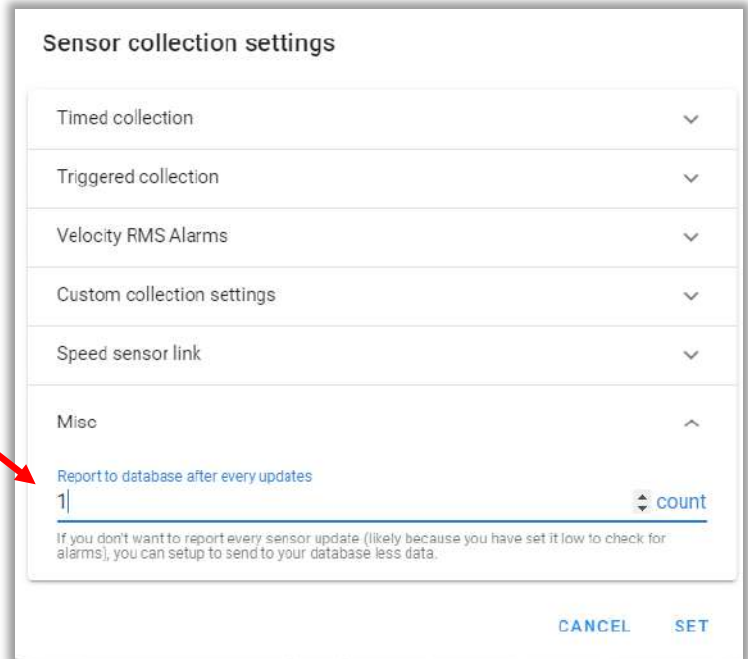

**Sensor collection settings**

- Timed collection
- Triggered collection
- Velocity RMS Alarms
- Custom collection settings
- Speed sensor link
- Misc
  - Report to database after every updates: 1 count

If you don't want to report every sensor update (likely because you have set it low to check for alarms), you can setup to send to your database less data.

CANCEL SET


**Note** – The Sensor Update Interval has a direct impact on sensor battery life! Setting to a very low value such as 1 min will also impact Gateway traffic. It is recommended to only use an Update interval of less than 10 minutes for brief periods of time, and set to higher values under normal conditions.

## External Triggering

Several models of Erbesd Instruments Phantom sensors can be used to **trigger** other Phantom triaxial vibration sensors or thermographic cameras to collect data. This helps ensure vibration/thermographic measurements are taken when a machine is running in a desired state, e.g., RPM or current draw are within a specific range, Five models of Phantom sensor can be used to trigger:


1. EPH-S40 Speed Phantom for RPM
2. EPH-C31 Current Phantom for Amperage
3. EPH-G62 Dry Contact Phantom for manual or automatic contact-closure
4. EPH-G61 4-20 mA General Purpose I/O (requires gateway Firmware version 58 or higher)
5. EPH-G63 0-10 Volt GPIO (requires gateway Firmware version 58 or higher)

These Phantom sensor models update their associated Gateway with information (RPM, current, etc.) at varying intervals, some are pre-set, others are configurable. When triggering conditions are met, the gateway initiates measurement(s) to begin within a few seconds, depending on the gateway traffic load.

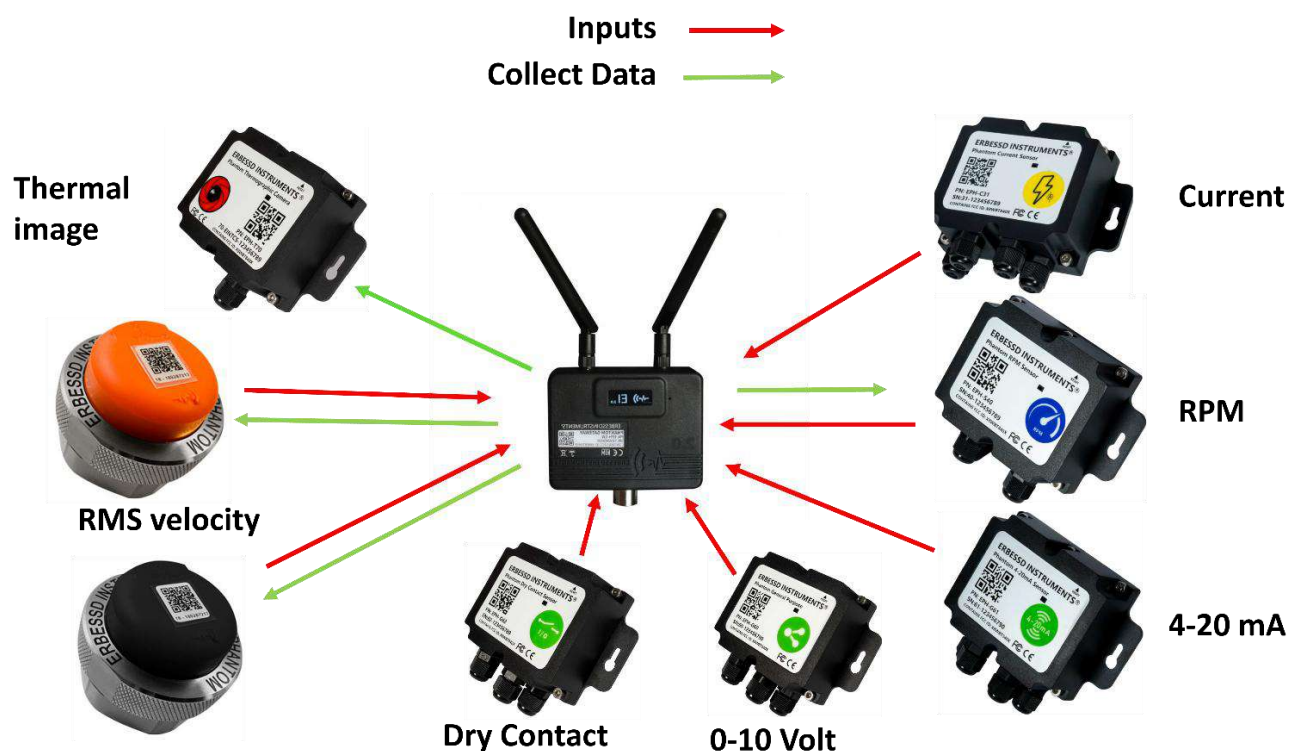

## RPM Trigger


The EPH-S40 Phantom Speed sensor reports RPM to the Gateway using the **Sensor Update** interval as configured in the **In-sensor Settings**. It is beneficial to set this value to a minimum so there is no delay in triggering. However, the negative impact on battery life makes this undesirable. Therefore, it is highly recommended to install the Speed Phantom in **Continuous measurement mode**. This requires hard-wired 5-24VDC power in place of batteries.

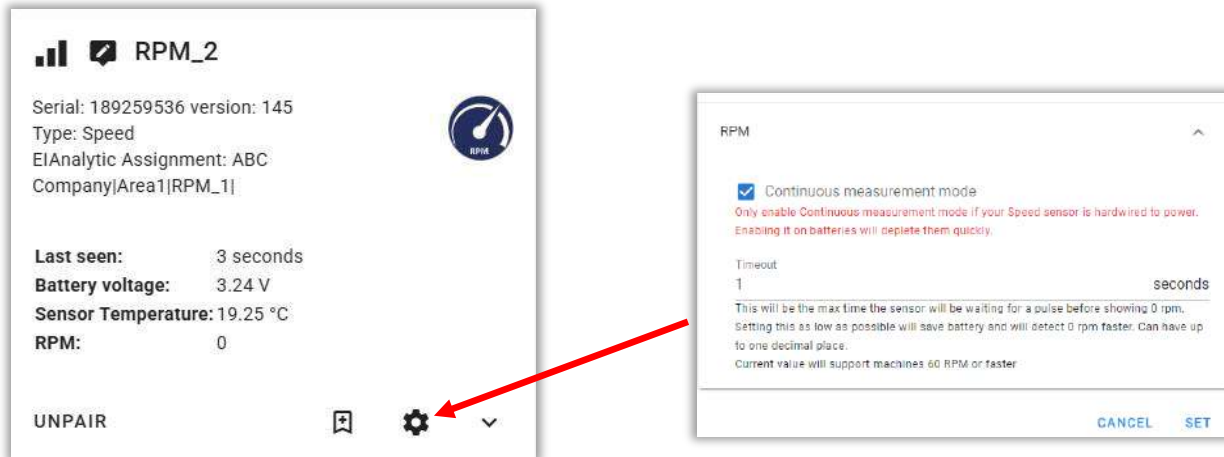

When **Continuous Mode** is enabled, the sensor will update the RPM value to the Gateway every 2 seconds.


With an EPH-S40 Phantom Speed sensor installed to provide RPM information, the steps to set up triggering of Phantom vibration sensors(V10 or V11) or a T70 Thermographic camera are as follows:

1. In the Live State screen of the Phantom Gateway Admin Console, locate each V10/V11 or T70 sensor to be triggered. For EACH sensor, click on the **Collection Settings** icon, and select **External Triggered collection**

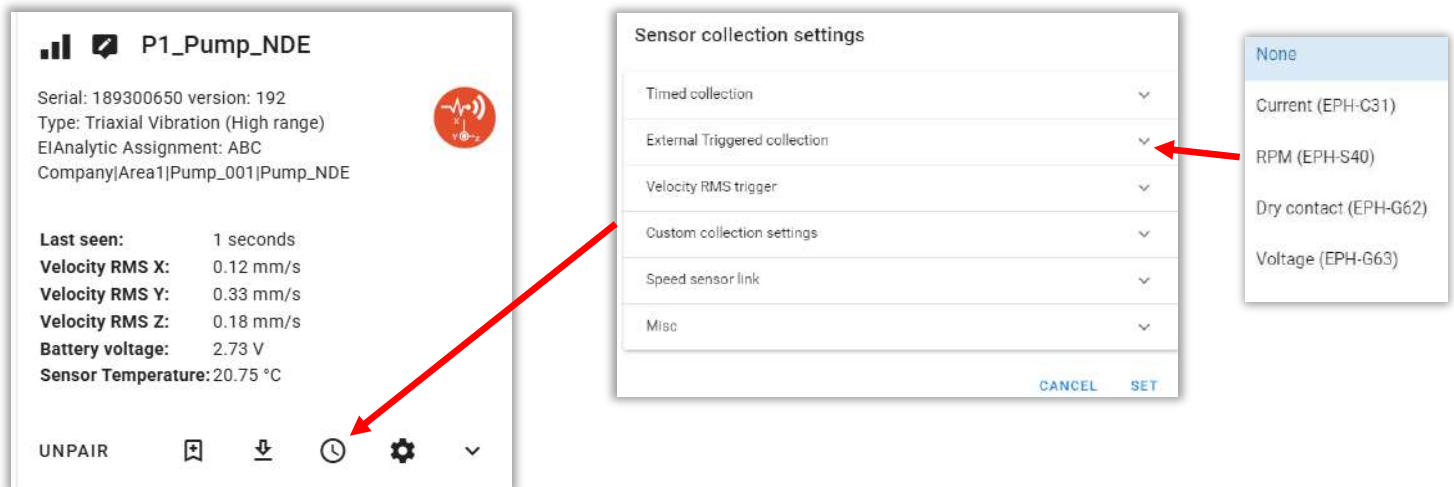

2. Choose the **RPM** triggering method:

3. Select the Phantom Speed sensor from the **Triggering Sensor** drop-down list.

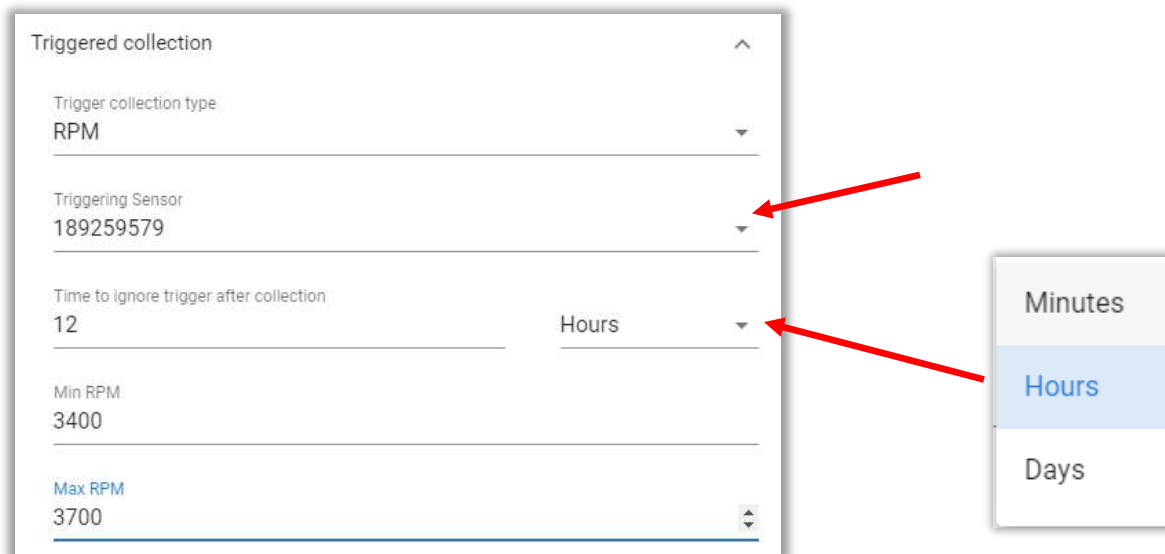

4. Set the **Time to ignore trigger after collection** value. This sets an interval between triggered events. Once the timer has elapsed, and the RPM Min/Max conditions are met, a new trigger will occur.
5. Set **Min and Max RPM** to define the range in which the RPM must fall to cause a trigger event.
6. Press **SET** to save changes.

**Note** – A Triggered collection setting is independent of the normal **Timed collection** setting for the V10/V11 vibration sensor.





If regular Timed collections are not desired, set the Timed collection to **disabled**. Only triggered collections will now be provided.

## Speed Sensor Link


The Speed Sensor Link feature allows the RPM from a Phantom S40 speed sensor to be sent to the database synchronous with vibration data from any V10/V11 Phantom connected to the same Gateway network.

This feature should only be used when the S40 is set to **Continuous** mode (must be powered locally).

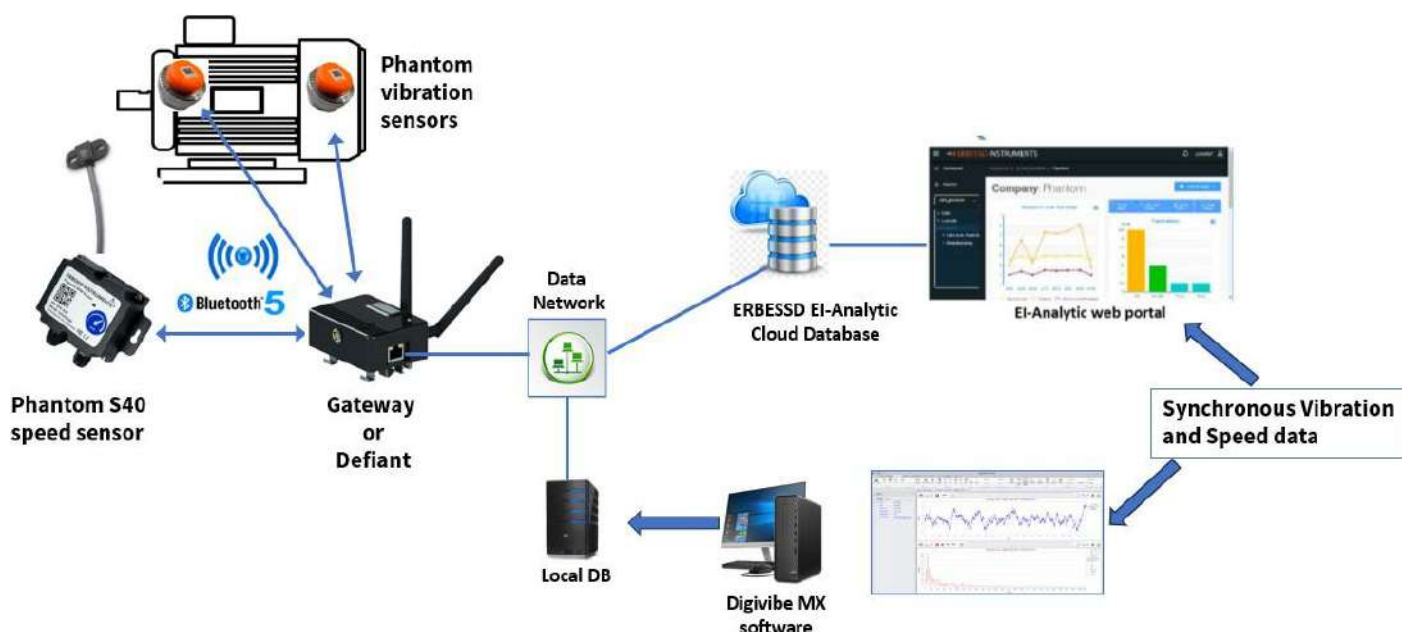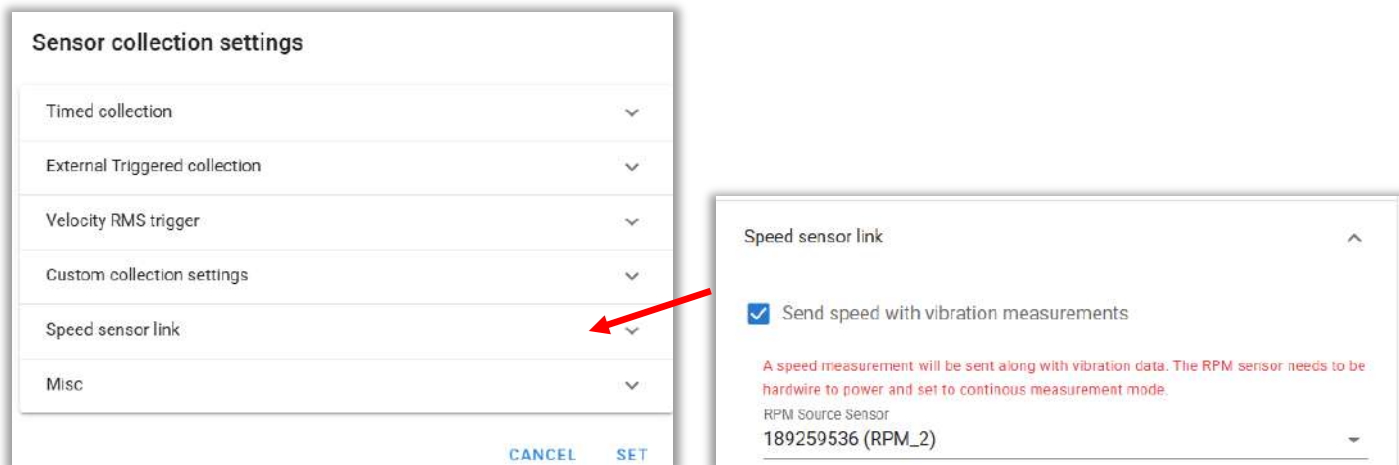


## Current Trigger

The EPH-C31 Current sensor updates the Amperage values from all 4 channels to the Gateway **every 5 seconds** regardless of the **Sensor Update** interval assigned in the **In-Sensor settings**. (which is the interval at which data is sent to the database)

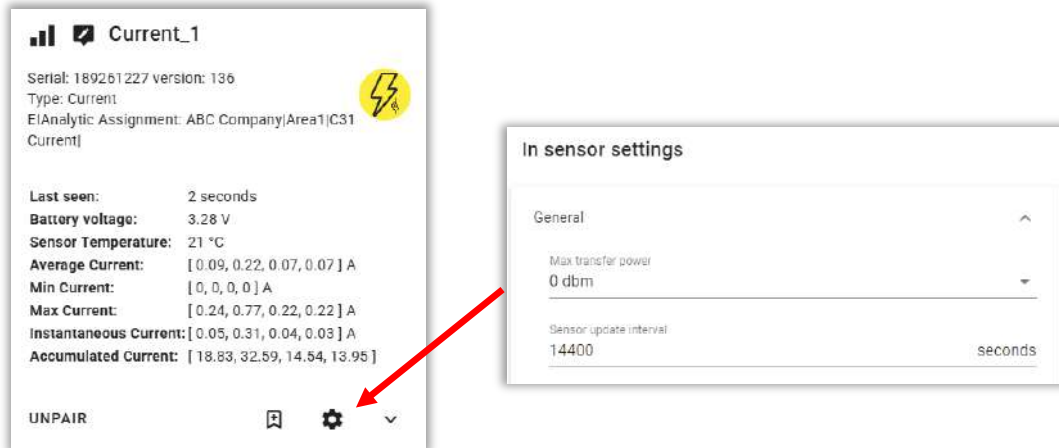


With an EPH-C31 Current Phantom sensor installed, any of the channels can be used to trigger a V10 or V11 vibration sensor. The steps to set this up are:

1. In the Live State screen of the Phantom Gateway Admin Console, locate each V10/V11 sensor to be triggered. For EACH sensor, click on the **Collection Settings** icon, and select **External Triggered collection**

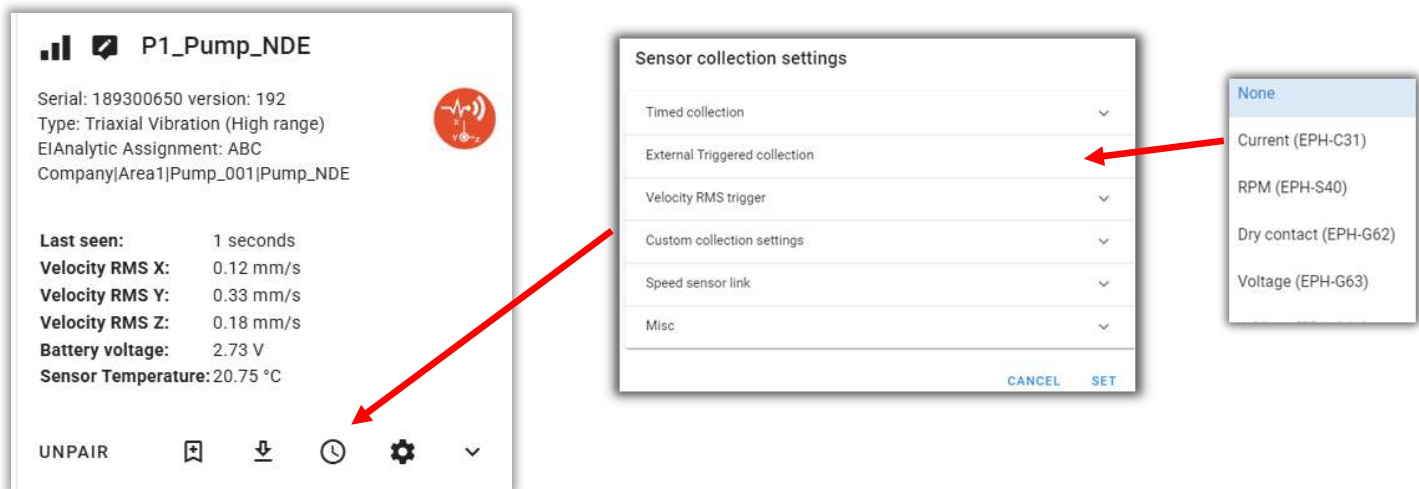

2. Choose the **Current** triggering method:

3. Select the Phantom Current sensor ID from the Triggering Sensor drop-down list.

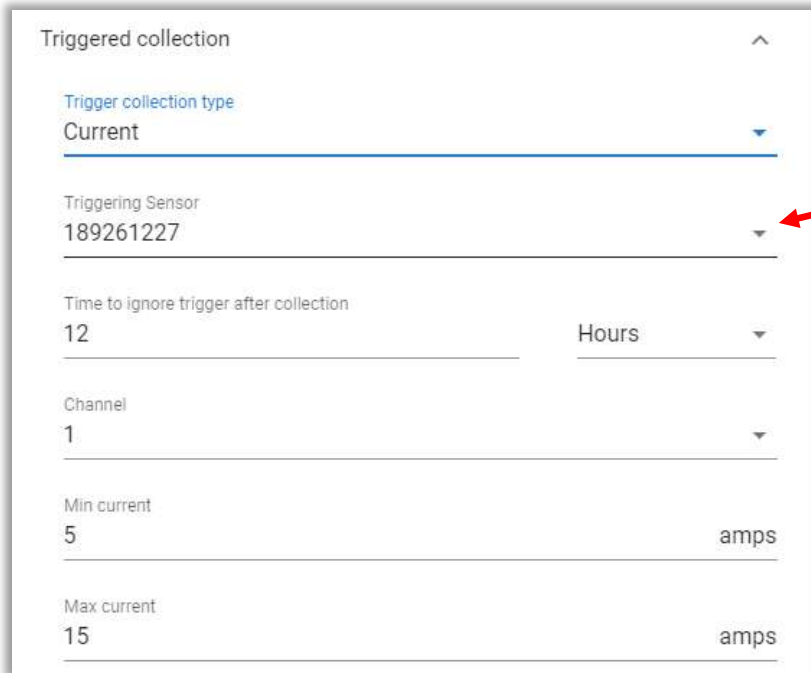

4. Set the **Time to ignore trigger after collection** value. This sets an interval between triggered events. Once the timer has elapsed, and the current Min/Max conditions are met, a new trigger will occur.
5. Choose the **Channel** (1-4)
6. Set **Min and Max current** to define the range in which the current must fall to cause a trigger event.
7. Press **SET** to save changes.


**Note** – A Triggered collection setting is independent of the normal **Timed collection** for the V10/V11 vibration sensor.



If regular Timed collections are not desired, set the Timed collection to **disabled**. Only triggered collections will now be provided.


## Dry Contact Trigger

An EPH-G62 Dry contact Phantom sensor can be used to trigger V10/11 vibration sensors. This Phantom Specialty sensor updates the open/closed state of each channel every 5 seconds or less to the Gateway. The state information is sent to the database using the **Sensor Update** interval in the **In-sensor settings** of the sensor.

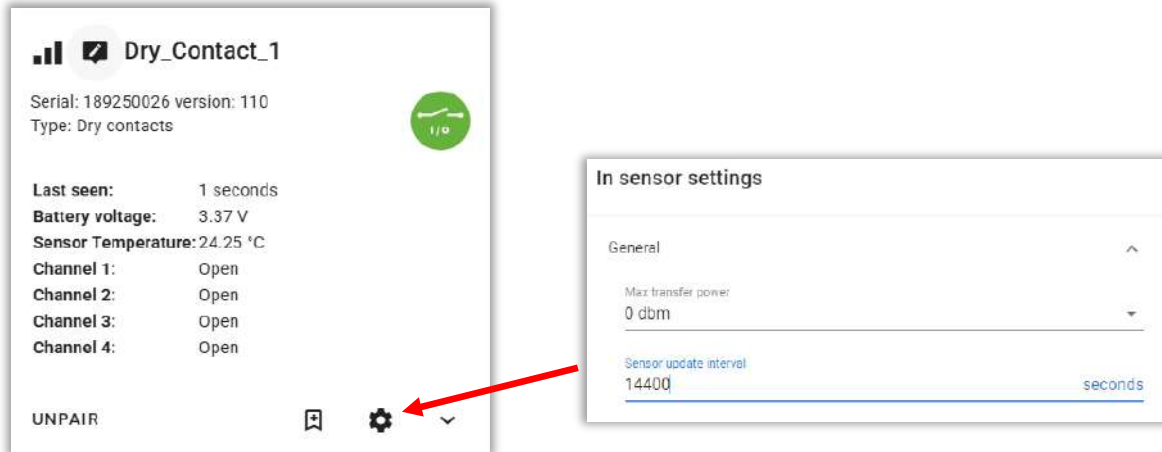


To configure Dry Contact triggering, follow these steps:

1. In the Live State screen of the Phantom Gateway Admin Console, locate each V10/V11 sensor to be triggered. For EACH sensor, click on the **Collection Settings** icon, and select **Triggered collection**

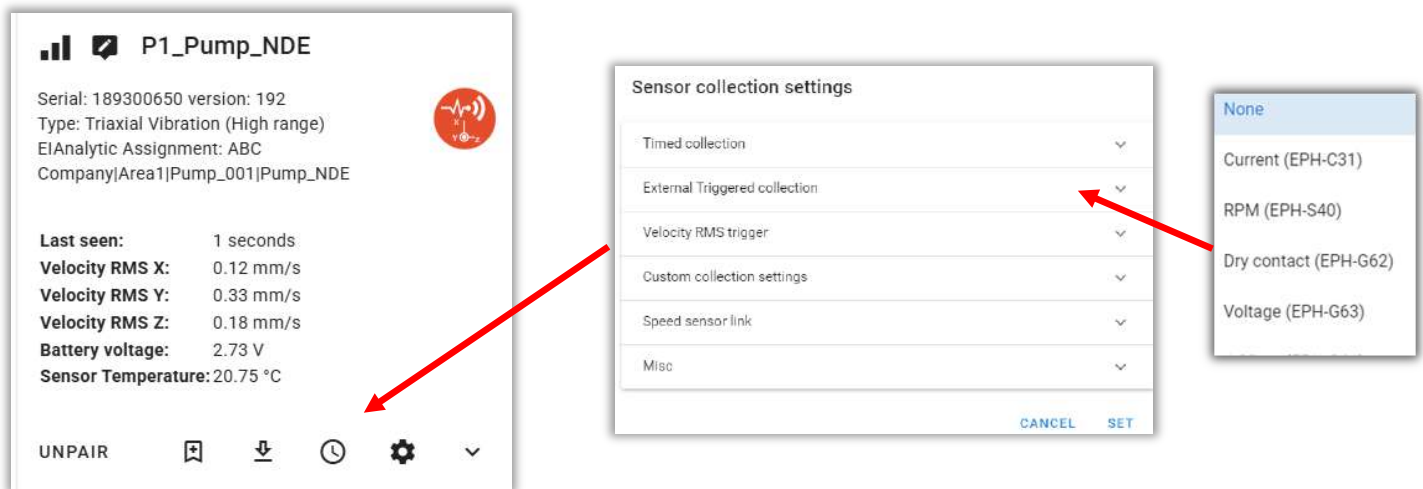

2. Choose the **Dry contact** triggering method:

3. Select the Phantom Dry contact sensor ID from the Triggering Sensor drop-down list.

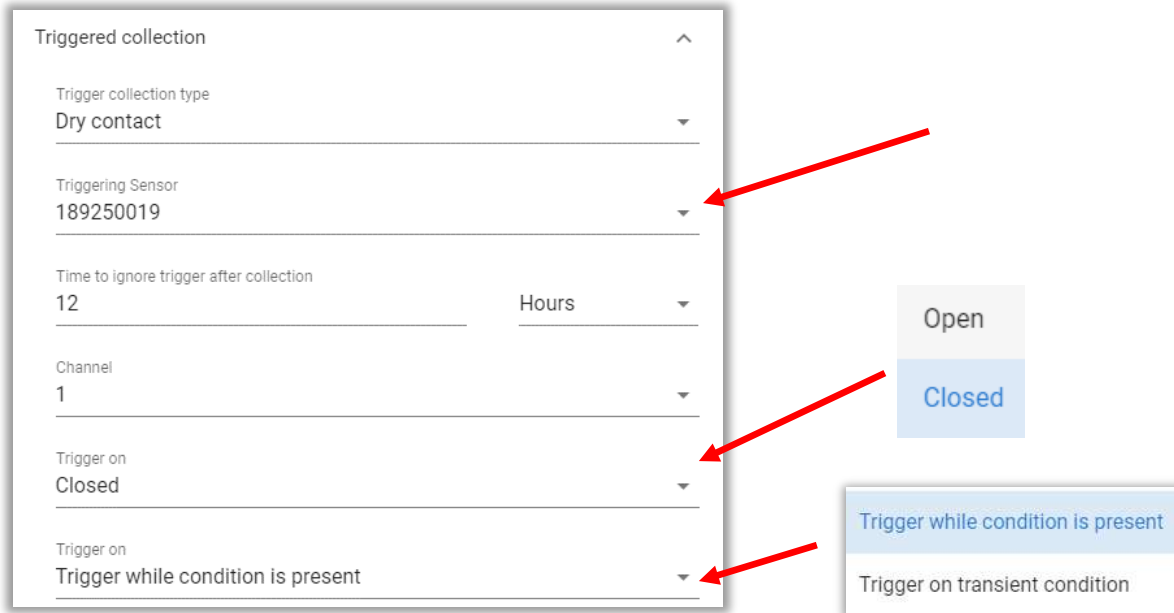

4. Set the **Time to ignore trigger after collection** value. This sets an interval between triggered events. Once the timer has elapsed, and the trigger conditions are met, a new trigger will occur.
5. Choose the Channel (1-4)
6. Set the **Trigger on** parameter to **Closed** or **Open**. When the Sensor Update Interval expires, the sensor reports the contacts as open or closed. Triggering can be done based on either condition.
7. **Trigger while condition is present** uses the open or closed setting above to determine if triggering should take place. Typically, this is used when a remotely-controlled relay is connected to the sensor, and is closed automatically when a machine is in operation. **Trigger on transient condition** causes triggering to occur whenever the condition changes, which would be used in a case where a button is pressed manually to cause a trigger. Note – the manual button-press method works with either selection of this parameter.
8. Press **SET** to save changes.

**Note** – A Triggered collection setting is independent of the normal **Timed collection** setting for the sensor.



If regular Timed collections are not desired, set the Timed collection to **disabled**. Only triggered collections will now be provided.

## 4-20 mA GPIO Trigger

The EPH-G61 4-20 mA Phantom sensor can be used to trigger a vibration sensor (EPH-V11E or V10E) or an EPH-T70 Thermographic camera.

Example sensor setting:



1. Select 4-20ma from the **Type** field
2. Pick the **triggering sensor** from the list of available Phantoms
3. Set the **Time to ignore trigger after collection** value. This sets an interval between triggered events. Once the timer has elapsed, and the Min/Max conditions are met, a new trigger will occur.
4. Set **Min and Max Current** to define the range to cause a trigger event.
5. Press **SET** to save changes.

**Note** – A Triggered collection setting is independent of the normal **Timed collection** setting for a V10/V11/T70 sensor. If regular Timed collections are not desired, set the Timed collection to **disabled**. Only triggered collections will then be provided.

## 0-10 Volt GPIO Trigger

The EPH-G63 0-10V Phantom sensor can be used to trigger a vibration sensor (EPH-V11E or V10E) or an EPH-T70 Thermographic camera.


Example of a Sensor setting when a 0-10 Volt sensor is used to trigger:

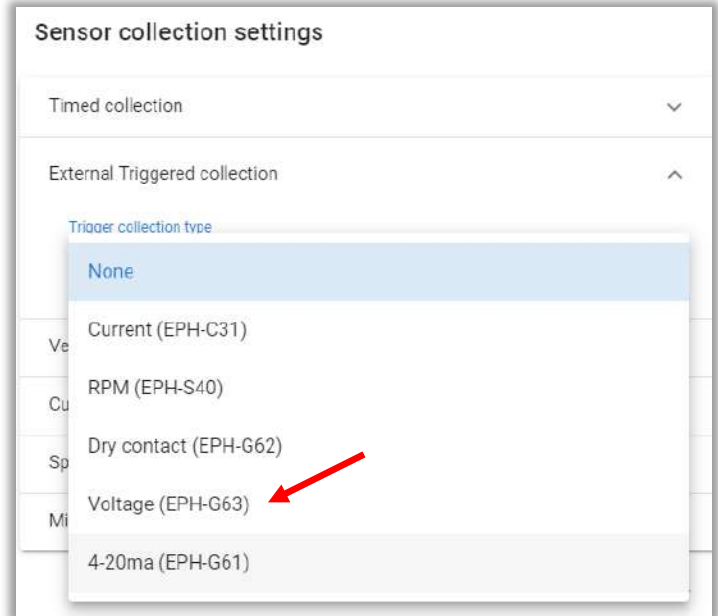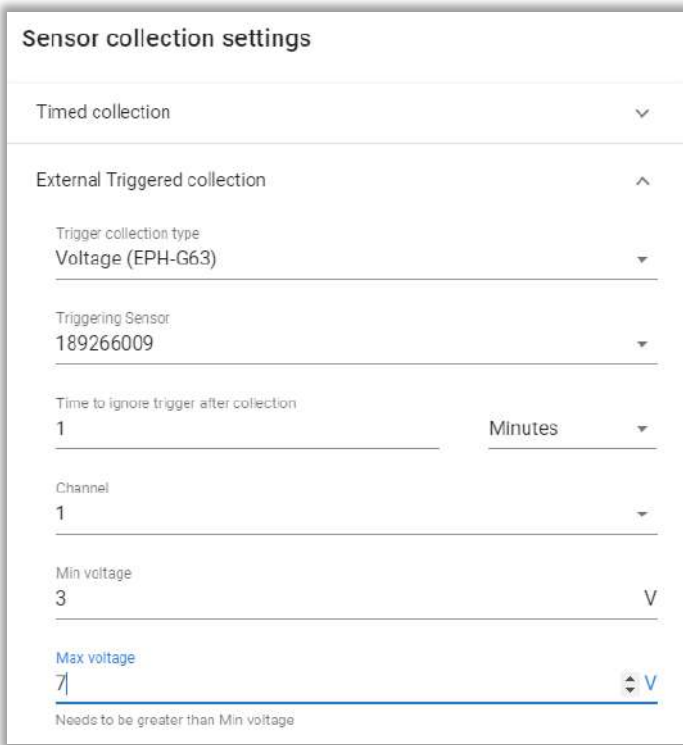

1. Select Voltage from the **Type** field
2. Pick the **triggering sensor** from the list of available Phantoms
3. Set the **Time to ignore trigger after collection** value. This sets an interval between triggered events. Once the timer has elapsed, and the Min/Max conditions are met, a new trigger will occur.
4. Set **Min and Max voltage** to define the range in which it must fall to cause a trigger event.
5. Press **SET** to save changes.

**Note** – A Triggered collection setting is independent of the normal **Timed collection** setting for a V10/V11/T70 sensor. If


regular Timed collections are not desired, set the Timed collection to **disabled**. Only triggered collections will then be provided.

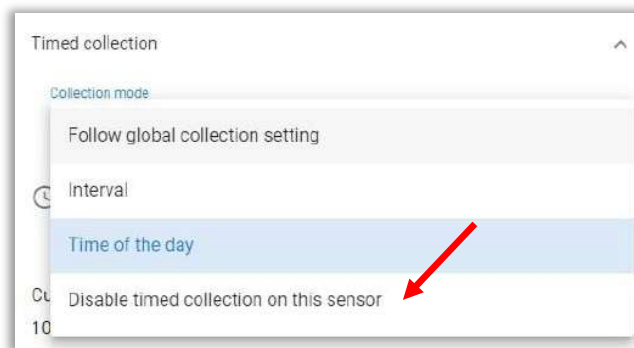


## Gateway Offline Storage

Phantom Gateway 2.0 has an on-board SD card for storage of up to 100,000 vibration signal files when no Internet or EI-Monitor is available. Once connection to the database is restored, the files are uploaded automatically.

The **Offline Storage** tab on the Main Menu shows the number of files currently in storage. Storage may be purged by clicking the **Reset Storage** button.

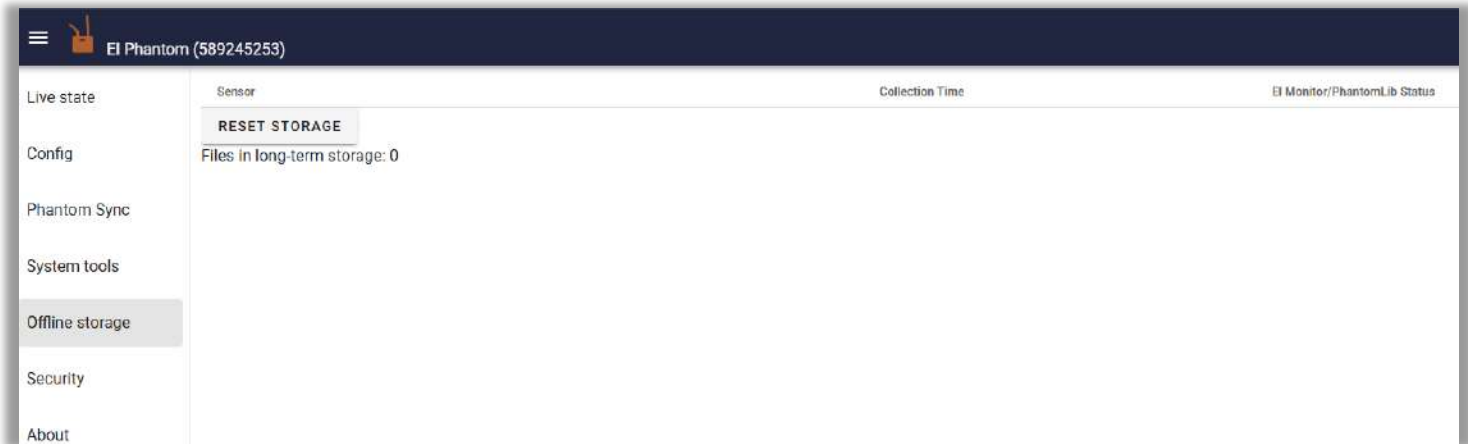

The gateway can also be set to store all data offline until manually collected. (under the **General** tab of the Config menu)

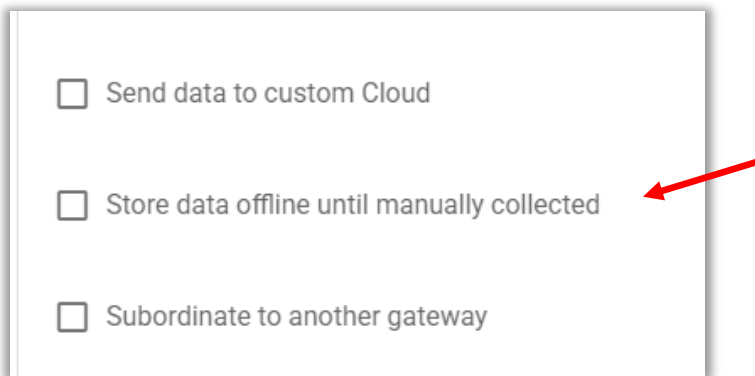


Simply uncheck this box to begin uploading the saved files. Make sure the connection to EI-Analytic or EI-Monitoring is established before unchecking this box.

## Security

The Gateway Security tab has the following options:

**Enable Console password** forces the entry of a password to access the Console Admin screen.

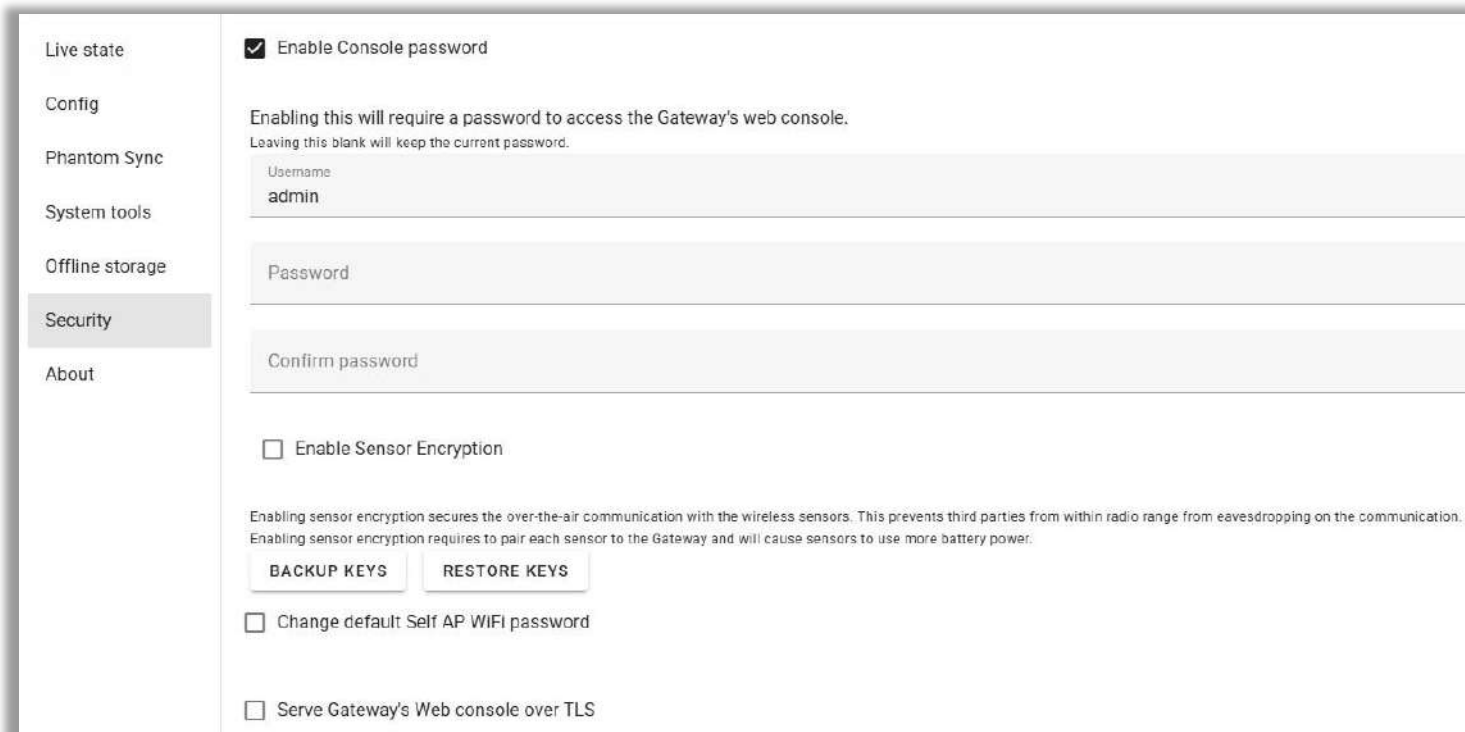

The screenshot shows the 'Security' configuration page. On the left is a navigation menu with options: Live state, Config, Phantom Sync, System tools, Offline storage, Security (highlighted), and About. The main content area has the following sections:

- Enable Console password**: A checked checkbox. Below it, text reads: "Enabling this will require a password to access the Gateway's web console. Leaving this blank will keep the current password." There are three input fields: "Username" with the value "admin", "Password", and "Confirm password".
- Enable Sensor Encryption**: An unchecked checkbox. Below it, text reads: "Enabling sensor encryption secures the over-the-air communication with the wireless sensors. This prevents third parties from within radio range from eavesdropping on the communication. Enabling sensor encryption requires to pair each sensor to the Gateway and will cause sensors to use more battery power." There are two buttons: "BACKUP KEYS" and "RESTORE KEYS".
- Change default Self AP WiFi password**: An unchecked checkbox.
- Serve Gateway's Web console over TLS**: An unchecked checkbox.

### Enable Sensor Encryption

If encrypted Bluetooth communication is required between Phantom sensors and the Gateway, it can be enabled here.

Note that this feature has an impact on sensor battery life.

**Change default Self AP WiFi password** allows you to change the default password (88888888) used by the gateway for SELF AP Wi-Fi mode.

**Serve Gateway Web console over TLS** - can be activated to enable a Gateway to use TLS for secure communication on a local network (HTTPS). The option to use self-signed or custom certificates is available.

**Note** - To get your computer to recognize a self-signed certificate from a device on your local network, you need to **manually trust the certificate's issuing authority**. If the device uses a self-signed certificate, you must import the certificate's public key into your computer's trusted certificate store.

## Gateway Resets

The Phantom Gateway 2.0 has a two-tier Reset mechanism.

**Tier 1** – Insert a paper clip or similar reset tool into the small hole located just left of the OLED display. Press and hold the internal reset button for about **5 seconds** until the display changes. The **Basic Config Reset** screen will appear on the display. If you release the button, the gateway will restart. This will delete the Wi-Fi network configuration, but keep the sensor configurations.



**Tier 2** - After you see the **Basic config reset** message, continue to press the button for **another 10 seconds** until the **Factory Resetting** message is displayed. This level of reset returns all gateway settings to factory values. Recycle the power to the gateway once the **Factory Reset** message is displayed.




## Phantom Sync Feature

Multiple Phantom vibration sensors can be configured in a Sync group in a Phantom Gateway so when initiated, a data collection is performed by all sensors in the group simultaneously, to within a single sample. **Note** - all sensors, including those providing a trigger to initiate a sync recording must be paired to the SAME Phantom Gateway 2.0.

The Sync process consists of three steps:

1. The **prepare** step. The Phantom Gateway places all sensors into a special *waiting* state. They will be listening for a signal (beacon) from the Gateway which will cause them to record waveforms simultaneously. The prepare step can take up to 8 seconds per sensor. In this mode, the Gateway broadcasts timing information to the sensors, emitting beacons very quickly with time information. This timing info is a very accurate timer counting down to zero. The sensors need to catch a few of (around 6) these time beacons so it can synchronize its own internal clock with the gateway's. Note - Phantoms consume a little bit more battery while they are in this state.
2. The **recording** step. The gateway will broadcast a **beacon** that all sensors will receive, causing them to start their synchronized countdown timers and recording simultaneously. The result is stored in their internal memory. Initiation of a Sync recording can be set **manually**, or by setting an **interval** or specific **time-of-day** values. Optionally, recording can be *triggered* by another sensor state such as when a speed sensor reaches a particular RPM (see next page).
3. Finally, the gateway will sequentially **download** the data from each sensor. This can take up to a minute per sensor.

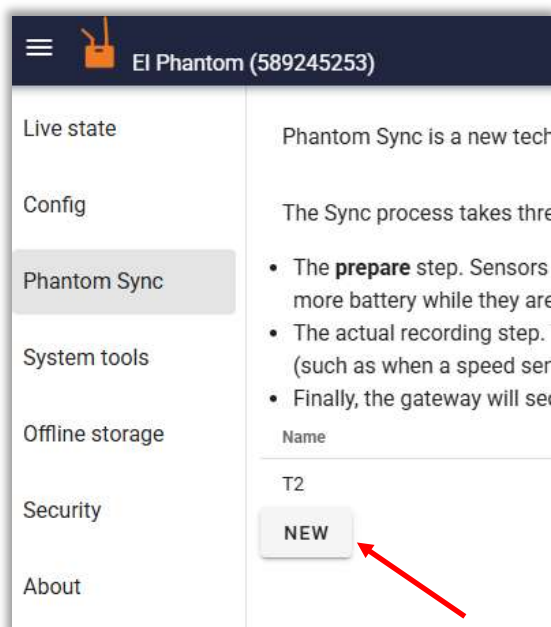

To set up a Sync group, open the **Phantom Sync** tab on the Main Menu and click **New**.

**NOTE** – Setting the Sensor Update Interval to a low value (under 60 seconds) for any sensor in the Sync Group will interfere with the Phantom Sync feature.

Enter a **Name** for the group and select the **Start on** option, None(manual), Interval or Time of day. Pick a sensor from the **Sensors to activate** drop-down field and click **ADD**. Repeat this for all the sensors to be added to the group. Click **Save**.

Sensor	Actions
189286917 - Pump_01	
189298418 - Pump002	
189300650 - Holst001	
189301939 - Air-Handler001	

Only vibration sensors with firmware 182 and up are supported.

SAVE CANCEL

## Manually Activated Sync Recording

To take a Sync recording manually:

1. Open the Phantom Sync tab and click on **Activate Now** for the group.

Name	Actions	Last activated	Activate now
group1		2 days 22 hours 48 minutes	
Test2		Never	

NEW




2. Three options are available:
  - Prepare
  - Prepare and send beacon
  - Send beacon

The **Prepare** and **Send Beacon** actions can be performed independently or both automatically depending on the option chosen.


Set the **Timeout** value high enough to allow all sensors in the group to be updated to 'Waiting for Beacon' status.

It takes up to 8 seconds for the Gateway to place a sensor into the waiting state, so if there are a large number of sensors, it could take a few minutes to complete.

Example -pressing **Prepare**. will put all sensors in the *waiting* state for up to 10 minutes.

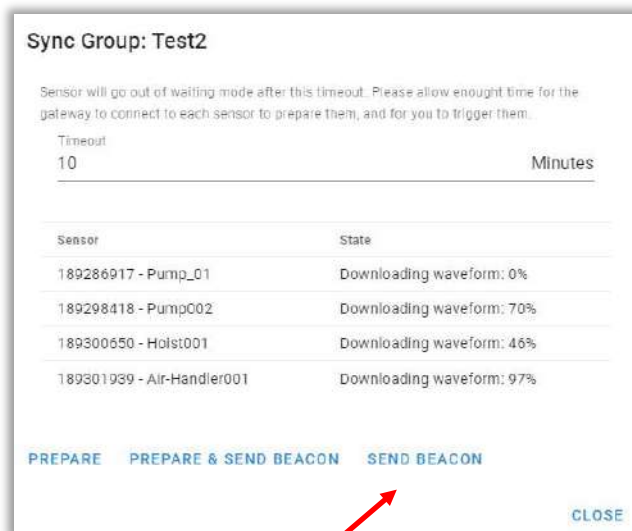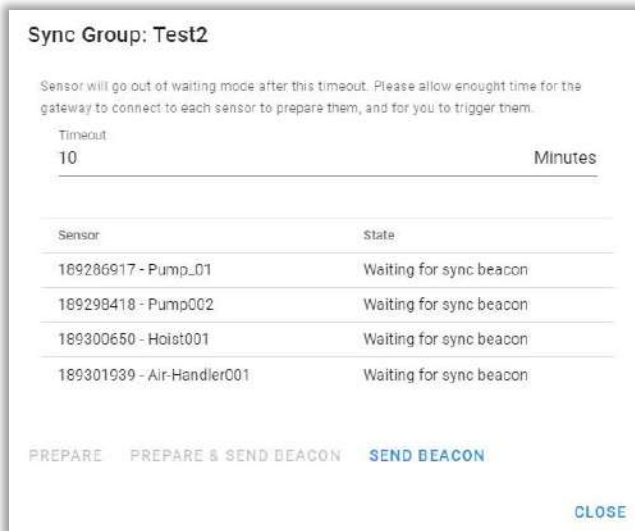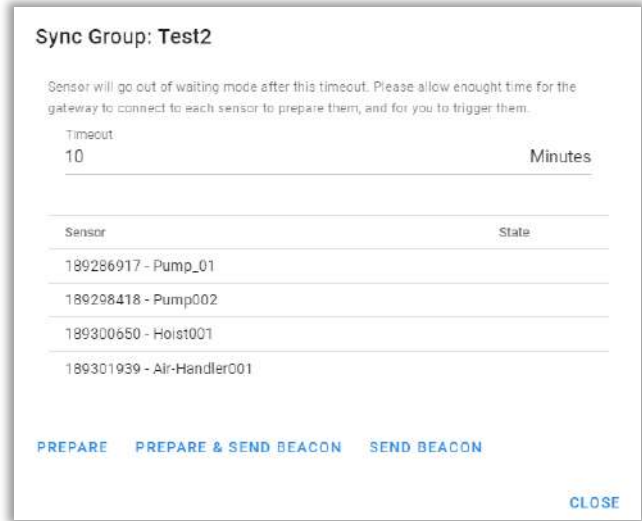

Press **Send Beacon** to initiate the Sync recording. All sensors will then download their signal files.


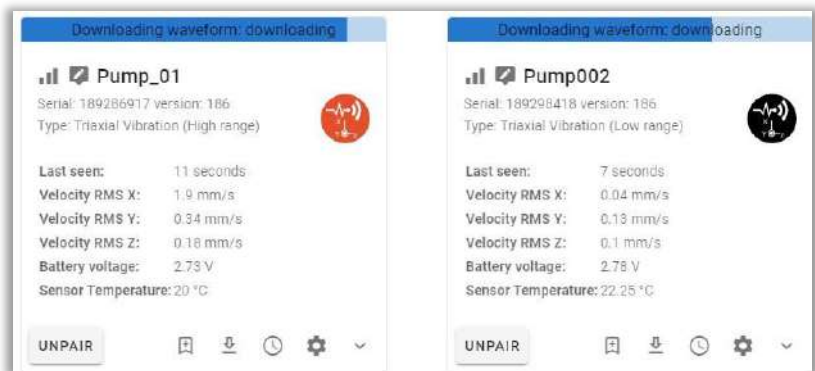


If you compare the timestamp on the signal files from all 4 sensors, they are identical to within a second.

Online File List					
Date	Point	Axis	Reason		Vel(mm/s)
2025/03/24 11:02:20	Motor_NDE	H	⊕		2.58
2025/03/24 11:02:20	Motor_NDE	V	⊕		0.45
2025/03/24 11:02:20	Motor_NDE	A	⊕		0.37
2025/03/24 11:02:21	Motor_DE	H	⊕		0.32
2025/03/24 11:02:21	Motor_DE	V	⊕		0.73
2025/03/24 11:02:21	Motor_DE	A	⊕		0.27
2025/03/24 11:02:20	Pump_NDE	H	⊕		0.37
2025/03/24 11:02:20	Pump_NDE	V	⊕		0.53
2025/03/24 11:02:20	Pump_NDE	A	⊕		0.29
2025/03/24 11:02:20	Pump_DE	H	⊕		0.09
2025/03/24 11:02:20	Pump_DE	V	⊕		0.17
2025/03/24 11:02:20	Pump_DE	A	⊕		0.23

## Automatically Triggered Sync Recording

All vibration sensors in a Sync Group can automatically be put into the *waiting for sync beacon* state, based on either **Interval** or specific **Time-of-day** values (multiple values can be entered). Once in that state, the **send beacon** command can be initiated by a triggering sensor.

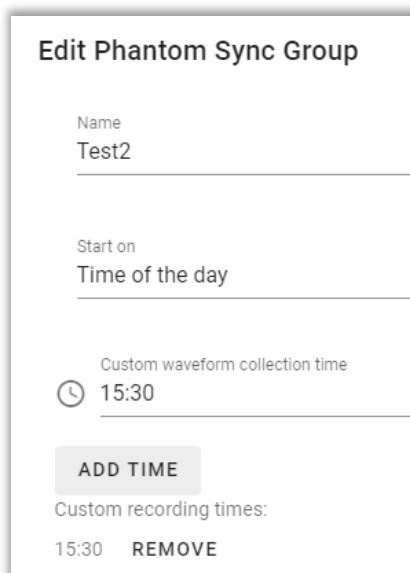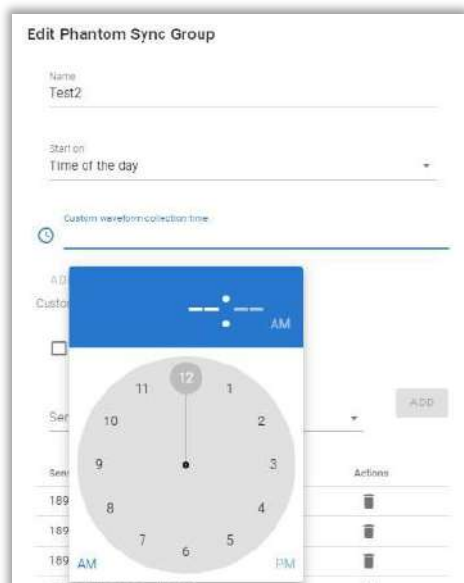


In the example, a Sync recording is set for 3:30 pm. A C31 Phantom Current sensor will trigger a Sync recording if the conditions are met. See below.

Click the **Wait on sensor condition** box and select the **Trigger collection type**.

Three models of Phantom sensor are supported to provide triggering:


- 6. EPH-S40 Speed Phantom for RPM triggering
- 7. EPH-C31 Current Phantom for Amperage triggering
- 8. EPH-G62 Dry Contact Phantom for manual or automatic contact-closure triggering

Pick the sensor serial number from the available list under **Triggering Sensor**. In the example, channel 2 of the Current Phantom will trigger the Sync Group when the current is between 2 and 15 amps. The sensors will be held in the *waiting* state until the min/max conditions are met. To conserve battery life, a timer is used to return the sensors to normal state if the triggering conditions are not met within the specified value (defaults to 30 minutes).

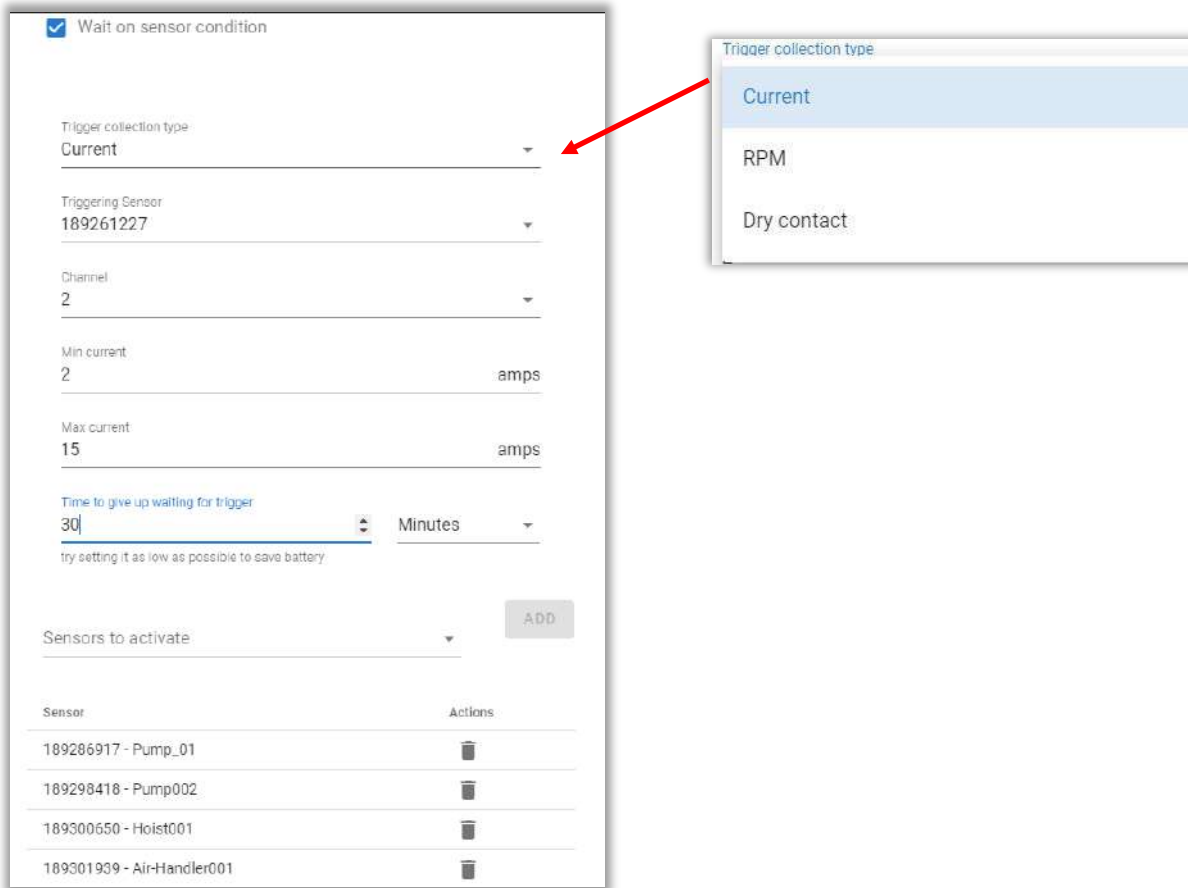

Press **Save** to complete the configuration.


At 3:30, the Gateway will put all sensors into the waiting state:

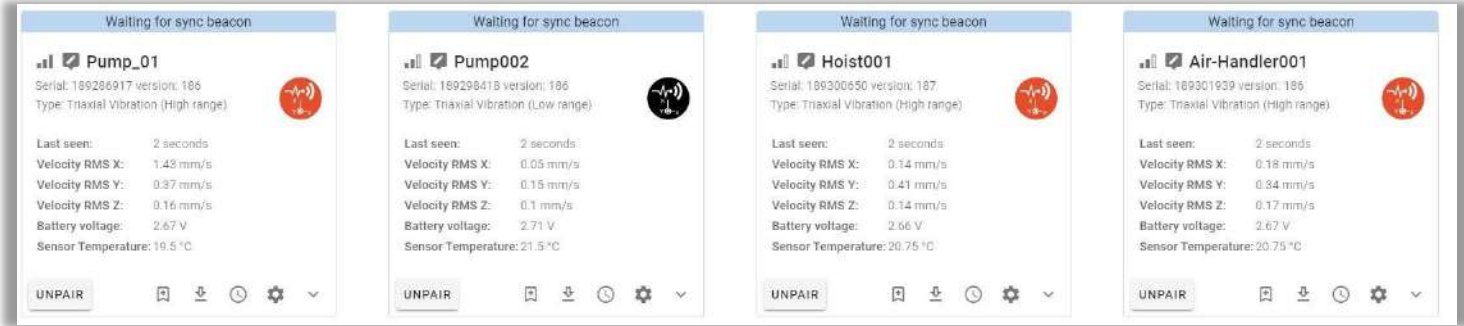


If the Current sensor detects between 2 and 15 Amps anytime between 3:30 and 4:00 pm, it will trigger the gateway to Send Beacon and simultaneous recordings will take place. The resulting signal files will then be downloaded to the database.

## System Tools

The Gateway 2.0 firmware version is updated via the **System firmware update** tab. Click the **Check Online Update** button to show the current and available versions. **Firmware file** allows uploading a firmware file directly from your computer to update the gateway. This option does not require internet access.

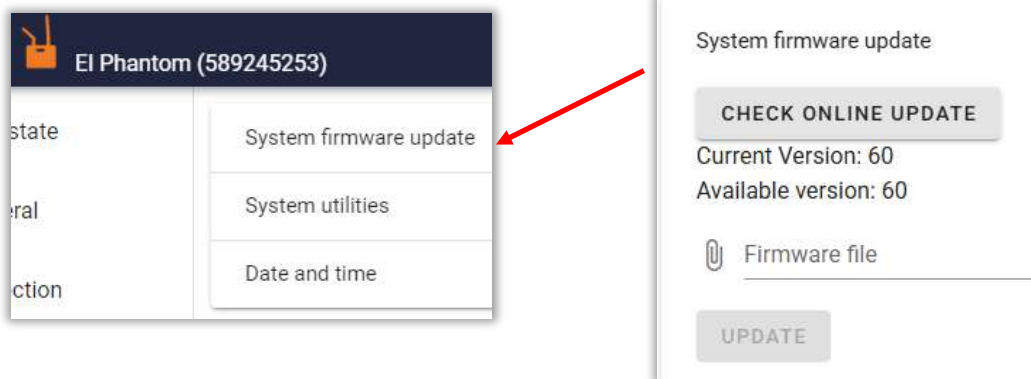

**System Utilities** include a Restart option and access to the System Log. You may be asked to access the log by an Erbesd technical support representative as part of a troubleshooting procedure.

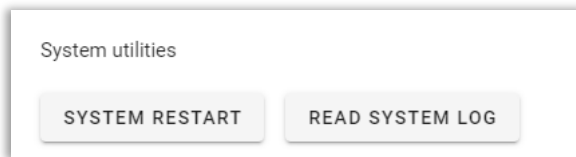

The **Date and Time** tab is used to select the time zone for the gateway from the drop-down field. Check **Enable NTP Server** if you wish to use a Network Time Protocol server via an internal data network or one via the Internet(defaults to pool.ntp.org). You may specify the URL in the NTP Time Server field. The other option is to **Set Gateway time to your computer time** and press SET.

Enable NTP Server

Set Gateway time to your computer time

**Current Gateway Date/Time (GW Timezone):** 8/23/2023, 11:44:59 AM

This will be the date used to timestamp your measurements. You need to save any time

SET

E1 Phantom Main Gateway (S99245293)

Live status

Repeater

General

Collection

Phantom Sync

E1 Analytic

Modbus

MQTT

System tools

System firmware update

System utilities

Date and time

Canada/Eastern

Enable NTP Server

NTP Time Server:  
pool.ntp.org

**Current Gateway Date/Time (GW Timezone):** 9/19/2023, 9:42:17 AM


This will be the date used to timestamp your measurements. You need to save any timezone changes and come back here after a restart to check the date/time.

SET

**Note-** If you select neither, the Gateway will use an internal clock (free run) to set the time/date.

## Modbus

The Erbesd Instruments Phantom solution supports Modbus TCP integration. A Phantom gateway can operate as a Modbus *server*, configured to store sensor data in registers in the gateway. Gateways configured for Modbus listen on well-known **TCP port 502** for incoming requests from Modbus *clients*. Gateways do not initiate contact with Modbus clients, only respond to them. Upon request, they send their register contents to the client.

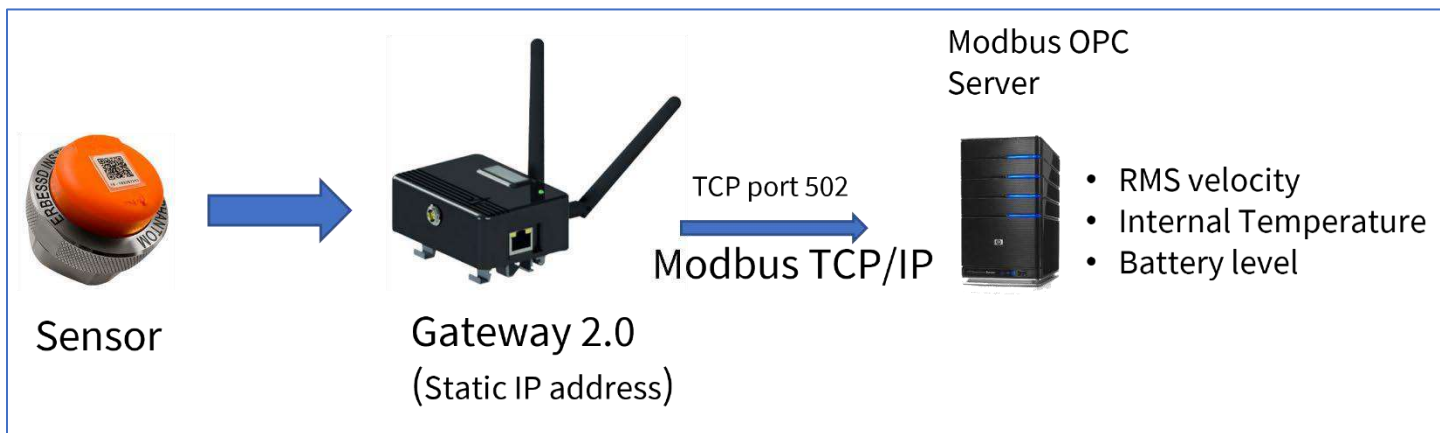

The information stored varies by sensor type. In the example below, data from an EPH-T25 Temperature Phantom is to be stored in the gateway. For details regarding the data formats for all Phantom sensors, see the Erbesd website at: <https://www.erbessd-instruments.com/docs/phantom/modbus-integration/>.

**NOTE - Static IP** addressing must be used on Phantom gateways with Modbus integration. The gateways are identified to the Modbus client by IP address (not by hostname), therefore DHCP is not viable. **ONLY** the Main gateway in a Repeater Network is configured as a Modbus server. All Modbus data from Subordinate gateways is stored in the Main GW.

To activate the Modbus server feature:

1. Open the Modbus tab on the Main Menu and check **Enable Modbus server**.

The screenshot shows the configuration interface for the Modbus server. At the top, the checkbox **Enable Modbus server** is checked. Below it, the text reads "Connect to Phantom Gateway modbus server on port 502". Under "Select a sensor", the value "189262176" is selected. The "Sensor value" field is empty. Below this is a table with columns: Register, Sensor, Data type, Field, Current Value, and Actions.


Register	Sensor	Data type	Field	Current Value	Actions
0	189262176	float	Thermocouple temperature (1)	-0.01	🗑️ ⬇️ ⬆️

Buttons for "ADD" and "SAVE" are visible at the bottom of the table.

2. Select a sensor from the **Select a sensor** drop-down field.


3. Choose the data type from the **Sensor Value** field. In the example, the Thermocouple temp from channel 1 will be stored in register 0 of the gateway. Different options are presented, based on the type of sensor chosen. Click **Add** to configure another sensor.
4. Click on **Save**, and the gateway will restart.

The data in the gateway registers is refreshed using the **Sensor Update** interval, as set in the Gateway Admin Console, for each sensor.

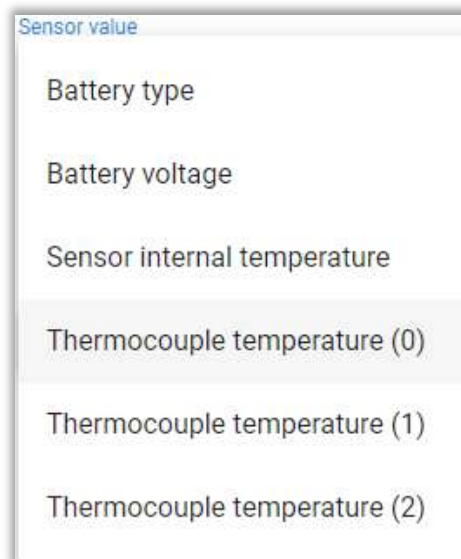

## MQTT

Phantom Gateway 2.0 supports MQTT protocol integration. The gateway acts as a MQTT client and can connect to any compatible MQTT broker from version 3.1.1 up to MQTT 5. **Note** – In Repeater Networks, Subordinate gateways send MQTT data to the Main gateway, where the interface to the MQTT broker is configured.

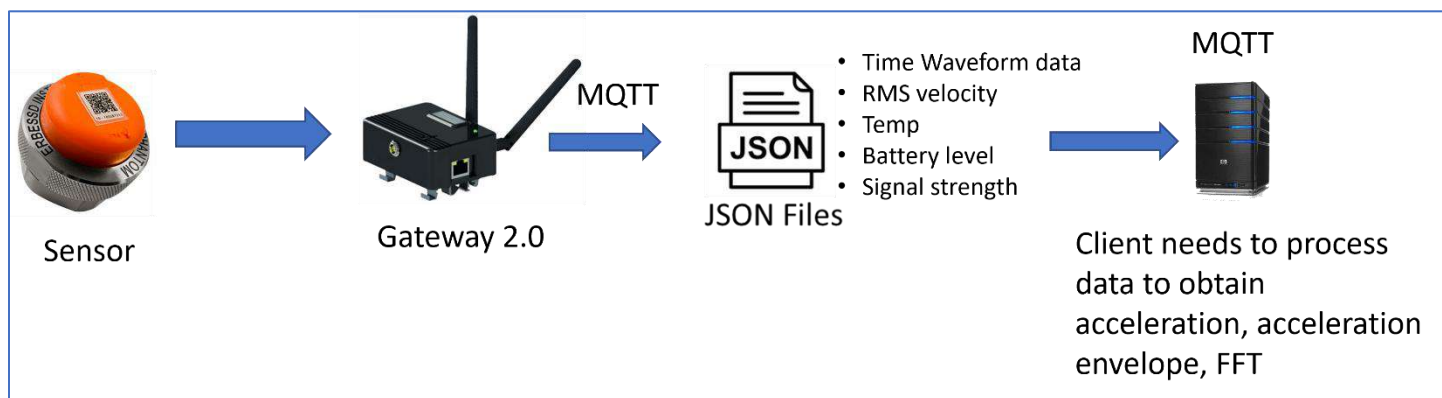

To set up MQTT, open the MQTT tab in the GatewayAdmin Console and click **Enable MQTT connection**.

**Protocol:** Can be either mqtt://, mqtts://, ws:// or wss:// depending on the transport supported by your MQTT broker.

**MQTT server:** Is the hostname or IP address of your MQTT broker.

**Port:** The network port your MQTT broker is listening on.

**Username:** The (optional) username to connect to your MQTT broker.

**Password:** The (optional) password to connect to your MQTT broker.

**Publish Topic:** The topic where the gateway will be publishing the sensor data and will subscribe for commands.

**Publish QoS:** A Quality Of Service (QoS) tag can be applied to the MQTT data allowing management of the data packet priority on the network. (Data packets with higher QoS tags get routed first) When in doubt, use 0.

**Append Gateway and serial number as subtopics** is an option for formatting the data.

**Publish waveforms:** Whether or not to publish complete time waveforms to MQTT. These measurements represent about 160kB of data per waveform. They require additional post processing to render an FFT.



**Allow Gateway management through MQTT:** Allow full gateway management so that clients connected to the same broker can change all gateway and sensor settings.

**Save:** Will save the settings and the gateway will restart.

**Reset:** Will reset all settings to their previous values.

- After you save the settings the gateway will restart. After it restarts it will try to connect to the MQTT broker and show a state in the MQTT section at the top.
- MQTT is supported at the same time as any other protocol supported by the gateway, including EI Analytic, EI Monitor, OPC UA and Modbus.
- The gateway will start publishing messages every time a sensor updates its data (Sensor Update interval) or whenever a time waveform measurement is taken, e.g., alarm or on-demand.

The messages are in JSON format, here is an example:
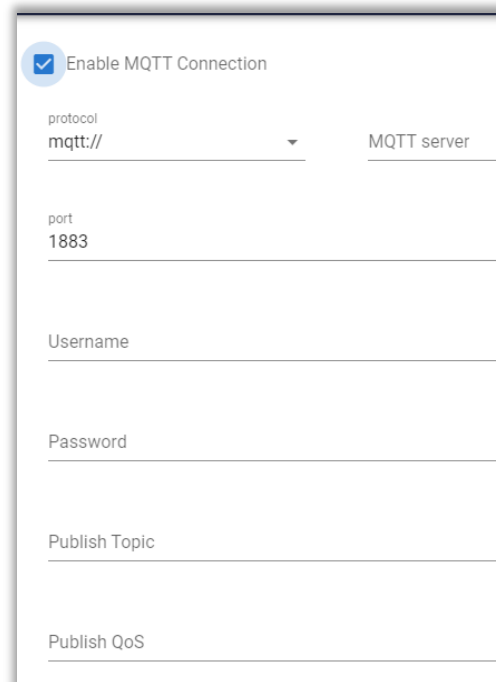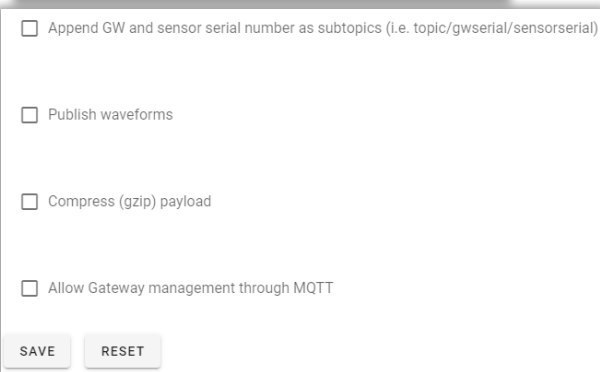
```
Topic: eitststopic QoS: 0
{"rssi": -56, "type": 3, "version": 178, "phantomCode": 189281421, "gwSerial": 4294967295, "seq": 27, "advFlags": 6, "batteryType": 1, "battery": 3.07, "temperature": 23.75, "updateInterval": 10, "txPower": 8, "minRMSFreq": 30, "maxRMSFreq": 1000, "rms": [0.42, 0.15, 0.08], "range": 8, "recordingSettings": 0}
2022-12-08 12:38:28-758
```

The JSON messages contain the following standard fields:

Variable Name	Description
dataType	can be either "collection" or "stateupdate". "collection" refers for time waveforms for vibration sensor. Every other sensor dataType is "stateupdate", vibration sensors report "stateupdate" for it's internal rms measurement
type	Sensor type
phantomCode	Sensor's serial number
gwSerial	Gateway serial number
timestamp	The time in seconds since 1970 where this measurement was taken.
battery	Battery level in volts
batteryType	Battery type. 1/6D (1), AAA(2), CR2032(3), CR2477(4)
temperature	Sensor internal temperature (in Celsius)
version	Firmware version
rsi	Sensor signal strength

With triaxial vibration sensors, the full time waveform data is sent in a nested Array containing 3 subarrays, one for each Axis.

### Triaxial Accelerometer (3, 5 and 6) for dataType "collection"

Variable Name	Description
sampleRate	The sample rate at which this measurement was taken.
data	This will contain the time wave form data. It contains three arrays, one for each axis. Two of the axis arrays may be empty if a single axis mode was selected. The numbers in the array are in G's (9.8m/s <sup>2</sup> )

Example of triaxial vibration data arrays:

```
mosquito.conf [serialNumber189352172,sampleRa +
File Edit View H1 B I A
{"serialNumber":189352172,"sampleRate":26054,"gwSerial":589249918,"timestamp":1764131854,"type":6,"dataType":"collection","data":[[0.03491
2109375,0.01611328125,-0.00439453125,-0.0078125,0.002197265625,0.0244140625,0.02294921875,0.0224609375,0.033935546875,0.02734375,0.0126953
125,0.0.005859375,-0.003173828125,-0.007568359375,-0.009521484375,-0.004638671875,0.003662109375,-0.02197265625,-0.033935546875,-0.0217285
15625,0.01318359375,0.035400390625,-0.007080078125,-0.00927734375,0.02490234375,0.023193359375,0.0400390625,0.065673828125,0.07177734375,0
.056884765625,0.0295078125,-0.002197265625,0.010498046875,0.0107421875,-0.0068359375,-0.00341796875,0.015869140625,0.02490234375,0.0349121
09375,0.028076171875,0.024658203125,0.046630859375,0.05126953125,0.023681640625,0.016845703125,0.037109375,0.046630859375,0.045166015625,0
.03857421875,0.023681640625,0.005126953125,0.008056640625,0.02734375,0.0537109375,0.066162109375,0.060302734375,0.045654296875,0.021240234
375,0.00390625,0.007568359375,0.021240234375,0.05078125,0.07080078125,0.027099609375,-0.016845703125,-0.013916015625,-0.018310546875,-0.01
46484375,0.0107421875,0.0283203125,0.03076171875,0.02587890625,0.017822265625,-0.003662109375,-0.013671875,-0.00634765625,0.008544921875,0
.044921875,0.06787109375,0.05517578125,0.031494140625,0.0087890625,0.0212728515625,0.039306640625,0.018310546875,0.00830078125,0.02734375,0
.0361328125,0.028564453125,0.01904296875,0.0263671875,-0.00537109375,-0.043701171875,-0.038330078125,-0.02392578125,0.00048828125,0.000244
140625,0.0.0234375,0.040283203125,0.036376953125,0.028564453125,0.036865234375,0.04052734375,0.007080078125,-0.008544921875,0.013427734375
,0.04150390625,0.060546875,0.0458984375,0.027099609375,0.0361328125,0.052001953125,0.035888671875,-0.0185546875,-0.0439453125,-0.032470703
125,-0.01513671875,0.016357421875,0.025146484375,0.017578125,0.019775390625,0.009033203125,0.015869140625,0.01904296875,0.0029296875,-0.00
4638671875,0.003662109375,-0.00439453125,-0.025634765625,-0.000244140625,0.029052734375,0.037109375,0.034912109375,0.01611328125,0.0075683
59375,0.03271484375,0.044677734375,0.020751953125,0.021240234375,0.056884765625,0.050048828125,0.029052734375,0.019287109375,0.01489257812
5,0.0244140625,0.02294921875,0.0224609375,0.028076171875,0.030517578125,0.049560546875,0.064208984375,0.059326171875,0.021728515625,-0.019
287109375,-0.00344796875,0.033447265625,0.05078125,0.047119140625,0.02783203125,0.0126953125,0.0234375,0.0107421875,-0.0009765625,0.017089
84375,0.01953125,0.032470703125,0.03271484375,0.02685546875,0.0361328125,0.0048828125,-0.009521484375,-0.004638671875,-0.002197265625,0.02
8076171875,0.024658203125,0.01123046875,0.028564453125,0.03076171875,0.031982421875,0.038330078125,0.058837890625,0.074462890625,0.0522460
9375,0.0302734375,0.019775390625,0.02099609375,0.021484375,0.033447265625,0.044921875,0.032470703125,-0.002685546875,-0.01318359375,0.0173
33984375,0.031494140625,-0.003173828125,-0.036865234375,-0.029052734375,-0.025390625,-0.029541015625,0.003662109375,0.01904296875,0.014648
4375,0.0185546875,0.026123046875,0.02978515625,0.031494140625,0.0380859375,0.035400390625,0.039794921875,0.0419921875,0.048828125,0.034423
828125,0.015869140625,0.00732421875,0.00927734375,0.021728515625,0.04541015625,0.062255859375,0.052490234375,0.0419921875,0.048828125,0.05
224609375,0.018310546875,-0.03857421875,-0.035888671875,-0.010986328125,0.00048828125,0.035400390625,0.0400390625,0.0302734375,0.008056640
625,-0.031494140625,-0.026611328125,0.010986328125,0.022705078125,0.004638671875,0.001953125,0.018310546875,0.026123046875,0.011962890625,
-0.00048828125,0.005615234375,0.00830078125,-0.008056640625,-0.00390625,0.027587890625,0.042236328125,0.037109375,0.034912109375,0.0515136
71875,0.04736328125,0.03369140625,0.033447265625,0.0390625,0.04736328125,0.03955078125,0.030029296875,0.031494140625,0.0380859375,0.029541
015625,0.025390625,0.0234375,0.016845703125,0.001953125,-0.022705078125,-0.0107421875,0.035888671875,0.052001953125,0.035888671875,0.03442
3828125,0.033447265625,0.0390625,0.047607421875,0.045654296875,0.027099609375,0.0361328125,0.052001953125,0.047607421875,0.045654296875,0.
038818359375,0.02978515625,0.025634765625,0.029541015625,0.054931640625,0.066650390625,0.048583984375,0.057861328125,0.050537109375,0.0412
50765625,0.02076171875,0.027841796875,0.046875,0.027587890625,0.018798828125,0.002685546875,0.0120930452125,0.020906875,0.001708084375,-0.0
```

For more information regarding MQTT, visit the Erbesd website at:


<https://www.erbessd-instruments.com/gateway-2-0-mqtt-support/>

## OPC UA

Phantom Gateway version 2 supports the OPC UA industrial protocol. All sensor *processed* data is available through OPC. Subordinate gateways forward OPC data to the Main gateway for connection to the OPC UA server.


**Note** - Due to how the OPC UA protocol works, the full time waveform or FFT is not available.

The gateway acts as a OPC UA server and listens for TCP connections on port 4334.

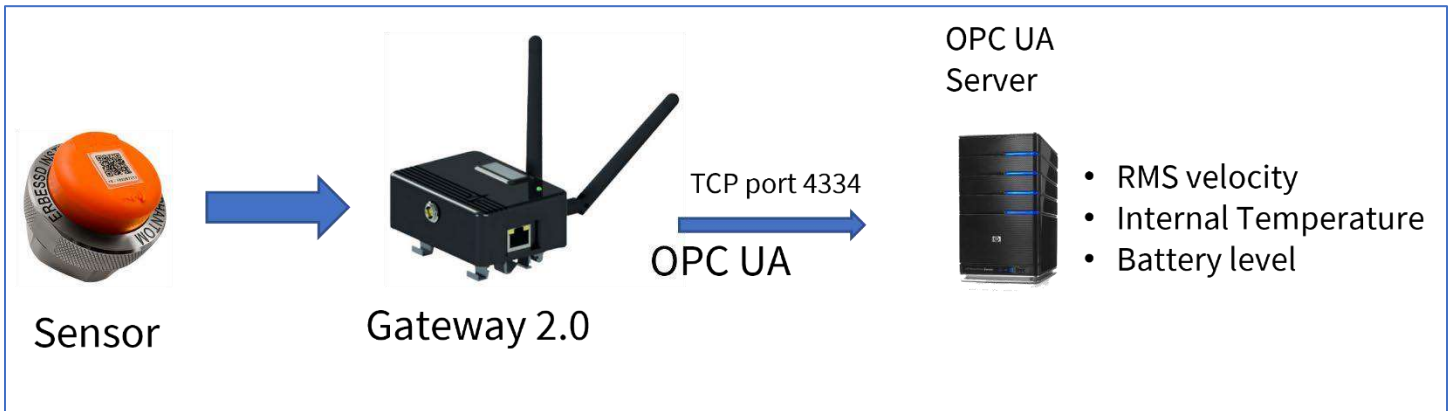


To activate OPC UA, simply check the box in the General tab of the Gateway Admin Console.

The OPC UA feature supports multiple User logins or an Anonymous login. Unencrypted communication can also be disabled (use encryption only).

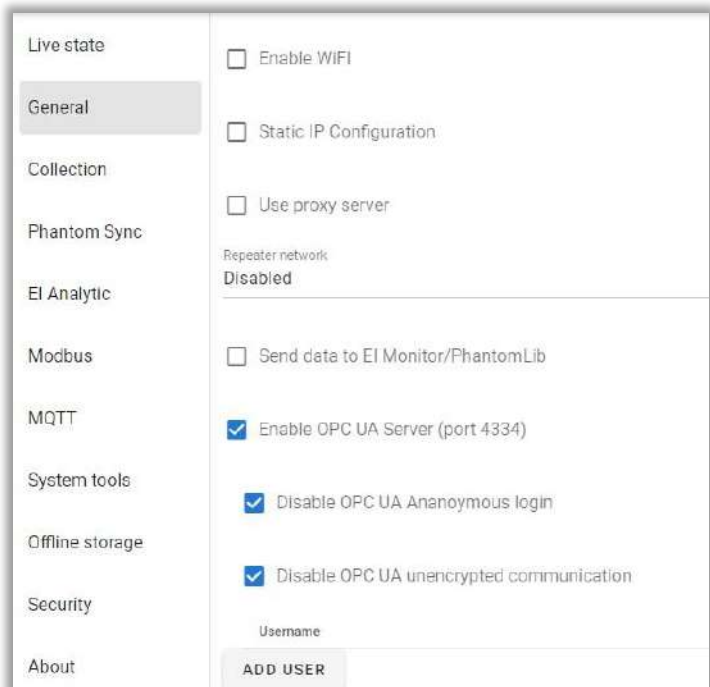

Click **ADD USER** to administer OPC UA Users and passwords:

- The OPC UA server interface can be active at the same time as any other protocols supported by the gateway, including EI Analytic, EI Monitor, MQTT and Modbus.
- After the OPC UA server has been enabled, access the server using the following URL format with a OPC UA client: `opc.tcp://192.168.1.2:4334/UA/PhantomGW`, where 192.168.1.2 is replaced by the IP Address of your gateway. For an Anonymous login use Security Mode none and Security Policy None.
- The OPC UA is organized in a tree like structure. For the Phantom Gateway Under the root folder is an Object folder, under which all the sensor serial numbers will be shown. Under each serial number there will be a number of different variables depending on the sensor type.

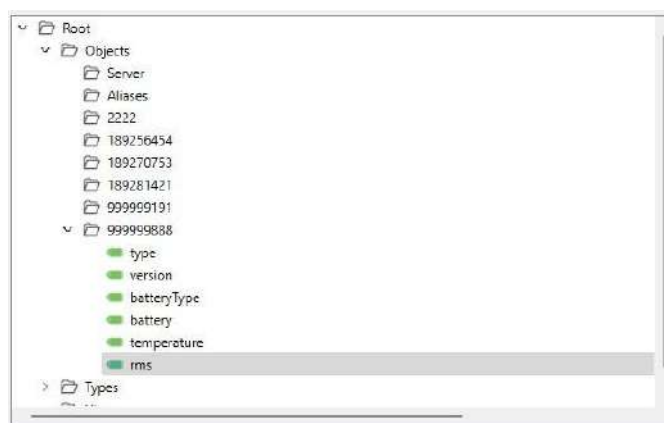

OPC messages contain the following standard fields:

Variable Name	Description
<b>type</b>	Sensor type
<b>battery</b>	Battery level in volts
<b>batteryType</b>	Battery type. 1/6D (1), AAA(2), CR2032(3), CR2477(4)
<b>temperature</b>	Sensor internal temperature (in Celsius)
<b>version</b>	Firmware version
<b>VRMS</b>	The Velocity RMS value measured from 10Hz to 1KHz

The VRMS value is derived from an in-sensor calculation of the spectrum from 10 to 1KHz (hard-coded). The interval is set via the In-sensor settings **Sensor Update** interval as administered from the Gateway Admin Console.

For more details regarding OPC UA, visit the Erbesd website at: <https://www.erbessd-instruments.com/opc-ua-tutorial/>

## Phantom Gateway Gen2 Management API

The Phantom Gateway Gen2 Management API supports multiple languages and provides full access to all features and controls of the Gateway Gen2.

The Gateway's administration console web page uses the same API, so anything that can be done using the admin GUI can also be done through the API. This includes:

- changing Gateway settings
- observing all sensors current state
- changing sensor configuration
- requesting on-demand time waveforms from vibration sensors, etc.

The management API is accessible either through a web socket connection directly to the gateway IP address, or using a MQTT broker, to which the gateway connects.

## Web Socket interface

The gateway has a web socket interface at the following url:

ws://GATEWAY-IP-ADDR/realtime

Connecting to this URL using a web socket client library allows the receipt of updates from the Gateway as well as issuing commands to it.

Upon connection, the gateway will start sending messages to the client with the following websocket interface format:

```
{  
  "type": "stateupdate",  
  ...  
}
```

All messages are in JSON format and all start with a *type* property. How the message is to be handled on the client side depends on this *type* property.

The very first message the gateway will send has *type* “stateupdate”. This contains the complete gateway internal state in the “payload” property.

Subsequently, the Gateway will start sending message with *type* “statepatch”. These messages contain a JSON Patch (RFC 6902) that needs to be applied to the original state send in the “stateupdate” message. This will keep the gateway state up to date without sending the complete state every time.

Commands that have the following general format can be sent to the Gateway:

```
{  
  "type": "observeerequest",  
  "phantomcode": "189281421",  
  "action": "signal"  
}
```

The message is sent over the websocket in JSON format. The *type* always need to be “observeerequest”. Then the parameters change, depending on the action. The above example requests a time waveform measurement from the sensor serial number 189281421.

## MQTT Interface

The Gateway can be configured to connect to an MQTT broker, allowing the management API to be used to publish messages to this MQTT broker from a client. Please ensure the “Allow Gateway management through MQTT” setting in the Gateway’s MQTT config is enabled.

Unlike the web socket interface, the gateway won’t automatically publish it’s state continuously. But it can be requested to publish the following JSON message to the same topic as the Gateway is configured:

```
{  
  "type": "observeerequest",  
  "action": "getstate",  
  "gwSerial": 589245105
```

All messages to the Gateway, unlike the web socket interface, must include the “gwSerial” property with the serial number of the gateway receiving the message. This is necessary as there maybe multiple gateways subscribed to the same topic.

## The State Object

The gateway maintains its internal state and of its sensors in a single object that can be accessed using the management API.

The basic structure of the state object is as follows:

```
{  
  "nodes": {  
  },  
  "deviceInfo": {  
  },  
  "phantomSync": [  
  ],  
  "basicconfig": {  
  }
```

The “nodes” property contains objects with information on all the sensors that the Gateway is seeing (or has seen).

The “deviceInfo” property contains information on the running state of the Gateway itself. The

“phantomSync” property is an array of all Phantom Sync groups.

The “basicconfig” property contains configuration for the Gateway.

Inside the “nodes” property is a list of all sensors the gateway has seen. The following is an example from a vibration sensor:

```
"189281421": {
  "lastseqchange": 1679600932675,
  "advdatav2": {
    "company_id": 65535,
    "phantomCode": 189281421,
    "version": 183,
    "type": 3,
    "canForceUpdate": true,
    "cmd": 1,
    "gw2adv": true,
    "canupdateSettings": true,
    "candownloaddata": true,
    "seq": 1,
    "advFlags": 7,
    "batteryType": 1,
    "battery": 3.28,
    "temperature": 30.75,
    "updateInterval": 3600,
    "txPower": 8,
    "minRMSFreq": 14,
    "maxRMSFreq": 1000,
    "rms": [
      0.52,
      0.24,
      0.19
    ]
  }
}
```

```
    ],  
    "range": 8,  
    "recordingSettings": 0,  
    "gw1Disabled": true,  
    "advertisingEnabled": true  
  },  
  "phantomCode": 189281421,  
  "type": 3,  
  "version": 183,  
  "rssi": -50,  
  "ch_index": 34,  
  "lastseen": 1679600932676,  
  "isDFUmode": false, "hasupdate":  
false, "actions": {},  
  "bootloaderadvdata": {  
    "company_id": 65535,  
    "version": 183,  
    "type": 3,  
    "lastseen": 1679600922081  
  },  
  "lastcollection": 1679600904167,  
  "lastManualCollection": 1679589071263,  
  "bledevice": {  
    "ble_addr": {  
      "type": "Buffer", "data": [  
        133,  
        148,  
        84,  
        69,  
        29,  
        238  
      ]  
    }  
  }  
]
```

```
    },
    "rssi": -50,
    "ch_index": 34
  },
  "settings": {
    "isFavorite": true,
    "isPaired": true, "timed": {
      "collectionMode": "global",
      "collectionInterval": 6,
      "collectionUnits": 3600,

      "timeArray": []
    },
    "alarms": {
      "enabled": false,
      "waitAfter": 12,
      "waitAfterUnits": 3600, "rms": [
        0,
        0,
        0
      ],
      "rmsLevel2": [ 0,
        0,
        0
      ],
      "alarmCount": 1,
      "enabledLevel2": false
    },
    "trigger": {
      "type": "none",
```

```
    "phantomCode": "",  
    "waitAfter": 12,  
  
    "waitAfterUnits": 3600,  
  
    "channel": 0,  
  
    "min": 0,  
  
    "max": 0, "dryState":  
    "closed", "transient": false  
  },  
  
  "triaxialRecording": { "custom":  
    true, "mode": "triaxial",  
  
    "axis": "x", "sampleRate":  
    12800,  
  
    "range": 8,  
  
    "samples": 2  
  }  
}  
  
},
```

The “lastseqchange” property is expressed in milliseconds since 1970, in the gateway’s time, when the “seq” property of the sensors last change. This tells you when was the last time the gateway update it’s internal measurement.

The “lastseen” property is also expressed in milliseconds since 1970 and gateway’s time. This represents the last time the sensor was seen by the Gateway’s Bluetooth radio.

The “phantomCode” property contains the sensor serial number.

The “type” property contains the sensor type according to the following table:

3	Vibration Triaxial high range
5	Vibration Triaxial low range
6	Vibration Triaxial low range, different internal accelerometer
7	All in one sensor
10	Thermal camera
30	Current sensor
32	Current sensor v2
40	Speed sensor (RPM)
20	Thermocouple temperature sensor
21	Thermocouple temperature sensor v2
25	Infrared temperature sensor
31	Dry contacts sensor
26	4-20mA general purpose sensor
27	0-10v sensor general purpose sensor
60	-2v to 2v high speed sensor

The “version” property contains the version of the sensor firmware.

The “rssi” property contains the signal strength of the sensor. The following is a rough guidance on signal strength:

Up to -55 is excellent.

From -56 to -75 is good.

From -76 to -85 as is ok.

And from -86 and up is poor.

The “isDFUmode” property is a Boolean that if true, indicates that the sensor is currently in DFU (device firmware update) mode. This means that a device firmware update can be initiated. This mode is entered for a few seconds after the sensor is reset with a magnet. Or the Gateway can put the sensor in this mode if an update is required.

The “hasupdate” property means there’s a newer firmware for this sensor that can be applied.

The “lastcollection” property indicates the last time a time wave form was downloaded from this sensor.

The “advdatav2” contains the information that is in the advertising package of the sensor. It contains the following properties:

“seq” this property is a number that the sensor updates every time it takes a measurement internally. It wraps around after 255.

“batteryType”: Contains the battery type of the sensor according to the following table:

1	1/6D
2	AAA
3	CR2032
4	CR2477

“battery”: Contains the battery voltage.

“temperature”: Contains the internal sensor temperature, in Celsius. “updateInterval”:

Contains the sensor internal measurement update interval. “txPower”: Contains the sensor radio power, can be 0db, 4db or 8db.

The “settings” property contains settings that are stored in the gateway for this sensor. It contains the following properties:

“isFavorite”: A Boolean indicating if the sensor is market as favorite in the Gateway GUI.

“isPaired”: A Boolean indicating if the sensor is paired to this Gateway. The Gateway will only send data of paired sensors to a number of services, such as EI Monitor, EI Analytics and MQTT.

“timed”: This propert contains configuration on how to collect time wave forms based on time. It contains the following properties:

“collectionMode”: It can be either “global” to follow the global configuration. “interval” this will override the global configuration with a local to this sensor interval. “timeoftheday” will override the global configuration with a local list of times to capture waveforms. “disabled” will completely disable time-based waveforms collection for this sensor (but will allow alarm, trigger or manual collections).

“collectionInterval”: The interval in which collection will happen for this sensor if the collectionMode is set to “interval”, see below for units.

“collectionUnits”: The units in seconds for the “collecetionInterval” property. Can be 60 (minutes), 3600 (hours) or 86400 (days).

“timeArray”: An array of strings in the format “HH:ss” indicating the times of the day (in 24hour format in which collection will happen if “collectionMode” is set to “timeoftheday”

“alarms”: Contains the alarms settings, it contains the following properties: “enabled:” A Boolean indicating if alarm based collection is enabled.

“waitAfter”: The time the alarm will be ignored after it was triggered once.

“waitAfterUnits”: The units in seconds for the “waitAfter” property. Can be 60 (minutes), 3600 (hours) or 86400 (days).

“rms”: An array of three elements that indicate the alarm levels in mm/s for each of the axis of a vibration sensor.

“rmsLevel2”: An array of three elements that indicate the alarm level 2 levels in mm/s for each of the axis of a vibration sensor.

“alarmCount”: The number of times the alarm has to be maintained (in sensor update interval times) for the alarm to actually trigger (to avoid transient events triggering the alarm).

“enableLevel2”: Boolean indicating if alarms level 2 are enabled. “trigger”: Contains the triggers options as follows:

“type”: Can be either “none” to disable triggering, “current” to use a current sensor for triggering. “rpm” to use a rpm sensor for triggering or “gpio” to use a dry contact sensor.

“phantomCode”: The serial number of the sensor that will be used for triggering. The sensor has to be of the appropriate type for the trigger type.

“waitAfter”: How long to ignore the trigger condition if it keeps presenting after triggering once.

“waitAfterUnits”: The units in seconds for the “waitAfter” property. Can be 60 (minutes), 3600 (hours) or 86400 (days).

“channel”: Channel to use for triggering for current or dry contact sensors. “min” and

“max”: Indicate the window for the current or rpm triggers.

“dryState”: What state to trigger for the dry contact sensor, can be “open” or “closed”.

The “deviceInfo” property contains running information about the Gateway, it can contain the following properties:

“serialNumber”: Contains the Gateway serial number.

“version”: Contains the main application firmware version of the gateway.

“btVersion”: Contains the firmware version of the Bluetooth controller in the gateway. “osversion”: Contains the operating system version of the Gateway.

“btTemperature”: Contains the temperature as reported by the Bluetooth controller. In Celsius

“cpuTemperature”: Contains the main CPU temperature of the gateway. In Celsius.

“netinfaces”: Contains a list of the active network interfaces of the Gateway along with its network settings.

“wifimac”: Contains the mac address of the wifi network interface.

“ethmac”: Contains the mac address of the ethernet network interface.

“apmac”: Contains the mac address of the Gateway wifi network interface in Access point mode. “uptime”:

The gateway update in minutes.

“totalmem”: The total amount of RAM in the gateway “freemem”:

The amount of free RAM in the gateway

## Commands to the Gateway

The gateway can receive a number of commands. If published in MQTT, all messages must include the “gwSerial” property with the serial number of the Gateway.

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "signal"
```

This command will request a time waveform measurement to be taken from this sensor. The request will be pending for the sensor until the gateway has time to actually collect the waveform.

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "cancelsignal"
```

This will cancel the above request if it still hasn't been serviced

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "updatestate"
```

This command will request an internal measurement state (this updates the internal rms measurement in vibration sensor as well as all measurements in other kind of sensors). You will see a seq increase after this is completed

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "cancelupdatestate"
```

This will cancel the above request if it still hasn't been serviced

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "sleep"
```

This request will schedule a sleep request to the sensor.

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "cancelsleep"
```

This will cancel the above sleep request if it still hasn't been serviced.

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "forget"
```

Forget a sensor. This deletes all the gateway specific configuration for this sensor.

```
{  
  "type": "observeerequest",  
  "phantomcode": 189281421,  
  "action": "pair"
```

Pair a sensor to the gateway. This will cause the sensor to send data from this sensor to all its configured sources (MQTT, EI Monitor, EI Analytic, etc)

```
{  
  "type":  
  "observeerequest",  
  "phantomcode":  
  189281421,  
  "action": "unpair"
```

Unpair a sensor to the gateway

```
{
  type: "observeerequest",
  phantomcode: 189281421, action:
  "changesettings", params: {
    general: {
      radioPower: 0, // Values a 0, 4 and 8 (for 0dbm, 4dbm and 9dbm) updateInterval:
      3600, // Interval on which the sensor will update its
internal measurement
      gw1: false, // Wherer or not this sensor will connect to a legacy
Gateway v1.
      advertising: true // Wherer this sensor will perform advertising (this is
required to work for GW2)
    },
    // This only applies to triaxial sensors triaxial: {
      minRMSFreq: 10, // Low frequency filter for internal rms calculation (default
10hz)
      maxRMSFreq: 1000, // High frequency filter for internal rms calculation (default
1khz)
      range: 8, // Measurement range 2g, 4g, 8g for low range sensors. 8g, 16g, 32g
for high range sensors
      recordingSettings: 0, // Internal rms sample rate 0 = 25.6khz, 1 = 12.8khz,
2 = 6.4kHz, 3 = 3.2kHz, 4 = 1.6kHz. Recording time will double with every halving of
sampling rate.
      extRMS: false // extended internal rms calculation false = rms calculation will be
done over 8192 points. true internal rms calculation will be done over 16,384points
    },
    // Current (Amps) sensor settings current: {
      currentProbeType: [0, 0, 0, 0], // Current probe type for all 4
channels
multiplier: [1, 1, 1, 1], // Multiplier for each channel
```

```
offset: [0, 0, 0, 0], // Offset for each channel
},
// Settings for -2v to 2v sensor gp: {
  minRMSFreq: 0, // Low frequency filter for internal rms calculation (default
10hz)
  maxRMSFreq: 0, // High frequency filter for internal rms calculation (default
1khz)
  velocity: false, // true = Calculate RMS of velocity (assume it has an
accelerometer connected), false = calculate RMS of voltage
  sensitivity: [0, 0] // Sensitivity for accelerometer in each of two
channels
}
}
```

Change internal sensor settings. All sensor types support the "general" field. Other sensors have their own settings. Only settings for the particular sensor type should be present.

```
{
  "type": "observeerequest",
  "phantomcode": 189281421,
  "action": "cancelchangesettings"
```

Cancel change settings request if it hasn't been serviced yet.

```
{
  type: "observeerequest", phantomcode:
  189281421, action:
  "setsensorgwsettings", settings: {
    timed: {
      collectionMode: "global", // Can be global = follow global setup,
      "interval" = custom collection interval for this sensor, "timeoftheday" = custom times to
      collect for this sensor, or "disabled" do not do any timed collection for this sensor.
      collectionInterval: 6, // Interval
      collectionUnits: 3600, // Units for the interval in seconds timeArray: [], //
      An array of times in the "HH:ss" format for time of
the day collection (24hour format)
    },
    trigger: {
      type: "none", // trigger type "none", "current", "rpm", "gpio" phantomCode: "", //
      phantom code of the node to be used for trigger waitAfter: 3600, // Time to ignore
      the trigger after it has been done
once
waitAfterUnits: 60, // Wait units of the waitAfter in seconds channel: 0, // Channel for
GPIO and current triggers
min: 0, // Window for triggering for current and rpm triggers
    max: 0,
    dryState: "closed", // "closed"/"open" state for triggering for gpio
sensor
    transient: false // true: For gpi otrigger: trigger all sensors on single click
even if the state doesn't hold
  },
  alarms: {
    waitAfter: 3600, // Time to ignore alarm condition after it has been
triggered
    waitAfterUnits: 60, // Units of the above in seconds enabled:
    false, // Trigger level 1 enabled
  }
}
```

```
    rms: [0, 0, 0], // Array for alarm level 2 on mm/s
    rmsLevel2: [0, 0, 0], // Array for alarm level 2 on mm/s
    alarmCount: 1, // Number of times the alarm has to show up for it to be
triggered
    enabledLevel2: false // Alarm level 2 is enabled
  },
  triaxialRecording: {
    custom: false, // Whether this triaxial sensor has custom collection
settings
    mode: "triaxial", // Mode "triaxial" or "singleaxis" axis: "x", //
    // If single axis select axis "x", "y", "z" sampleRate: 25600, sample
    // rate 25600, 12800, 6400, 3200
    range: 8, // Range 2, 4, 8 for low range, 8, 16, 32 for high range samples: 0 // 0
    // = normal samples 1 = extended samples
  },
}
}
```

Change settings for this sensor inside the gateway (these settings are stored in the gateway, rather than the previous ones that are stored in the sensor).

## EI-Analytic Notifications Manager

**Notifications** are available for EI-Analytic cloud data service accounts. Email and Push notifications can be configured to be sent when certain configurable conditions of a Machine, Phantom Sensor or Item are met.

This feature is not available when a local database is used.



Note-With EI-Analytic accounts, Phantom V10/V11 sensors natively support email/push notifications for RMS Velocity alarms, however for other vibration parameters such as RMS Acceleration, only Tasks can provide notifications.

For non-vibration Phantom sensors this is the only method to receive email/push notifications

Tasks are assigned by Machine, Phantom, or to custom *Items* added to the database.


Machine Learning Tasks are created automatically when a Learning Model is applied to a Machine Point.

Expand a Notification group to see existing Tasks:

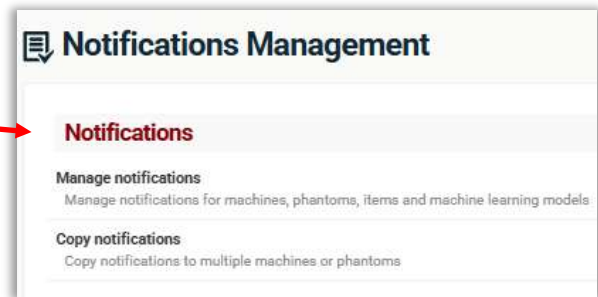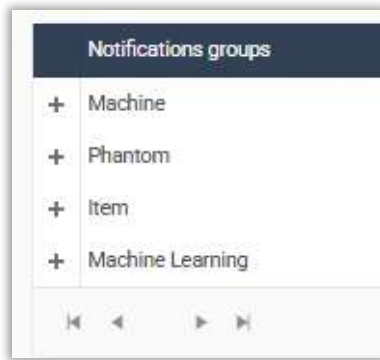


Code	Asset	Location	Unit	Actions
189262176	T25_Test	ABC Company - Area1 - T25_Temp	Temperature	[Edit] [Delete]
189275916	TDam1	Tomcoo - Garage - TDam	Max Temperature	[Edit] [Delete]

Press the New Task button at top right to create a new task.



For Machine tasks, select the Machine. For Phantom tasks, enter the Phantom serial number, for an Item add the Item name. In this example, a Task is added to report alarms for a Phantom T25 temperature sensor (thermocouple).

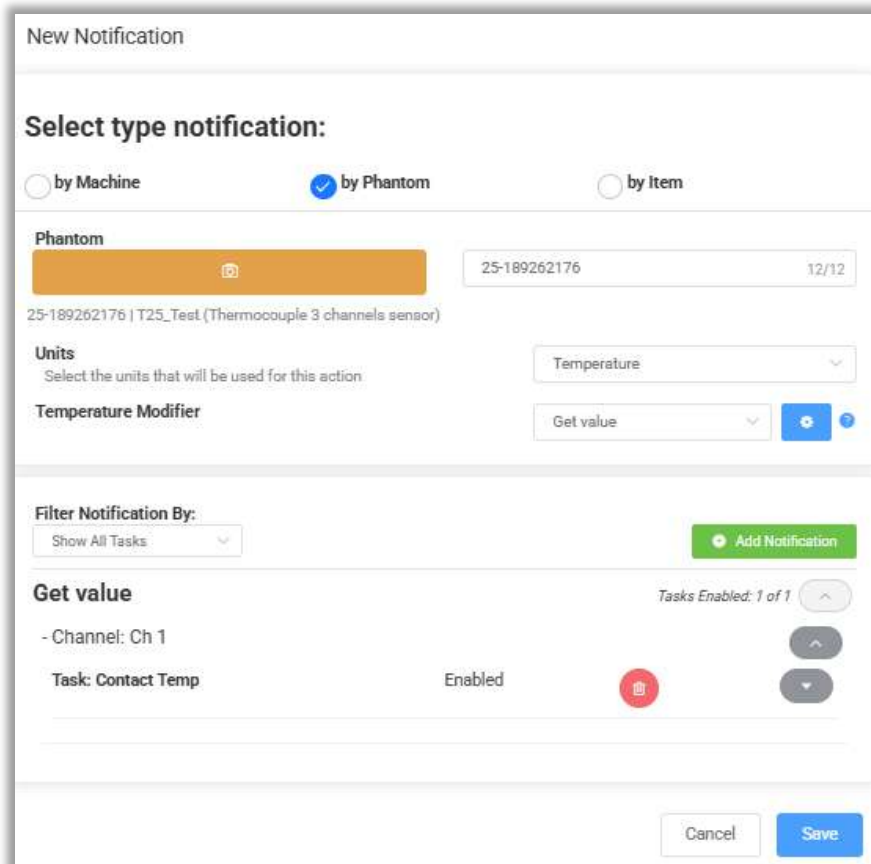


Either scan the QR code on the sensor or enter the serial number.

The **Units** drop-down field will show all available options, based on the Phantom Code entered. **Note** - As per the on-screen tip, If you want to use any unit modifier other than RMS for vibration sensors, you must edit the DB Settings of the EI-Analytic account. E.g., you want to receive notification based on a peak-to-peak value instead of RMS.

To do so, click the Enable Modifiers button.



To continue setting the Task, press the Add Notification button.



1. Start by assigning the Task a **Name**.
2. Select the Channel (1-4 for a temp sensor).
3. Choose a **Condition**



4. Set the **Value**. Note the Units shown on the left of the screen. Here temp is selected, so the units shown is C, based on account settings (Imperial or Metric).
5. Add the **Title** (displayed in the Task Name field of the email), and the **Content** (shown in the Message field in the email) to identify which machine/point has experienced an alarm.
6. The **Send email** slider provides a quick enable/disable option.
7. **Email mode** allows a choice between Batch and Immediately. Batch emails are sent daily (usually between 9 and 10 AM EST). This way, if your notification is not considered to be critical, an alarm is sent only once a day.
8. The **Time interval** provides a buffer between notifications to avoid unnecessary emails. Push notifications to WiSER Vibe mobile app users likewise has a configurable **Time interval**.
9. Click **Save** to complete the Task addition.

The Task Management page now shows the new Task, it can be easily edited or deleted.

Code	Asset	Location	Unit	Actions
189300650	P1_Motor_DE	ABC Company - Area1 - Pump_001 - Motor_DE	Acceleration	
189262176	T25_Test	ABC Company - Area1 - T25_Temp	Temperature	
189275016	TCam1	Tomco - Garage - TCam	Max Temperature	

Example 2 – set a Task to report an Peak-to-Peak Acceleration alarm for a V11 vibration sensor.

A reported value over 2.5 g on any axis will cause a Notification to be sent:

### New Notification

**Select type notification:**

by Machine  by Phantom  by Item

**Phantom**

11-189300650 | P1\_Motor\_DE (High Range Accelerometer)

**Units**  
Select the units that will be used for this action

**Acceleration Modifier**

---

**Filter Notification By:**

**Peak to peak** Tasks Enabled: 1 of 1

- Channel: All Channels

Task: Acceleration Alarm Enabled

---

**Name**

**Channel**

**Condition**

**Value 1 (g)**  
Enter the value to compare

---

**Body Notification**

**Title**  
Enter the title of the notification

**Content**  
Enter the content of the notification

**Send email**  
activate this option to receive email notifications


**Email mode**  
select the way you want to receive emails (only applies to the owner).

**Time interval for Sending Emails**  
time interval for sending or collecting emails, it will not be executed within this interval if the condition repeats.

ⓘ If you are the owner of the database, you can enable "Email Mode", which only applies to you. To enable email notification feature for your shared users, a paid subscription is required. Once you have subscribed, you can easily configure the email notifications and allow your shared users to receive them.

**Time interval for Push Notifications**  
time interval for sending push notifications (owner and all shared users), it will not be sent within this interval if the condition is repeated.

Below is an example email notification received for a Task assigned to a Phantom Thermographic

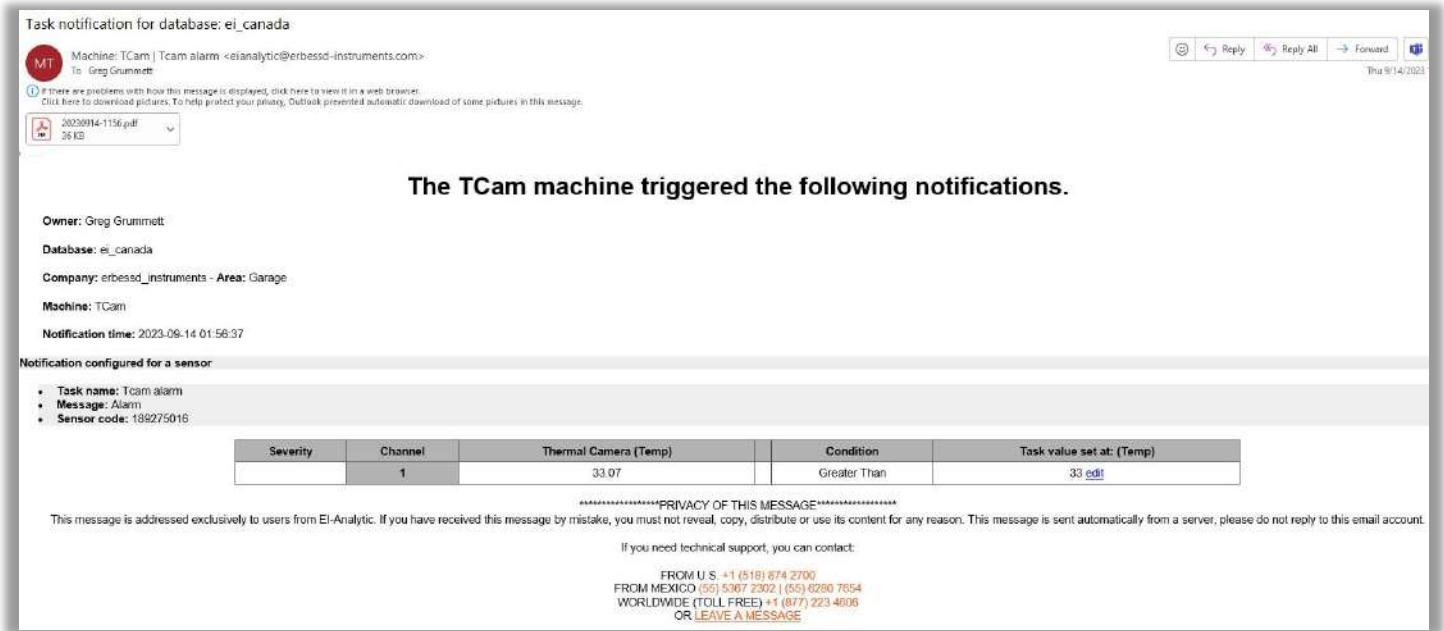

## EI-Analytic Diagnose Manager

Diagnose Manager is an EI-Analytic feature that analyzes vibration signal files from Phantom Expert triaxial or WiSER3X portable sensors and assigns a percentage probability to the possible root cause(s) of the vibration measured.

This tool calculates the probability of the following types of failure(Faults), based on a set of parameters(Rules), including the specific configuration of a Machine and its Points:


- Static Imbalance
- Couple Imbalance
- Dynamic Imbalance
- Parallel Misalignment
- Angular Misalignment
- Bent Shaft
- Bearing Fault: Stage 2, 3, 4.
- Cocked bearing
- Bearing Looseness

For each parameter, certain conditions must be met to a greater or lesser extent, which is reflected in the Diagnostic evaluation.

Diagnose Manager also allows the creation of Custom Faults and associated Rules that can be applied to the machine database. See below for more details.

## Accessing the Feature

Diagnose Manager is accessed from the Database drop-down menu on the EI-Analytic Dashboard. It can also be opened from the Options Menu of the WiSER Vibe mobile app.

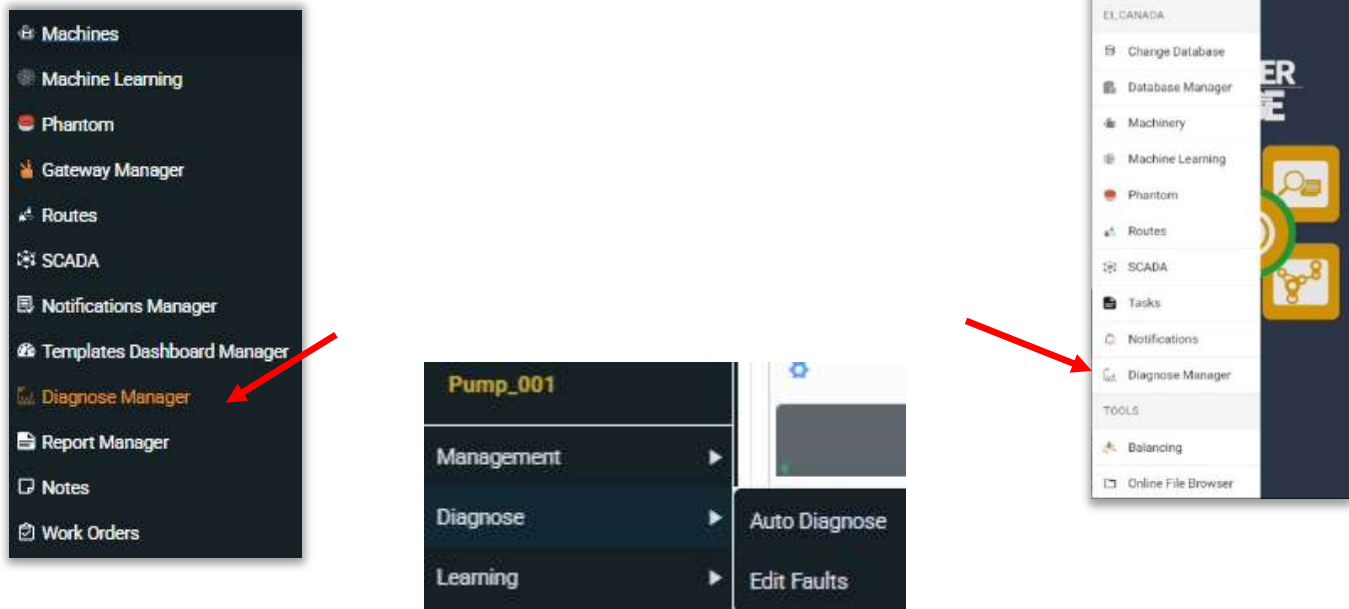

Links to Diagnose Manager have been added to many screens in EI-Analytic. In the Machine Tree, right-click on any Machine or Point, and an **Auto Diagnose** option is now available. Machine and Point views, as well as the Bad Actor List all now have links to the Diagnose feature.

The **Diagnose Management** screen has three functions:



- **Diagnose Builder** – used to create custom rules for diagnostics
- **Diagnose Tools** - Load a machine for diagnostics using defaults or custom values.
- **Delete Faults** – used to remove faults or rules.




## Diagnose Tools

The Diagnose Tools screen is used to load a Machine Point for analysis and display the results:

Press the **Load Machine or Point** button to open the Machine Tree, then select a Machine or Point for analysis:

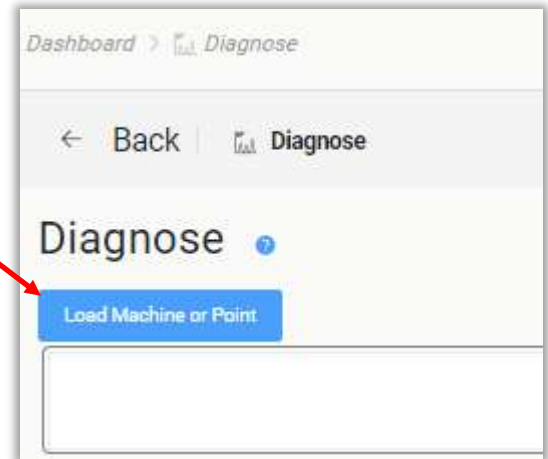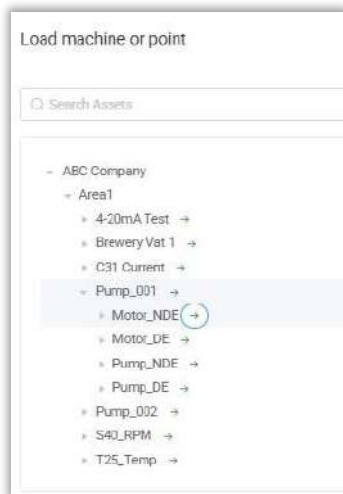

When opened, a graph with data for the past 30 days is displayed.

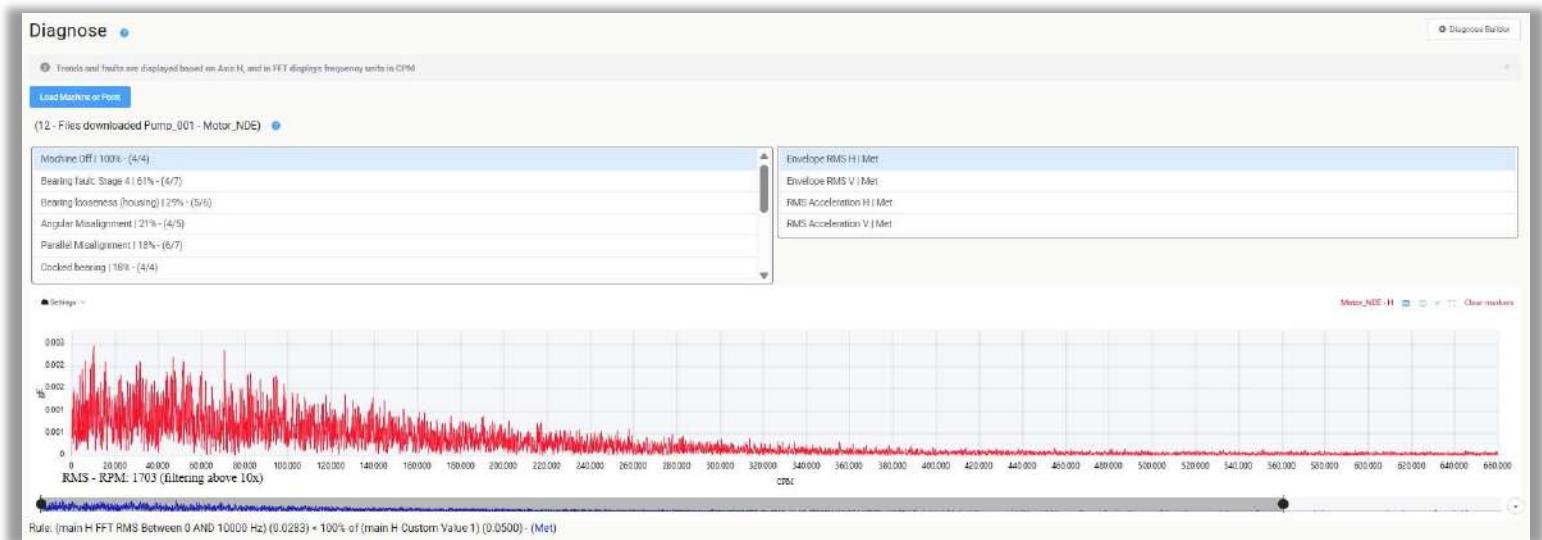

The Diagnosis for the machine point is highlighted. In this example it was correctly diagnosed as **Machine off** condition, based on the rules.



Diagnostic results are listed by Machine Point. **Note** -The **H** axis is always used for trends and fault diagnosis.

A list of faults and their probability are shown, based on analysis. The Rules used are listed in the right panel. Click a Rule to see the results in the FFT, with more detail displayed at the bottom of the screen, including the default operators and values used.

The FFT can easily be zoomed by using the slider tool at the bottom.

## Using Diagnose Builder

To create custom faults, use the Diagnose builder button on the main Diagnose screen.

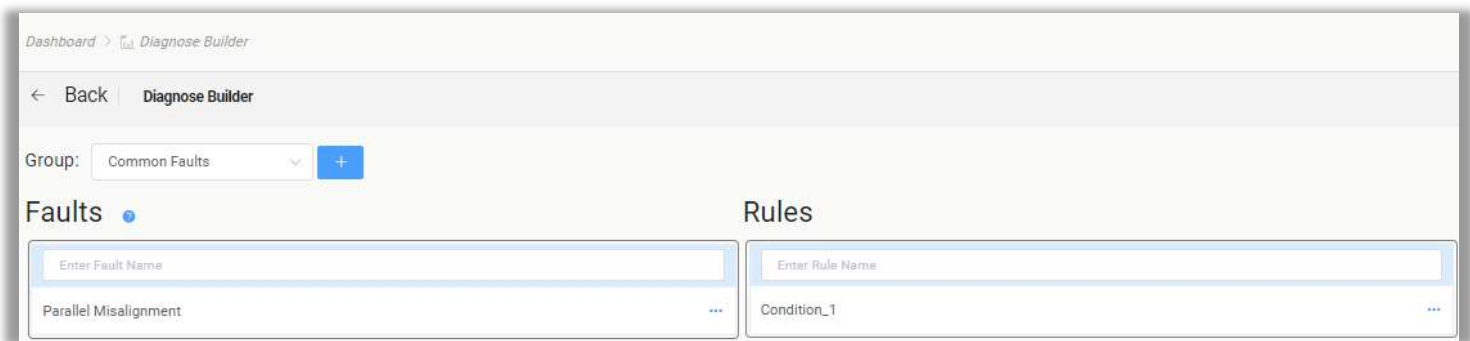



Create a **Group** name for custom Faults by clicking the blue add button.



- **Faults and Rules:** Name the Fault and the Rule for the first condition to met. Click the checkmark when finished.



- Now select which Machine and Points to apply the Rule using the  button.

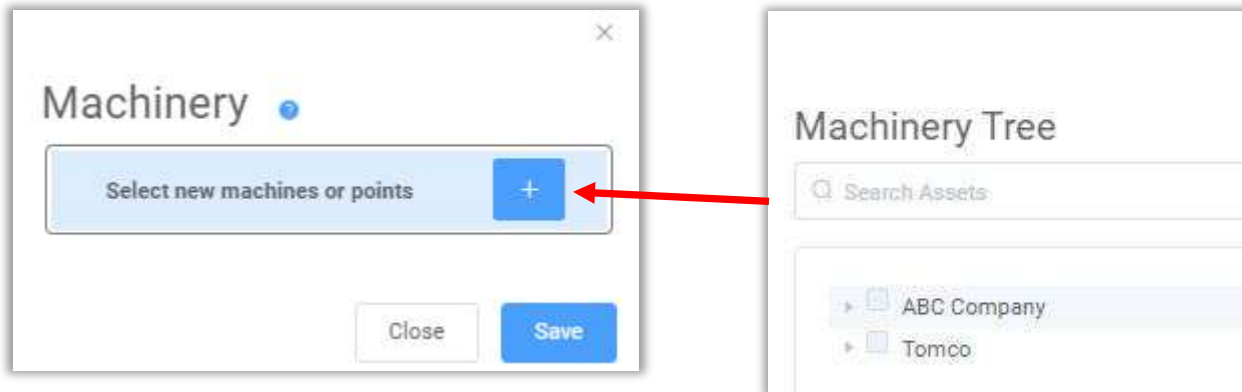


Click Close and then continue with the Rule:

**Name and ID:** The Name will be used for user reference and ID is used internally to identify the rule.

- **Value A and B** - The equation is composed of two values; both values are taken as reference for comparison and must be configured.
  - **Location** – set to one of three options: 1) the point to be analyzed, 2) the complement to compare with, or 3) the coupling between them.
  - **Axis** – Select the axis for the Point to be diagnosed. (the default rules always use the H axis)
  - **Units** – Choose the preferred units.
  - **Value type** - Value of the signal that will be taken as a reference.
  - **Range** – Set the range of frequencies to analyze.
  - **Order** - Select the number of orders.
  - **Bearings** - Choose one or more bearing frequency faults. In case of multiple selections, the highest value will be used.
- **Operator** - used for comparing Value A and Value B. (equal to, greater than, etc)

- **Factor%** - This is a “weighting” factor applied to the result of the comparison of Value A and B. The higher the percentage, the more absolute the comparison between A and B must be to meet the Rule.

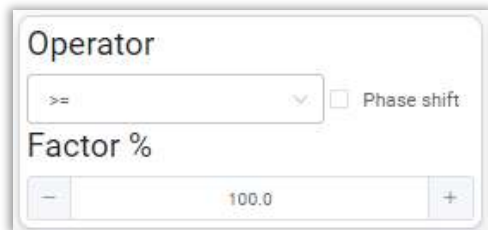


Operator

>=  Phase shift

Factor %

100.0

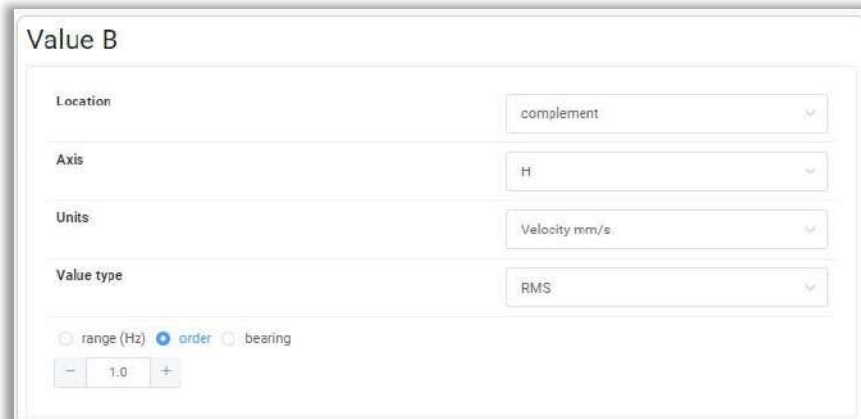

Value B

Location complement


Axis H

Units Velocity mm/s

Value type RMS


range (Hz)  order  bearing

1.0

Press  to complete the custom Fault and Rule configuration.

## Delete Faults

Used to delete Custom Faults or Rules

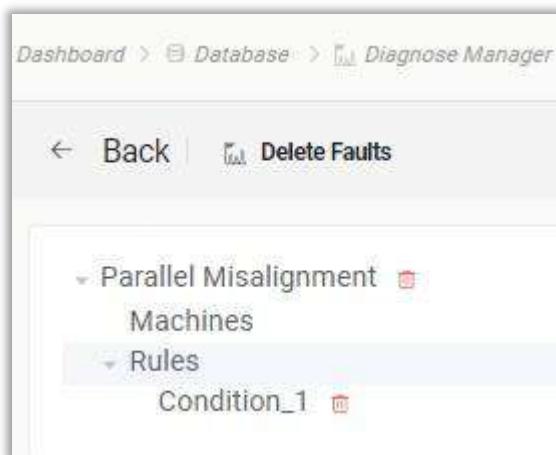

Dashboard > Database > Diagnose Manager

← Back Delete Faults

Parallel Misalignment

Machines

Rules

Condition\_1

For further information, please contact the Erbesd Instruments support team.



## WiSER VIBE Mobile App

### On Demand Recordings from Phantoms

There may be situations when immediate recordings are desired from a Phantom sensor. On-demand recordings can be requested from the Gateway Admin Console, or by using the magnetic key to manually reset the sensor, causing it to send an immediate recording.

Immediate on-demand recordings can also be generated using the WiSER VIBE mobile app. This mobile app was developed for use with the WiSER 3X portable triaxial sensor to perform Routed data collections. The app is a versatile tool with all the features of EI-Analytic, adapted to hand-held devices using iOS or Android.


Recording files are saved on the mobile device and can be uploaded directly from WiSER VIBE to the EI-Analytic cloud service (if the sensor is registered in an EI-Analytic database) or emailed from the app to a DigivibeMX user for analysis. WiSER VIBE is a free download for iOS devices from the Apple App Store or the Google Play Store.

To take on-demand recordings from Phantoms:


Download the WiSER VIBE application from the Google Play Store or App Store. Search on Wiser Vibe for quick access.


Install and launch the WiSER VIBE App.

Once installed and opened, the Home screen appears as shown below. Make sure Bluetooth is activated on your wireless device.

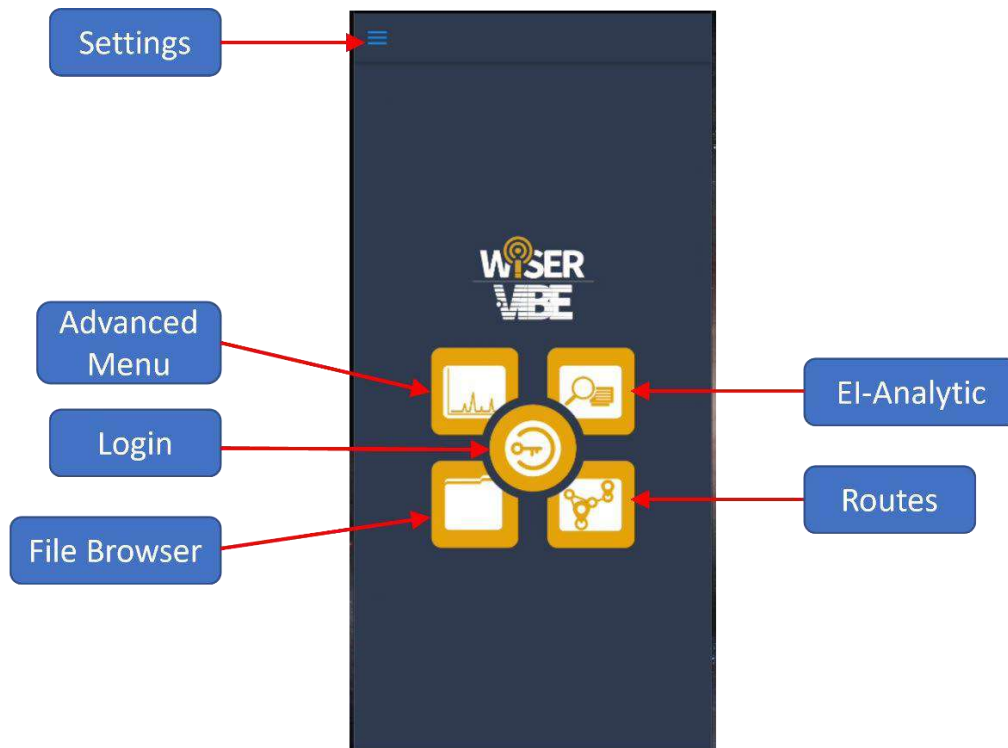


Logging in to your EI-Analytic account is optional to take recordings from Phantoms, however if you have Internet access, you may choose to login:



1. Tap the centre of the Home screen to login to your EI-Analytic cloud database.
2. Input your account credentials and press Log in.
3. Select the desired database and press 

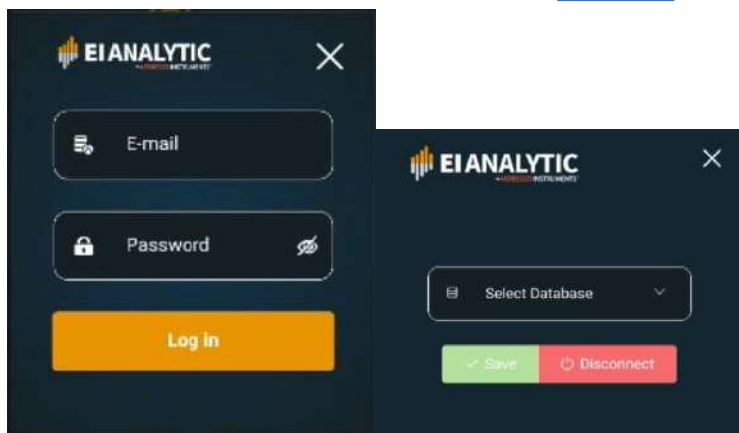


- The Home screen shows a green ring around the Login icon to indicate successful connection to an EI-Analytic database. Your Login credentials will be saved, so subsequent logins will not require entering your Email address and password.
- You must be logged in to your EI-Analytic account to upload files to the cloud database.

## Scan for Phantoms

Tap the Options icon (aka the hamburger)  at the top left of the Home screen, and select **Bluetooth Devices**. Click the **Options** icon and choose **Download to this device** or **Download and Queue**.

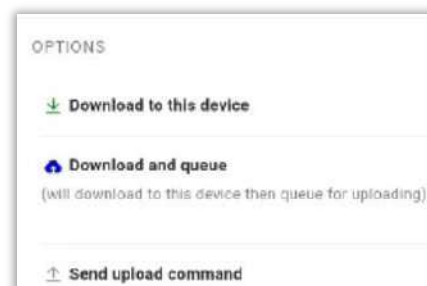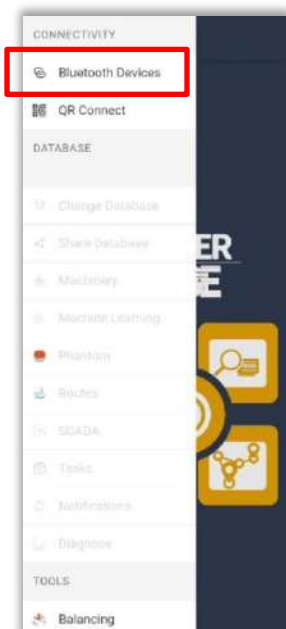


Press **Scan bluetooth sensors**

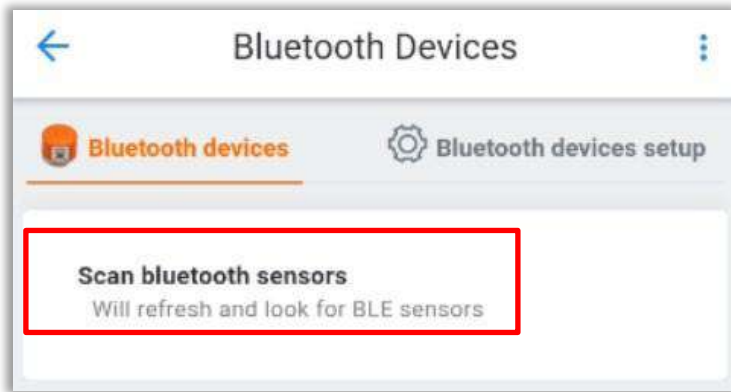


Sensors will show as “Unknown” if you are not logged into an EI-Analytic database.


When the desired sensor(s) appear, you can press **Stop Scanning**.


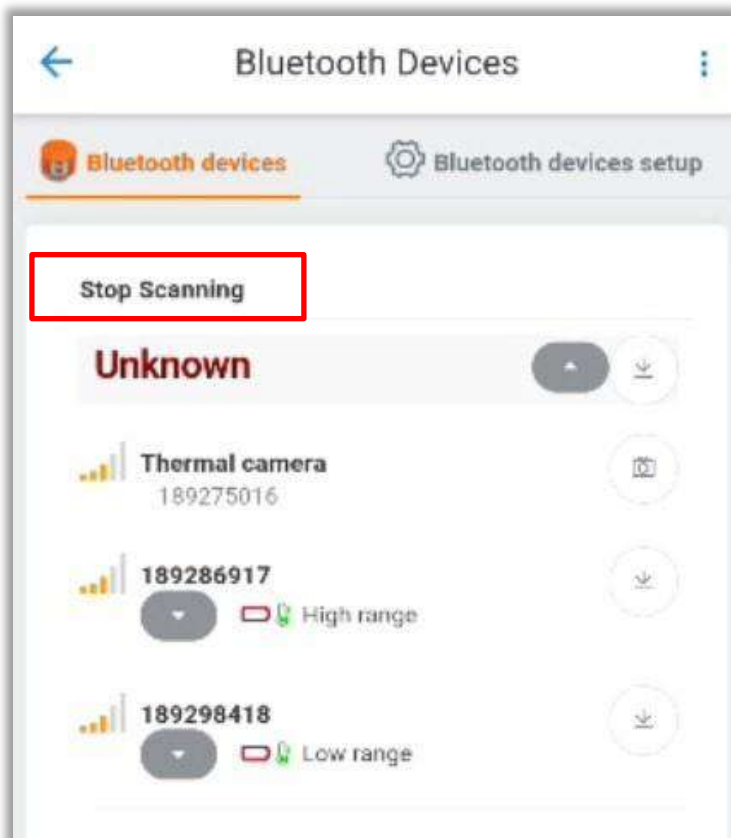


## Collecting Data

Tap the download icon(s)  to request a data collection from one or more sensors.

Progress is shown by a **percent complete circle** that replaces the download icon on your screen.


A message is displayed to indicate a successful data collection. The data is now saved in a file on your device. If you tap the green right arrow,  the file will be opened for analysis.

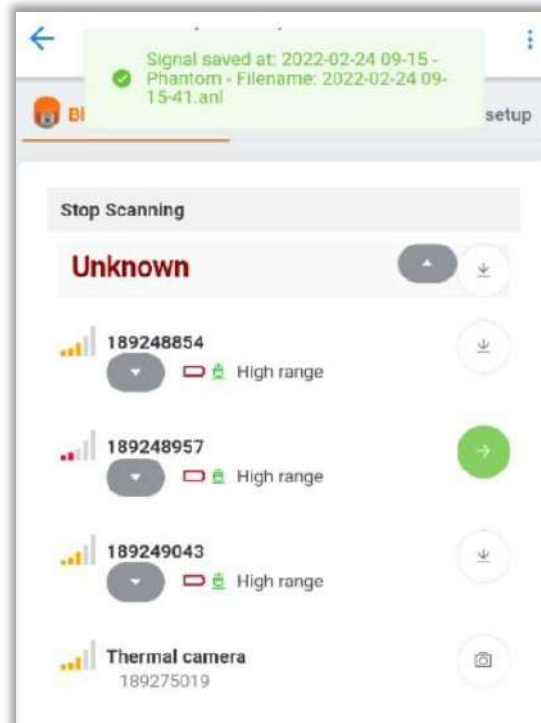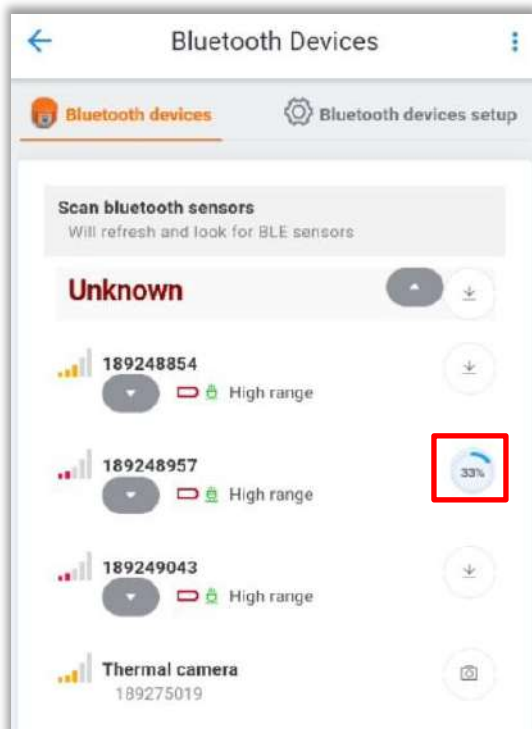

### Uploading files to the Cloud

To upload a recording to the EI-Analytic cloud database:

1. Log in to your EI-Analytic account as described above.
2. Open the File Browser from the Home screen:

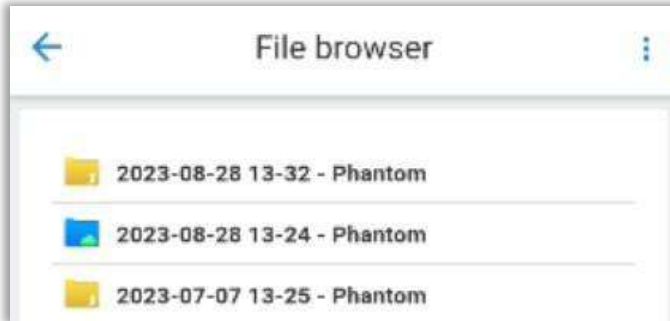



File Browser




Blue folders have previously been uploaded, yellow folders have not.


3. Click on a folder to view its contents. These .anl signal files can only be opened with DigivibeMX , EI Analytic, or the WISER VIBE mobile app.

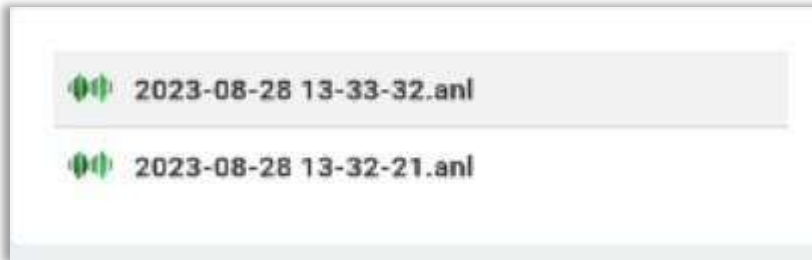


4. Tap the Menu icon  and select **upload to the cloud**.

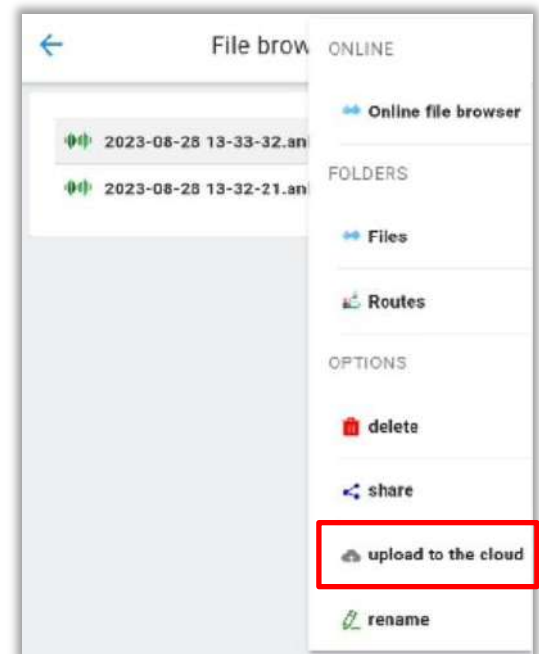

5. Choose the folders you want to upload (will be shown by checkmarks). All files in the selected folder(s) will be uploaded. You can also open folders to select individual files for upload as an option.

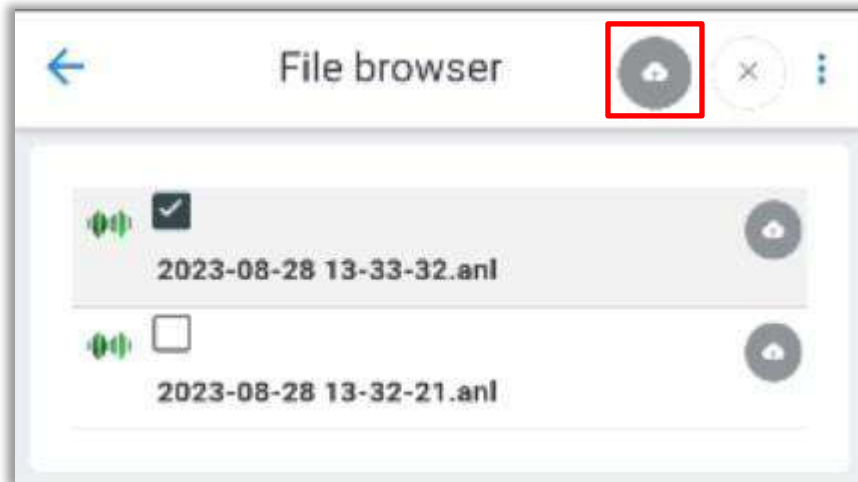

6. Tap the **cloud icon** at the top.
7. A message will be flashed at the bottom of the screen:




8. As the files upload successfully, you will see a message flashed at the top of the screen for each file.






If you do not see a successful upload message, or receive an error message, check to ensure you are logged into EI-Analytic, and are connected to the correct database. If you are logged in, but are receiving error messages, contact Erbesd Technical Support @ 1-877-223-4606, or open a ticket at <https://www.erbessd-instruments.com/ticket/> for assistance.

## Sharing Files


To share data files stored on your device via E-mail, text or other app:



1. Open the File browser menu and select 
2. Select the folder(s) to be shared (shown by checkboxes).
3. Tap the share icon at the top of the screen. 
9. The Share screen will open; choose text, email, WhatsApp etc., to send the .anl file(s) as attachments. **Note** - Phantom vibration sensors create data files of approximately 160kb in size. These .anl signal files can only be opened with DigivibeMX , El Analytic, or the WiSER VIBE mobile app.

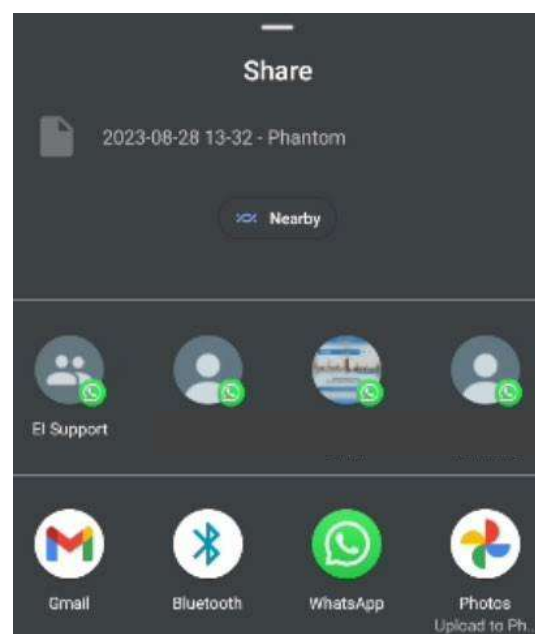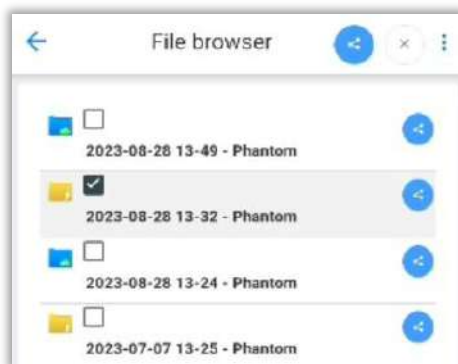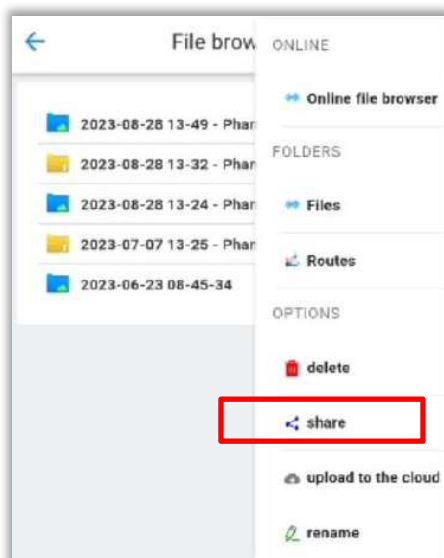

## Deleting Files

To delete files stored on your device:

1. Open the menu in the File Browser and select  delete

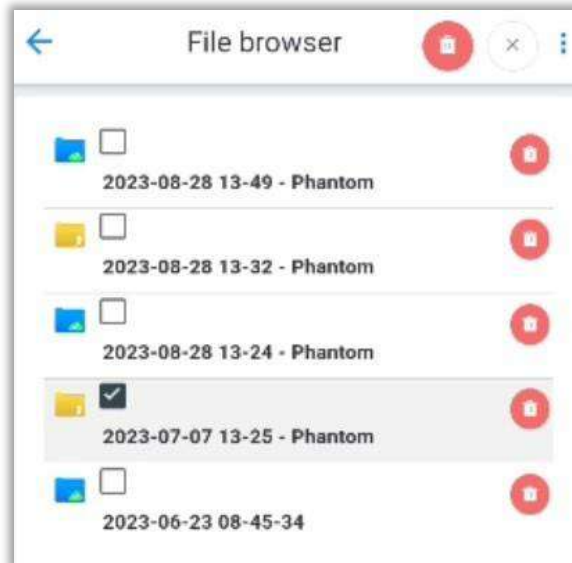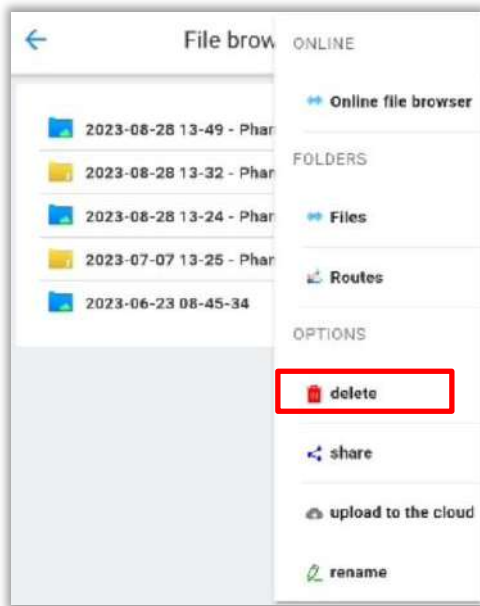


2. Select the folders to be deleted (shown by checkboxes) and press the delete icon at the top of the screen.
3. Confirm by pressing OK on the warning pop-up.



## Open File for Analysis

To open a vibration recording for analysis with WiSER Vibe, select the File Browser from the Home screen. Open the folder and tap on the desired .anl file. The Analysis screen will open, with the Time Waveform and FFT displayed. Many of the same tools used in DigivibeMX, such as Markers, are available in WiSERVIBE. Details regarding analysis are not included in this guide.

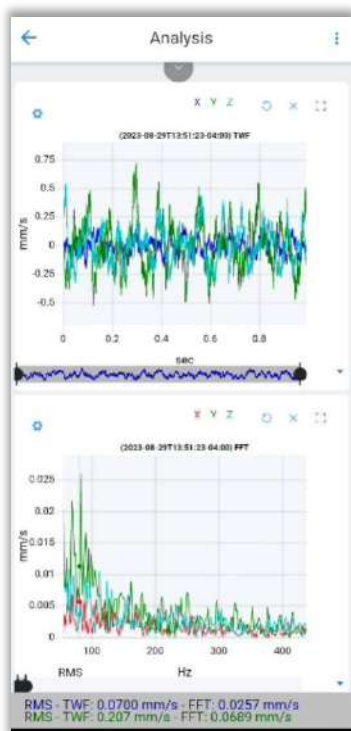

## Contacting Erbesd Instruments Technical Support

If at any point this guide does not answer your questions or resolve an issue, please contact Erbesd Instruments technical support using any of the following methods:


1. Visit our website and leave us a support ticket, to report minor software/firmware/device functionality concerns. Go to [www.erbessd-instruments.com](http://www.erbessd-instruments.com). From the Support menu, select **Log A Ticket**. Or initiate a Live Chat.



2. For more urgent assistance, contact our support team by email at: [support@erbessd-instruments.com](mailto:support@erbessd-instruments.com)
3. For the most immediate emergency assistance, contact us by phone at +1 877-223-4606 (International Toll Free)

Erbesd Instruments technical support staff use TeamViewer remote support software to provide real-time remote PC support. A download link for the free QuickSupport version of TeamViewer is provided in the DigivibeMX software.

Click **Remote Support** on the DigivibeMX Start Menu to download TeamViewer QuickSupport. Allow the program to download, install and launch. Then be prepared to provide the TeamViewer User ID and Password it provides to the responding Erbesd Instruments support engineer.

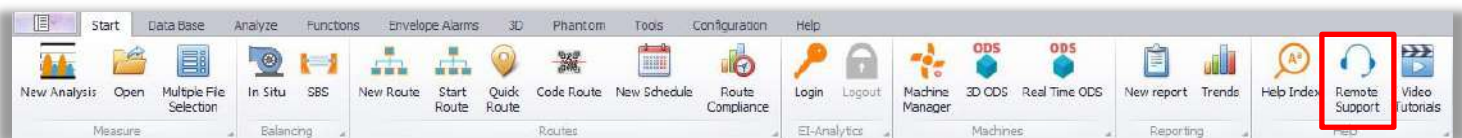

For additional information on other specific Phantom system configurations and options, please visit the Tutorials section of our website at: <https://www.erbessd-instruments.com/erbessd-tutorials/>